








Generator 18" from wall
and 5' from window vent is
half-way on walkway and
in front of gate.

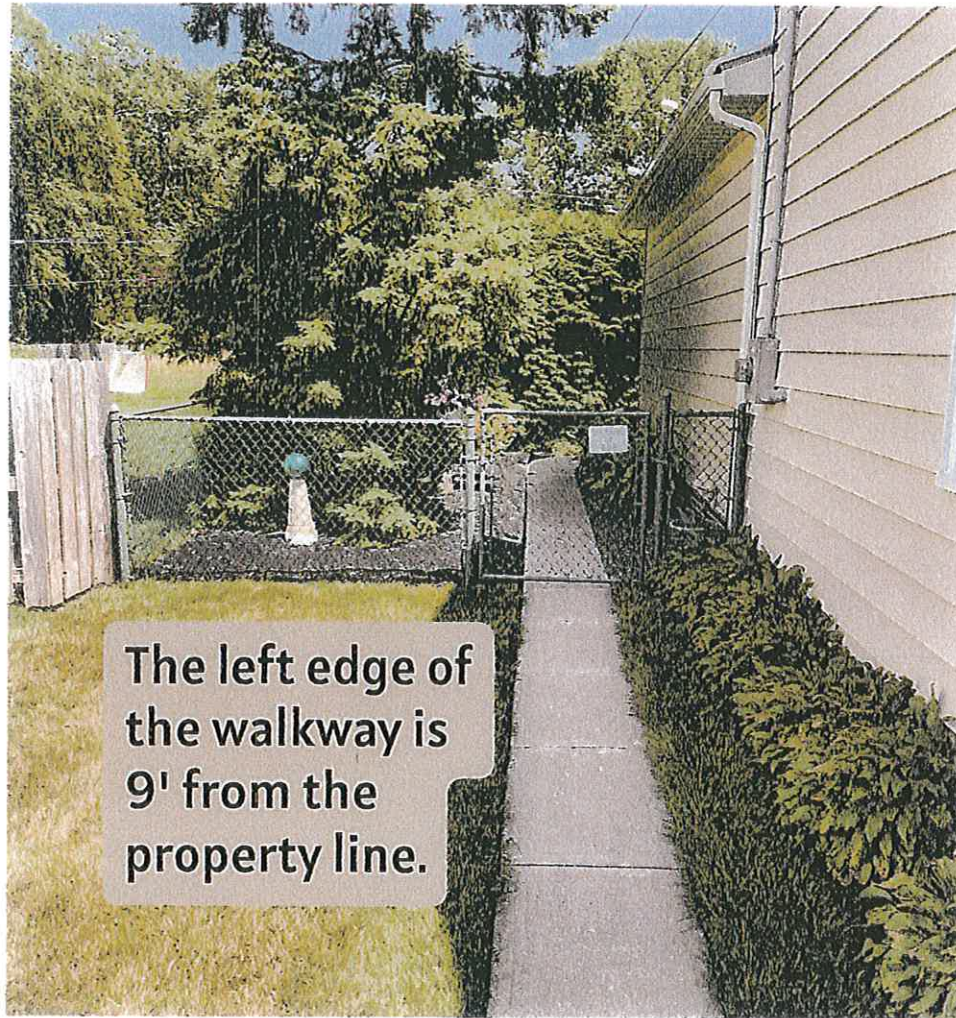

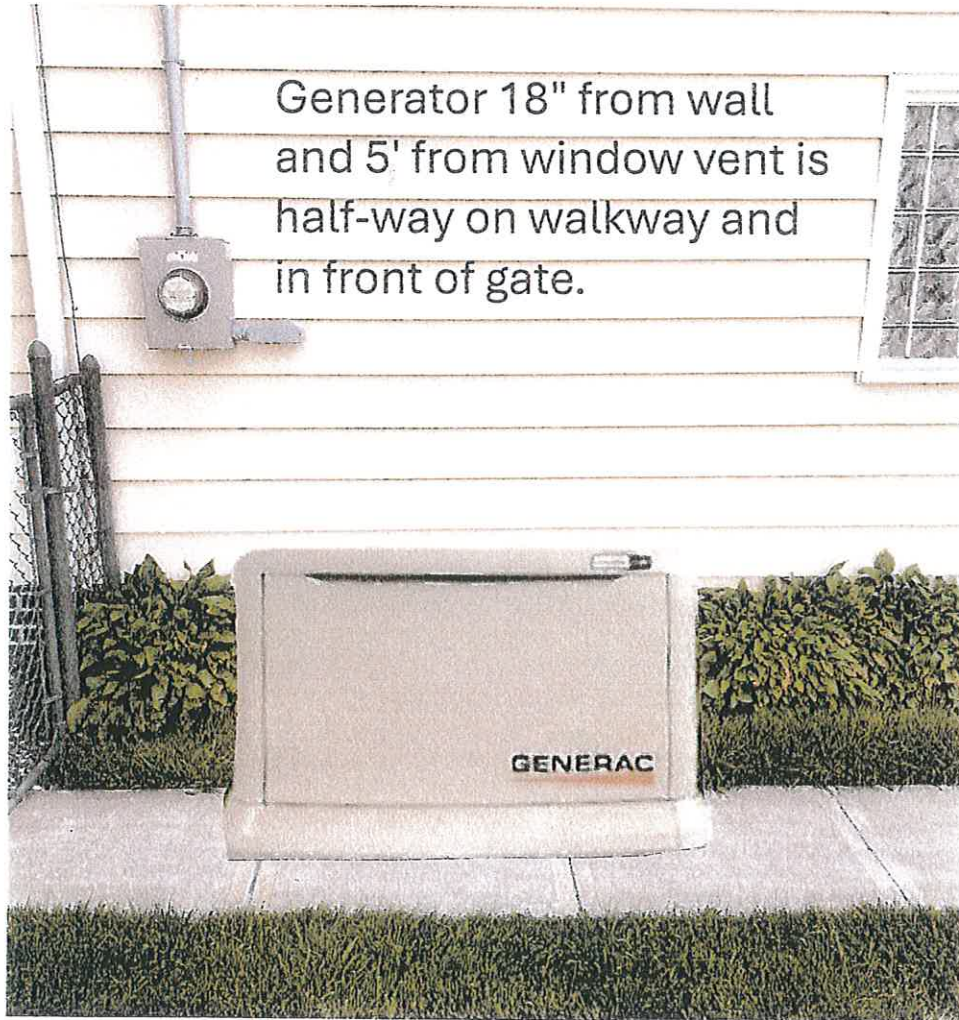


Proposed secure area
for generator.

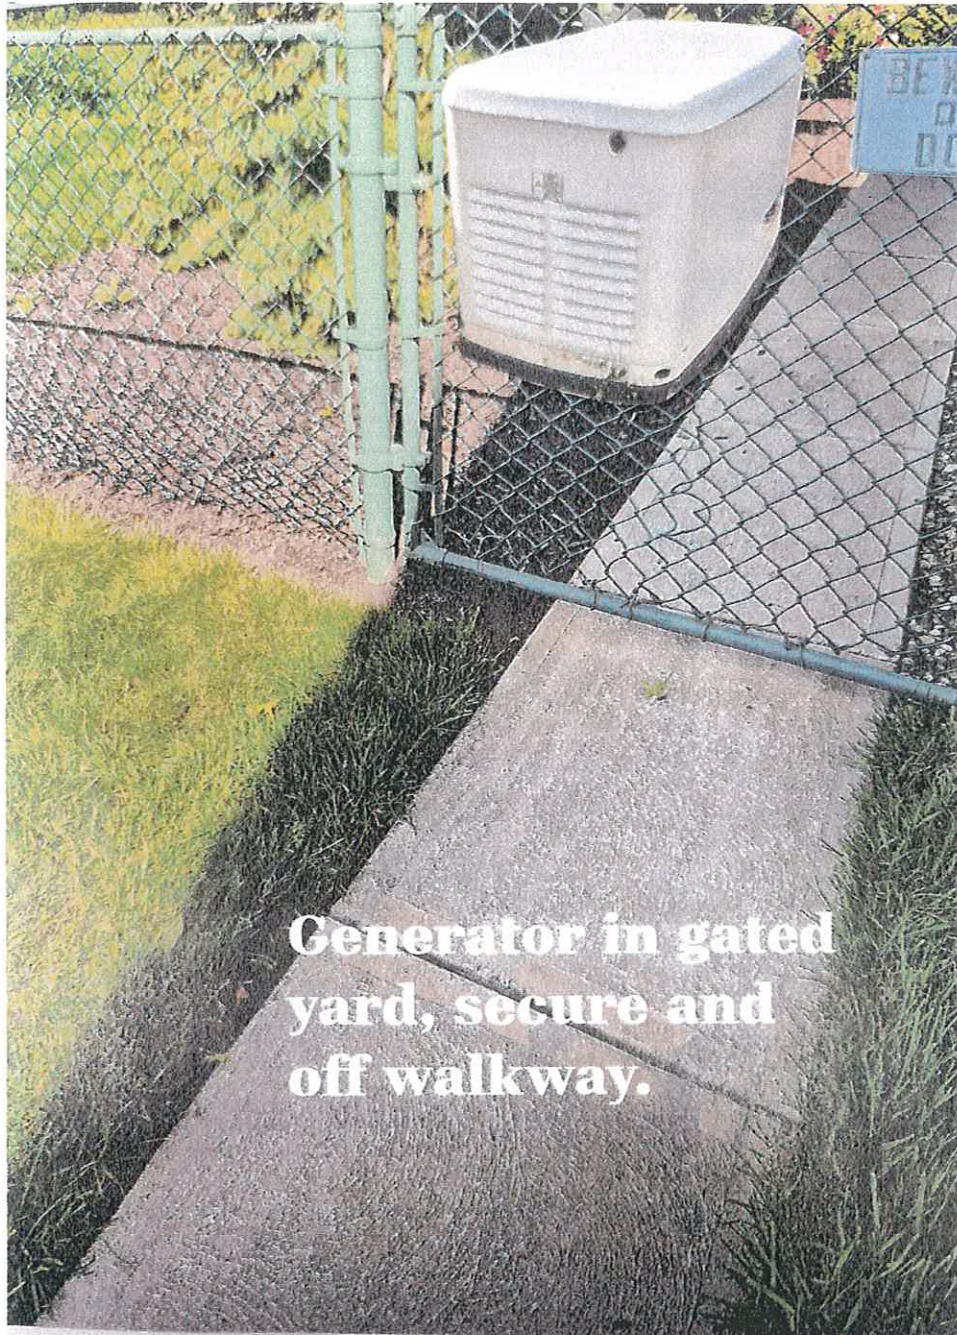


**Generator in gated
yard, secure and
off walkway.**

Site plan is not to scale, and equipment locations shown are approximate and intended to represent general placement only.

Generator A: with VARIANCE - no less than 6' to properly live.
Generator B: without VARIANCE

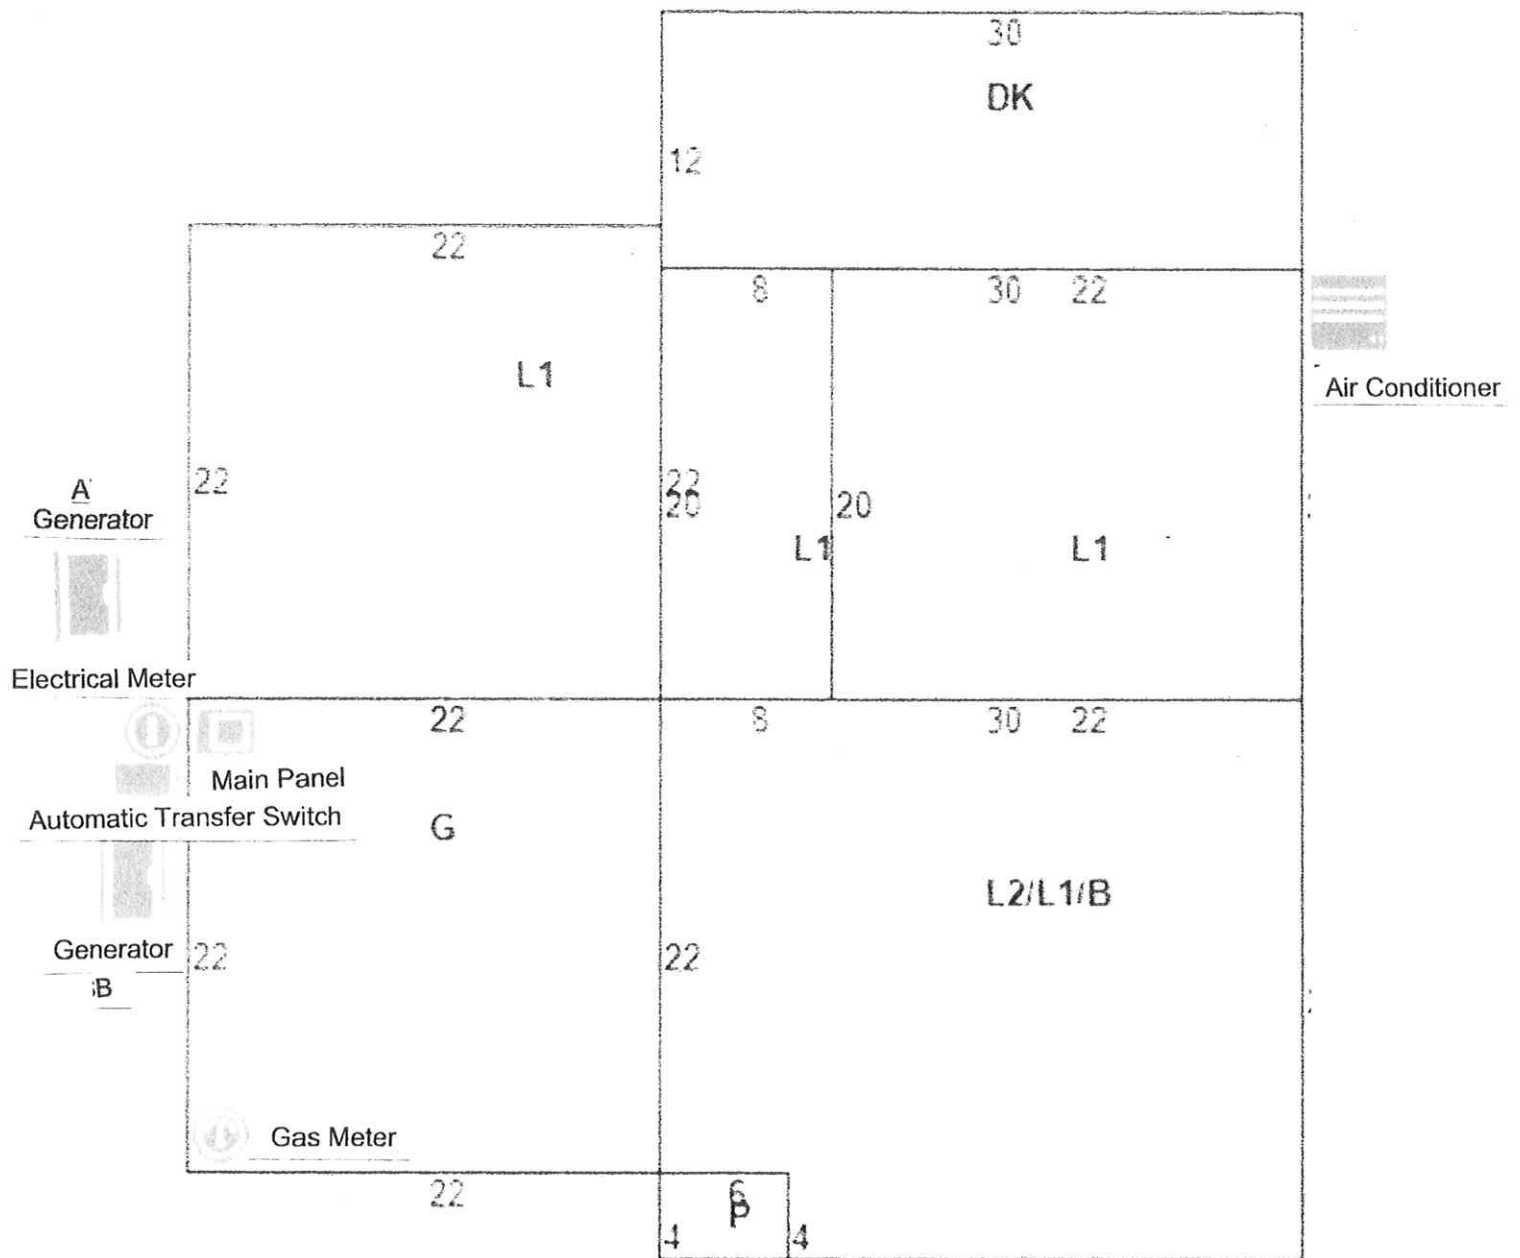

PLACEMENT DIAGRAM — AIR-COOLED GENERATORS

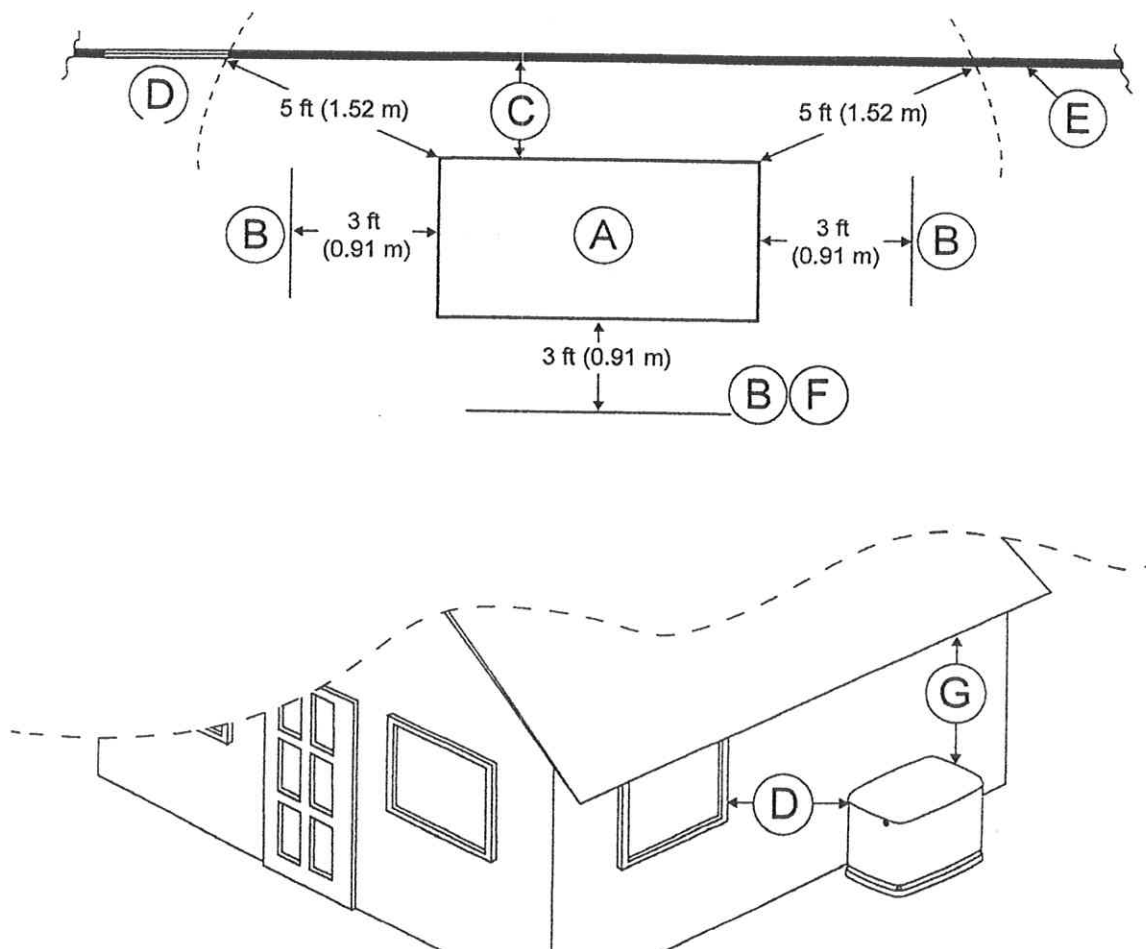

ID	Description	Comments
A	Top of generator	—
B	Front and end clearance	Minimum clear distances cannot include shrubs, bushes, or trees.
C	Rear clearance	18 in (45.7 cm) minimum clearance per NFPA testing, labeling, and listing, unless state or local codes dictate otherwise.
D	Windows and openings	No operable windows, doors, or openings in the wall are permitted within 5 ft (1.52 m) from any point of the generator.
E	Existing wall	One-hour fire rated walls allow closer placement of the generator set without approved enclosure. Confirm before installation.
F	Removable fence	Removable fence panels for servicing cannot be placed less than 3 ft (0.91 m) in front of the generator.
G	Overhead clearance	5 ft (1.52 m) minimum distance from any structure, overhang, or projections from the wall. DO NOT install under wooden decks or structures unless this distance is maintained.