

[illegible]

PROJECT SCOPE: THIRD FLOOR CONVERSION TO A SINGLE FAMILY RESIDENCE						
			GUARDRAIL AND HANDRAILS	200 P.S.F.	15 P.S.F.	25 P.S.F.
			GUARDRAIL INFL. COMPONENTS	50 P.S.F.	15 P.S.F.	65 P.S.F.
A-10			PASSENGER VEHICLE GARAGES	50 P.S.F.	15 P.S.F.	65 P.S.F.
			SPECIFICATIONS			

GENERAL NOTES

WHEN THIS PLAN IS SUBMITTED FOR PERMIT IT IS UNDERSTOOD THAT THE BUILDER HAS REVIEWED THE DOCUMENTS AND HAS ACCEPTED THE PLANS AS READY TO CONSTRUCT. IF QUESTIONS ARISE, CONTACT THE ARCHITECT IMMEDIATELY IN WRITING.

NOTE: ALL SPECIFICATIONS FOR THIS PROJECT SHALL CONFORM TO INTERNATIONAL CODE (LATEST EDITION), WHETHER INDICATED OR NOT. THE USE OF THESE DOCUMENTS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED. REUSE OR REPRODUCTION OF THE DOCUMENTS (IN WHOLE OR IN PART) FOR ANY OTHER PURPOSE IS PROHIBITED. SCHILL ARCHITECTURE, INC. & STEPHEN M. SCHILL RETAINS ALL RIGHTS OF OWNERSHIP FOR THESE DOCUMENTS.

IF A DISCREPANCY OR CONFLICT BETWEEN CODE REQUIREMENTS, DRAWINGS DETAILS, SPECIFICATIONS, ENGINEERING DATA, MANUFACTURER'S RECOMMENDATIONS, OR OWNER PROVIDED INFORMATION EXISTS, THE CONTRACTOR, HE OR SHE SHALL PROMPTLY REPORT THE CONFLICT OR DISCREPANCY IN WRITING TO THE ARCHITECT OR OWNER'S REPRESENTATIVE FOR CLARIFICATION AND CORRECTIVE ACTION. IN ADDITION, ANY WORK INSTALLED IN CONFLICT WITH REQUIREMENTS IDENTIFIED HEREIN WITHOUT PROPER NOTIFICATION SHALL BE CORRECTED BY THE CONTRACTOR AT HIS OR HER EXPENSE, AND AT NO COST TO THE ARCHITECT, ENGINEER, OCCUPANT, OR BUILDING OWNER.

THE CONTRACTOR SHALL DETERMINE ERECTION PROCEDURE AND SEQUENCING AND PROVIDE WHATEVER BRACING THAT MAY BE REQUIRED TO COMPLETE THE WORK.

VERIFY ALL ROUGH OPENINGS WITH MANUFACTURER PRIOR TO FRAMING.

EACH SUBCONTRACTOR SHALL OBTAIN AND PAY FOR REQUIRED PERMITS AND SCHEDULE ALL INSPECTIONS AND COORDINATE ALL TRADES. THE CONTRACTOR AND SUB-CONTRACTORS SHALL BE SOLELY RESPONSIBLE FOR COMPLYING WITH ALL FEDERAL, STATE, AND LOCAL SAFETY REQUIREMENTS TOGETHER WITH EXERCISING PRECAUTIONS AT ALL TIMES FOR THE PROTECTION OF ALL PERSONS INCLUDING EMPLOYEES AND PROPERTY. IT IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND SUB-CONTRACTORS TO INITIATE, MAINTAIN, AND SUPERVISE ALL SAFETY REQUIREMENTS, PRECAUTIONS, AND PROGRAMS IN CONNECTION WITH THE WORK.

SYMBOLS AND ABBREVIATIONS IN THESE DRAWINGS ARE CONSIDERED TO BE CONSTRUCTION STANDARDS. IF THE CONTRACTOR HAS QUESTIONS REGARDING ABBREVIATIONS OR SYMBOLS AS TO THEIR EXACT MEANING, THE ARCHITECT SHALL BE NOTIFIED AT ONCE FOR CLARIFICATION. ALL EXTERIOR WALLS ARE 4" U.O.N. ON BOTH FLOORS. ALL INTERIOR WALLS ARE 3-1/2" ON THE MAIN FLEVEL AND 3-1/2" ON ALL OTHER LEVELS U.O.N. INTERIOR DIMENSIONS TAKE PRECEDENCE OVER SCHEDULED DIMENSIONS.

NOTIFY ARCHITECT OF ANY DISCREPANCIES. CONTRACTOR TO VERIFY ALL MEASUREMENTS ON JOB SITE.

ALL WINDOWS ARE INDICATED BY FRAME SIZE. ALL WINDOWS SHALL HAVE DESIGN PRESSURE RATING IN ACCORDANCE WITH R.C.O. 62.5

PROVIDE 1/4" INSULATED METAL DOOR (C LABEL) OR EQUAL TO GARAGE.

SMOKE DETECTORS SHALL BE HARD WIRED AND INTERCONNECTED TO BATTERY BACKUP.

PROVIDE CARBON MONOXIDE DETECTORS OUTSIDE OF EACH SLEEPING ROOM.

ALL UNDERGROUND ELECTRIC LINES SHALL BE EMBEDDED IN SAND.

SUMP PUMPS SHALL HAVE AN INLINE CHECK VALVE.

ALL HABITABLE ROOMS SHALL HAVE AGGREGATE GLAZING OF NOT LESS THAN 9% OF THE FLOOR AREA OF THE ROOM.

ROOMS USED FOR SLEEPING SHALL COMPLY WITH R.C.O. SECTION 3101 FOR EGRESS REQUIREMENTS.

ENCLOSED ACCESSIBLE SPACE UNDER STAIRS SHALL HAVE WALLS AND BOFFITS PROTECTED ON ALL SIDES BY 5/8" GYPSUM BOARD.

ALL HANDRAILS SHALL BE MOUNTED BETWEEN 34" MINIMUM & 38" MAXIMUM, MEASURED FROM THE NOSE OF THE TREAD.

FLOOR & BALCONY RAILINGS SHALL FORTH A GUARD NOT LESS THAN 36" IN HEIGHT WHEN MORE THAN 30" ABOVE FLOOR OR GRADE BELOW.

ALL STAIRS SHALL COMPLY WITH R.C.O. 311.1.4. NO RISER SHALL EXCEED 9-1/4" AND NO TREAD SHALL BE LESS THAN 9".

ALL STAIRS SHALL BE SPACED TO PROMOT A SPHERE OF 6" IN DIAMETER FROM PASSING THROUGH IT.

STEP FLASH AT ALL ROOF AND WALL INTERSECTIONS WITH KICK FLASHING AT GUTTER WALL LOCATIONS.

HEADROOM AT ALL STAIRS SHALL BE 6' 8" MINIMUM.

ACCESS TO THE ATTIC AREAS IN COMPLIANCE WITH SECTION 801.1 IS REQUIRED. THE ACCESS PANELS OR DOORS SHALL BE IN READILY ACCESSIBLE LOCATIONS.

PROVIDE HANDRAILS ON ALL STAIRS PER CODE.

ALL MECHANICAL FLUES SHALL BE ROUTED TO THE REAR OF THE HOME.

CONDENSING UNITS SHALL BE PLACED IN THE REAR OR SIDE YARDS, DEPENDING ON ZONING, CONSULT WITH OWNER AND ARCHITECT ON THIS LOCATION.

AGRICULT SOIL BEARING CAPACITY IS 2,000 P.S.F. THE ARCHITECT IS NOT RESPONSIBLE FOR VERIFYING THIS CAPACITY. A GEOTECHNICAL ENGINEER SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND/OR HOMEOWNER. NOTIFY ARCHITECT OF UNUSUAL SOIL CONDITIONS.

ALL GARAGE DOORS OPERATED BY AN ELECTRIC OPENER SHALL HAVE AN AUTOMATIC SAFETY REVERSE FEATURE.

ALL STAIRS SHALL COMPLY WITH R.C.O. 311.1.4. NO RISER SHALL EXCEED 9-1/4" AND NO TREAD SHALL BE LESS THAN 9".

ALL TOILET AND BATH/SHOWER AREAS SHALL HAVE AN EXHAUST FAN.

PROVIDE SILL PITCH ON ALL WINDOWS AND DOORS TOWARD THE EXTERIOR.

PROVIDE PAN FLASHING FOR ALL OPENINGS.

VEHICULAR SHED SHALL BE INSTALLED A MINIMUM OF 34" TO THE INSIDE OF INTERIOR FACE OF THE EXTERIOR WALLS.

IT IS THE RESPONSIBILITY OF THE BUILDER TO NOTIFY THE OWNER OR F THE OWNER IS ACTING AS HIS OR HER OWN CONTRACTOR TO KNOW THAT ALL HOUSES HAVE A POTENTIAL TO HAVE RADON LEVELS WHICH MAY EXCEED THE RECOMMENDED LEVELS ESTABLISHED BY THE UNITED STATES ENVIRONMENTAL PROTECTION AGENCY. THE BUILDER AND/OR OWNER SHALL DECIDE WHAT ACTION, IF ANY, SHOULD BE TAKEN CONSIDERING RADON. IT IS NOT THE RESPONSIBILITY OF SCHILL ARCHITECTURE LLC TO DETERMINE IF A RADON ABATEMENT SYSTEM IS REQUIRED.

FOR ANY ELEMENTS OF CONSTRUCTION NOT SPECIFICALLY NOTED ON THESE PLANS, COMPLY WITH THE LATEST EDITION OF THE RESIDENTIAL CODE OF OHIO, UNLESS LOCAL BUILDING AND ZONING DEPARTMENTS ADHERE TO A SPECIFIC EDITION.

ALL PLUMBING, ELECTRICAL, HEATING AND COOLING SYSTEMS SHALL COMPLY WITH ALL ORDINANCES SET FORTH THE BY THE LOCAL GOVERNING BUILDING AND ZONING DEPARTMENTS. PLUMBING SHALL ALSO COMPLY WITH THE OHIO PLUMBING CODE. ELECTRICAL SHALL ALSO COMPLY WITH THE NATIONAL ELECTRIC CODE AND THE OHIO BASIC BUILDING CODE.

ALL 10 VOLT SINGLE PHASE & 120 AMP BRANCH CIRCUIT SUPPLYING OUTLETS OR DEVICES INSTALLED IN DUELING UNIT KITCHENS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DINING BEDROOMS, SUNROOMS, RECREATION ROOMS CLOSETS, HALLWAYS, LAUNDRIES, OR SIMILAR ROOMS OR SPACES SHALL BE PROVIDED WITH ARC-Fault PROTECTION.

SCHILL ARCHITECTURE LLC IS NOT A SURVEYING COMPANY. IT IS THE RESPONSIBILITY OF THE BUILDER AND/OR OWNER TO RETAIN THE SERVICES OF A REGISTERED SURVEYOR OR ENGINEER TO COMPLETE AN ACCURATE SITE AND GRADING PLAN.

PRIOR TO THE COMPLETION OF THE DESIGN PHASE, DURING THE DESIGN PROCESS ANY SITE STUDY DRAIN BY SCHILL ARCHITECTURE LLC WILL BE USED TO DETERMINE AN ESTIMATED BUILDABLE AREA AND AT NO TIME IS SCHILL ARCHITECTURE LLC RESPONSIBLE FOR THE LOCATION OF THE HOUSE ON THE LOT, ANY UTILITIES, BUILDING ELEVATIONS OR GRADING INFORMATION.

SCHILL ARCHITECTURE LLC IS NOT A MECHANICAL ENGINEER AND DOES NOT ALWAYS CONSULT WITH A MECHANICAL ENGINEER FOR MECHANICAL SCHEMATICS DRAIN BY SCHILL ARCHITECTURE LLC. ALL HVAC, PLUMBING AND/OR ELECTRICAL SCHEMATICS DRAIN BY SCHILL ARCHITECTURE, LLC ARE SUGGESTED AND FOR USE ONLY TO FULFILL THE BUILDING DEPARTMENTS PLAN SUBMITTAL REQUIREMENTS. IT WILL BE THE RESPONSIBILITY OF THE BUILDER AND/OR OWNER TO HAVE ALL ACTUAL MECHANICAL SYSTEMS DESIGNED AND INSTALLED BY LICENSED MECHANICAL SPECIALISTS.

SCHILL ARCHITECTURE LLC ASSUMES NO RESPONSIBILITY FOR ANY MECHANICAL INSTALLATIONS AND/OR ISSUES RELATED TO THEIR INSTALLATION.

ALL ROOFING ATTICS AND RAFTER SPACES SHALL HAVE CROSS VENTILATION WITH THE NET FREE VENTILATING AREA NOT LESS THAN 1/300 OF THE AREA TO BE VENTILATED. ALL OPENINGS SHALL BE PROTECTED AGAINST THE ENTRANCE OF SNOW AND RAIN.

ALL WINDOWS SHALL BE FLASHED AND SEALED OVER NAILING FLANGES WITH WINDOW FLASHING TAPE.

G.C. SHALL PROVIDE CAULK AND SEAL PACKAGE OF ALL GAPS BETWEEN FRAME WALLS.

ALL ROOFING AND/OR GABLES SHALL NOT BE REARDED. IF ANY OF THE CHANGES TO THE PLANS OR BUILDING DURING CONSTRUCTION, FIELD CHANGES MADE TO THE BUILDING WITHOUT THE CONSULTATION AND/OR APPROVAL OF THE ARCHITECT, THE BUILDER WILL BE THE SOLE RESPONSIBILITY OF G.C. AND BUILDING OWNERS.

G.C. SHALL NOTIFY THE ARCHITECT OF ANY QUESTIONS OR CLARIFICATIONS OF THE DESIGN DRAWINGS. ANY CHANGES OR ALTERATI

NOTE: ANY CHANGES TO THE PLAN, STRUCTURAL COMPONENTS OR SPECIFICATIONS WITHOUT THE WRITTEN AUTHORIZATION OF SCHILL ARCHITECTURE SHALL BE THE SOLE RESPONSIBILITY OF THE INDIVIDUAL OR ENTITY MAKING THE CHANGE.

FRAMING NOTES

ALL RESIDENTIAL PLANS DRAIN BY SCHILL ARCHITECTURE, LLC ARE STRUCTURALLY SIZED BY SCHILL ARCHITECTURE, LLC. ANY BEAM SIZE, WALL MOVEMENTS OR SPANNED OPENING CHANGES MADE DURING CONSTRUCTION TO A STAMPED SET OF PLANS WITHOUT CONSULTING SCHILL ARCHITECTURE, LLC COMPLETELY NEGATES ANY STRUCTURAL RESPONSIBILITIES OF SCHILL ARCHITECTURE, LLC.

SCHILL ARCHITECTURE, LLC DOES NOT PROVIDE ANY CONSTRUCTION SUPERVISION. BUILDER AND / OR OWNER IS RESPONSIBLE TO VERIFY THAT ALL STRUCTURE MATCHES THE PLANS AS DRAWN AND DESIGNED.

SCHILL ARCHITECTURE, LLC IS NOT RESPONSIBLE FOR STRUCTURAL OR NON STRUCTURAL ISSUES RELATED TO SOIL CONDITIONS, ANY DESIGN, PLAN FLIP, SITE STUDY, MECHANICAL OR TRUSS RELATED CHANGES AND/OR ISSUES BROUGHT TO SCHILL ARCHITECTURE, LLC AFTER THE PRINTING OF FINAL CONSTRUCTION SETS WILL BE CONSIDERED CHANGES TO THE DRAWINGS AND BILLED.

SCHILL ARCHITECTURE, LLC IS NOT A TRUSS DESIGNER. ENGINEERED ROOF TRUSSES ARE THE RESPONSIBILITY OF THE BUILDER AND/OR OWNER, LUMBER COMPANY AND TRUSS MANUFACTURER. TRUSS DESIGNED ROOF PLANS ARE TO BE REVIEWED BY THE TRUSS MANUFACTURER PRIOR TO PRINTING FINAL CONSTRUCTION SETS. DURING THIS REVIEW PROCESS IT WILL BE THE RESPONSIBILITY OF THE TRUSS MANUFACTURER TO VERIFY THAT ALL PLATE HEIGHTS, JOIST SPACING, ROOF PITCH, RISE AND RUN, TRUSS BRACING, ETC. MEET THE REQUIREMENTS OF THE TRUSS MANUFACTURER'S SPECIFICATIONS. IF NECESSARY, ADJUST THE BUILDER OR ADD ANY BEAM, POST OR HEADER THAT IS DIRECTLY EFFECTED OR REQUIRED TO CARRY THE ROOF LOADS. IN THIS EVENT THE TRUSS MANUFACTURER, BUILDER AND/OR OWNER SHALL CONTACT SCHILL ARCHITECTURE, LLC TO UPDATE THE PLAN SET.

IT IS THE RESPONSIBILITY OF THE BUILDER, SCHILL ARCHITECTURE, LLC FIELD VERIFY ALL AS BUILT DIMENSIONS OF FOUNDATION AND FLOOR FRAMES. IF ORDERED BY TRUSSESS, SCHILL ARCHITECTURE, LLC ASSUMES NO RESPONSIBILITY FOR TRUSSESS ORDERED SOLELY FROM THIS SET OF CONSTRUCTION DOCUMENTS.

SCHILL ARCHITECTURE, LLC ASSUMES NO RESPONSIBILITY FOR ANY CONSTRUCTION SCHEDULE CHANGES OR DELAYS DUE TO ANY ENGINEERED ROOF TRUSS ISSUES.

ALL TRUSSES ARE TO BE INSTALLED BY THE TRUSS MANUFACTURER WITH DETAILED DRAWINGS DESCRIBING TRUSS LAYOUTS AND LOAD CALCULATIONS USED TO DESIGN THE TRUSSES. IT IS THE BUILDER AND/OR OWNERS RESPONSIBILITY TO SUPPLY ANY/ALL OF THIS INFORMATION IF REQUESTED BY THE BUILDING DEPARTMENT TO ISSUE BUILDING PERMITS.

ALL ENGINEERED FLOOR SYSTEMS SHALL BE DESIGNED BY THE MANUFACTURER.

PROVIDE 2x4 COLLAR TIES # 4 @ 0' o.c. FOR ALL RAFTERS.

ALL HEADERS SHALL BE FREE FROM SPLITS, CHECKS, KINKS, SHAKE.

PROVIDE DOUBLE HEADER JOIST AND TRIMMER AT ALL FLOOR OPENINGS.

PROVIDE DOUBLE JOISTS UNDER ALL PARALLEL PARTITIONS.

PROVIDE 1"x3" X" BRIDGING # 8 @ 0' o.c. OR SOLID BLOCKING

ALL ANGLED WALLS ARE 45 DEGREES U.O.N.

ADJUST ALL OVERHANGS OF DIFFERENT PITCHES TO MAINTAIN CONSTANT LEVEL .

ANY HIP OR VALLEY RAFTER EXCEEDING 26° 0' 0" BE L.V.L.

DOUBLE ALL JOISTS AT CANTILEVERS.

ALL EXTERIOR CORNERS SHALL BE BRACED IN EACH DIRECTION WITH PLYWOOD, IF FOAM SHEATHING IS USED, PROVIDE DIAGONAL LET-IN BRACING.

REPAIR/REPLACE ALL FRAMING DAMAGED BY MECHANICAL SYSTEMS INSTALLATION.

ALL WINDOW HEADS SHALL BE AT 6" 10/12" A.F.S. UNLESS OTHERWISE NOTED.

ALL LUMBER IN CONTACT WITH MASONRY AND/OR CONCRETE SHALL BE PROTECTED FROM DECAY IN ACCORDANCE WITH O.R.C. 371.12

PROVIDE 2" x 4" CLEAR BRACING BETWEEN MASONRY FIREPLACES AND ALL WOOD FRAMING, PROVIDE FIRESTOPPING BETWEEN FLOOR LEVELS.

ALL SILL PLATES SHALL BE FULL WIDTH OF FOUNDATION WALL.

ALL CUTTING NOTCHING AND BORING SHALL BE IN CONFORMANCE WITH O.R.C. R-602.6.1 & R-602.6.1.

ALL JOISTS, BEAMS AND GIRDERS SHALL BEAR A MINIMUM OF 1/2" ON WOOD OR METAL AND 3" ON MASONRY.

MILLOCKR AND CABINET DESIGN SHALL BE THE RESPONSIBILITY OF OTHERS.

CONSTRUCTION OBSERVATION IS NOT PROVIDED BY THIS ARCHITECT.

WALLS AND PARTITIONS INCLUDING FURRED OR STUDDO OFF SPACES OF MASONRY OR CONCRETE WALLS, AND AT THE CEILING AND FLOOR OR ROOF LEVELS, FIRESTOPPING SHALL BE INSTALLED AT ALL INTERSECTIONS BETWEEN VERTICAL AND HORIZONTAL SPACES SUCH AS OCCURRING AT SORTIS OR CABSINETS, DROP CEILINGS, COVE CEILING ETC.

IT IS THE RESPONSIBILITY OF THE BUILDER AND/OR OWNER TO VERIFY THAT ALL LUMBER USED FOR THIS PROJECT MEETS OR EXCEEDS THE MINIMUM REQUIREMENTS OF STRENGTH AND MOISTURE CONTENT SET FORTH BY THE STATE AND LOCAL BUILDING CODES.

ALL FRAMING LUMBER SHALL BE DOUGLAS FIR LARCH # 2 WITH A MINIMUM MODULUS OF ELASTICITY OF 1,000,000

ANY MICROSLIP (LVL) NOTED ON THESE DRAWINGS MUST MEET THE FOLLOWING CRITERIA: 1) O.E.....1900psi

WALL STUDS SHALL BE A MINIMUM OF 2"x4" @ 16" o.c. AND SHALL BE ONE PIECE FULL HEIGHT AND A MINIMUM OF (2) STUDS AT EACH SIDE OF ALL OPENINGS THROUGH ALL WALLS UNLESS NOTED OTHERWISE.

REFER TO THE TYPICAL WALL SECTION FOR SUBFLOOR AND ROOF SHEATHING THICKNESSES AND MATERIAL TYPES. ALL LUMBER SHALL BE STAMPED

ALL WINDOW & DOOR HEADERS TO BE 2"x10's w/ 1/2" SHIM U.O.N.

ALL JACKS SHALL BE BLOCKED BELOW THE DECK.

DOUBLE ALL FLOOR JOISTS @ WHIRLPOOL/BATH LOCATIONS.

ALL PARTITIONS OVER 10' 0" HIGH SHALL BE FRAMED W/ 2"x4" @ 16" o.c.

PROVIDE 3-x4 structural COLUMN @ WOOD BEAM BEARING POINTS.

PROVIDE 3" STEEL COLUMN @ STEEL BEAM BEARING POINTS.

PROVIDE 2x6 TOP PLATE OF ALL STEEL BEAMS- STAGGER BOLT # 2" 0" o.c. w/ 3/8" BOLTS.

PROVIDE GALVANIZED JOIST HANGERS @ ALL FLUSH BEAMS INSTALL PER MANUFACTURERS SPECIFICATIONS.

PROVIDE 2x8 STIFFBACKS # 10' 0" o.c. FOR ALL CEILING JOISTS.

ELECTRICAL NOTES

ELECTRICAL CONTRACTOR (EC) SHALL CONFIRM THE CAPACITY & EXISTING SERVICE TO ADEQUATELY SUPPORT THE NEW LOADS. IF NECESSARY, UPGRADE SERVICE EC SHALL BOND TOGETHER ALL ELECTRODES TO FORM A GROUNDING SYSTEM.

CONDUITS TYPES SHOULD BE AS SHOWN IN NEC 90.6(B). ELECTRICAL GROUNDING CAN INCLUDE FOLLOWINGS: (1) METAL UNDERGROUND WATER LINE IN CONTACT WITH EARTH FOR A MIN. 10'-0". (2) CONCRETE ELECTRODES. (3) ROD, PIPE AND PLATE ELECTRODES IN ACCORDANCE WITH NEC 250.55.

GENERAL LIGHTING AND RECEPTACLE OUTLETS BRANCH CIRCUITS SHALL BE 15amp OVERLOAD PROTECTED CIRCUITS INSTALLED WITH 14ga COPPER CONDUCTORS. ALL GENERAL BRANCH CIRCUITS TO BEDROOMS SHALL BE PROTECTED WITH ARC-FULT CIRCUIT INTERRUPTER DEVICE NEC 20.12.

KITCHEN SHALL HAVE A DEDICATED BRANCH CIRCUIT OF AMPERAGE IN ACCORDANCE WITH APPLIANCE REQ'D SERVICE.

OVEN, COOK TOPS, RANGES AND CLOTHES DRYER SHALL HAVE A 240V OUTLET WITH AMPERAGE AS REQ'D FOR APPLIANCE.

GENERAL RECEPTABLES BE SPACED NO MORE THAN 12'-0" APART OR 6'-0" FROM AN INSIDE CORNER SEE NEC 20.51. A RECEPTACLE MUST BE INSTALLED ON EACH WALL SPACE GREATER THAN 12'-0" SEE NEC 20.52.

REFRIGERATORS, MICROWAVE OVENS, DISHWASHERS AND ANY OTHER MAJOR APPLIANCES SHALL HAVE A DEDICATED BRANCH CIRCUIT OF AMPERAGE IN ACCORDANCE WITH APPLIANCE REQ'D SERVICE.

CIRCUITS WITHIN 6ft. OF A SINK OR WATER SOURCES SHALL BE PROTECTED BY A GROUND-FAULT CIRCUIT INTERRUPTER (GFCI) NEC 20.18.

ALL EXTERIOR OUTLETS, GARAGE OUTLETS, AND ANY OUTLET IN A UTET OR EXTERIOR LOCATION SHALL BE PROTECTED BY A GFCI BRANCH CIRCUIT SEE NEC 20.18.

	MASONRY NOTES ALL FOOTINGS TO BE 6" WIDER THAN THE WALL, THEY SUPPORT AND BEAR ON UNDISTURBED SOIL OF BEARING CAPACITY. THE TOP ALL FOOTINGS SHALL BE A MINIMUM OF 38" BELOW FINISHED GRADE. PROVIDE C.M.U. "LOOKOUTS" 4' x 4' O.C. WHERE SHELVES ARE NOT PROVIDED. PROVIDE (2"x7") ANCHOR BOLTS PER FLUTE NO MORE THAN 12" FROM EACH END - BRUIT SOLID PROVIDE SOLID MASONRY AT ALL BEAM BEARING LOCATIONS. SOLID MASONRY TO EXTEND DOWN TO FOOTING. PROVIDE 1/2" CEMENTAR 1/8" RIGID DAMPPROOFING ON ALL FOUNDATION WALLS. PROVIDE GALVANIZED CORRUGATED METAL TIES 1/8" O.C. HORIZONTALLY & VERTICALLY FOR ALL MASONRY VENEERS. PROVIDE 8" SOLDER 1/4" ROD/LOCK AT ALL WINDOW AND DOOR OPENINGS. PROJECTED 1/2" U.O.N. IF NO OTHER DESIGN IS INDICATED PROVIDE REEF HOLES 4" x 32" O.C. ON FIRST COURSE EXPOSED ABOVE GRADE PROVIDE 30# FELT OVER ALL SHEATHING TO RECEIVE BRICK VENEER. LAP ALL JOINTS A MINIMUM OF 6". FLASHING SHALL BE INSTALLED PER SECTION 103.8 OF THE O.R.C. PROVIDE EXTERIOR COMBUSTION AIR FOR ALL FIREPLACES. (MINIMUM 6" SQUARE INCHES). FIREPLACE HEARTING SHALL BE SIZED AS FOLLOWS: FIREBOX OPENING LESS THAN 6' 60.1FT. 1/6" WIDE FROM FACE OF FIREBOX. FIREBOX OPENING GREATER THAN 6' 60.1FT. 20" WIDE FROM FACE OF FIREBOX. FOUNDATIONS SHALL NOT BE BACKFILLED UNLESS PROPERLY BRACED. PROVIDE HORIZONTAL JAIL REINFORCING 1/8" O.C. VERTICALLY. PROVIDE ONE (1) 1/8" BAR VERTICALLY (FILL HEIGHT) 4' x 32" O.C. IN GROUTED CORE U.O.N. SLOPE ALL SILLS AWAY FROM THE STRUCTURE FOUNDATIONS AND/OR ON THESE DRAWINGS ARE PROVIDED FOR AN ALLOWABLE SOIL BEARING PRESSURE OF 2000 psf. WALLS ARE DESIGNED FOR AN EQUIVALENT FLUID PRESSURE OF 35 psf. IT IS THE RESPONSIBILITY OF THE BUILDER AND/OR OWNER TO DETERMINE THAT THE SOIL IS ADEQUATE TO SUPPORT THIS BUILDING ON THE FOUNDATION AND THE WALLS SHOWN, AND ALSO, DETERMINING THAT THE TOTAL AND DIFFERENTIAL SETTLEMENTS OF THE FOUNDATIONS ARE WITH IN THE TOLERABLE LIMITS OF THIS STRUCTURE AND THAT 35 psf IS THE CORRECT WALL LOADING. THE BUILDER AND/OR OWNER IS ENCOURAGED TO OBTAIN THE SERVICES OF A SOILS ENGINEERING FIRM TO DETERMINE THE SUITABILITY OF THE FOUNDATIONS AND THE WALLS SHOWN ON THESE DRAWINGS TO SAFELY SUPPORT THE STRUCTURE WITH NO DETRIMENTAL EFFECT TO THE BUILDING FILTER FABRIC SHALL BE INSTALLED OVER ALL FOUNDATION DRAIN TILE.
	CONCRETE NOTES ALL FOOTING CONCRETE SHALL BE 3000 P.S.I. (28 DAY COMPRESSIVE STRENGTH). ALL SLABS ON GRADE SHALL BE 4000 P.S.I. (28 DAY COMPRESSIVE STRENGTH) PROVIDE CONTROL JOINT @ MIDPOINT OF GARAGE IN BOTH DIRECTIONS. PROVIDE 5/8" OR HAND TROVELED CONTROL JOINTS 8' O' C.C. EACH WAY IN DRIVEWAYS. PROVIDE JEEP HOLES 4' x 32" O.C. ON FIRST COURSE EXPOSED ABOVE GRADE PROVIDE 6 MIL VAPOR BARRIER UNDER ALL INTERIOR AND GARAGE SLABS. PROVIDE EXPANSION JOINTS AS REQUIRED BY CODE. USE AN APPROVED CURING COMPOUND ON ALL FLAT SURFACES. THE USE OF ADMIXTURES IS PROHIBITED UNLESS APPROVED BY THE ARCHITECT.
	INSULATION NOTES NOTE: PROVIDE OPTION FOR CLOSED CELL FOAM INSULATION ALL INSULATION SHALL BE INSTALLED FIRM AND THICK IN THE CAVITY PER MANUFACTURER'S SPECIFICATIONS WALLS: 5-1/2" BATT (R-38 MIN.) FLAT CEILINGS: 1/4" BATT (R-43 MIN.) VAULTED CEILINGS: 8-1/2" BATT (R-30 MIN.) BOX ENDS: 10-1/4" (R-38 MIN.) SLAB EDGES: 2-1/4" RIGID EXTRUDED POLYSTYRENE (R-10 MIN.) PROVIDE VENTILATION BAFFLES @ ALL RAFTER SPACES CAULK ALL OPENINGS IN EXTERIOR WALLS. FOAM ALL OPENINGS IN TOP FLATES PROVIDE 2-1/4" THERMAFLEX STYROFOAM INSULATION ON ALL EXTERIOR FOUNDATION WALLS. RULL DEPTH (R-10 MIN.) ALL PENETRATIONS SHALL BE SEALED WITH BUTYL TAPE PROVIDE HOUSE WRAP OR FLUID APPLIED BARRIER PER LOCAL CODE PROVIDE BEAMS AT ANYUTATER MIGRATION FONTS IN THE CONSTRUCTION. INSULATION SHALL BE INSTALLED AND ALSO COMPLY WITH ALL MINIMUM ORDINANCES SET FORTH BY THE LOCAL GOVERNING BUILDING AND ZONING DEPARTMENTS. REFER TO THE TYPICAL WALL SECTION FOR R VALUES AND LOCATIONS.
	STEEL NOTES ALL STRUCTURAL STEEL FOR BEAMS AND PLATES SHALL COMPLY WITH A.S.T.M. SPECIFICATION A-36. ALL STRUCTURAL STEEL FOR COLUMNS SHALL COMPLY WITH A.S.T.M. SPECIFICATION A-589 GRADE B OR A-501. ALL REINFORCING STEEL FOR CONCRETE SHALL COMPLY WITH A.S.T.M. SPECIFICATION A-615 GRADE 60.
	GYPSUM NOTES PROVIDE 5/8" REGULAR GYPSUM BOARD THROUGHOUT ENTIRE STRUCTURE EXCEPT AS NOTED. PROVIDE 5/8" TYPE "X" FIRE CODE GYPSUM BOARD THROUGHOUT GARAGE AND WALLS COMMON TO HOUSE N GARAGE ATTIC. PROVIDE 5/8" G.B. ON ALL ATTIC ACCESS PANELS. PROVIDE WATER RESISTANT GYPSUM BOARD IN ALL BATH & TOILET AREAS. PROVIDE DUROCK OR EQUAL ON ALL TILED AREAS OF TUB DECKS AND SHOWER STALLS. ALL CEILINGS AND WALLS SHALL HAVE A SMOOTH FINISH. (LEVEL 5)
	FIREPLACE NOTES ALL CHIMNEYS AND FIREPLACES SHALL BE IN COMPLIANCE WITH THE REQUIREMENTS OF CHAPTER 10 AND INSTALLED PER THE ORDINANCES SET FORTH BY THE LOCAL GOVERNING BUILDING AND ZONING DEPARTMENTS. IT IS THE RESPONSIBILITY OF THE BUILDER AND/OR OWNER TO VERIFY THE ROUGH OPENING DIMENSIONS FOR ALL PREFAB FIREPLACES WITH THE ACTUAL UNIT TO BE INSTALLED. PRIOR TO FRAMING

ALL FOOTING CONCRETE SHALL BE 3000 P.S.I. (28 DAY COMPRESSIVE STRENGTH).
ALL SLABS ON GRADE SHALL BE 4000 P.S.I. (28 DAY COMPRESSIVE STRENGTH).
PROVIDE CONTROL JOINTS AT MIDPOINT OF GARAGE IN BOTH DIRECTIONS.
PROVIDE SAW OR HAND TROUELED CONTROL JOINTS @ 0' 0" E.C. EACH WAY IN DRIVEWAYS.
PROVIDE CONTROL JOINTS IN ALL WALLS EQUAL TO THE THICK OF THE WALL.
PROVIDE A VAPOR BARRIER UNDER ALL INTERIOR AND GARAGE SLABS.
PROVIDE EXPANSION JOINTS AS REQUIRED BY CODES.
USE AN APPROVED CURING COMPOUND ON ALL FLAT SURFACES.
THE USE OF ADMIXTURES IS PROHIBITED UNLESS APPROVED BY THE ARCHITECT.

NOTE: PROVIDE OPTION FOR CLOSED CELL FOAM INSULATION
ALL INSULATION SHALL BE INSTALLED FULL AND THICK IN THE CAVITY PER MANUFACTURER'S SPECIFICATIONS
WALLS 2-1/2" BATTIS (R-9 MIN.)
FLAT CEILINGS: 14" BATTIS (R-49 MIN.)
VAULTED CEILINGS: 8-1/2" BATTIS (R-30 MIN.)
BOX ENDS: 10-1/4" (R-38 MIN.)
SLAB EDGES: 2-1/4" RIGID EXTRUDED POLYSTYRENE (R-10 MIN.)
PROVIDE VENTILATION BAFFLES @ ALL RAFTER SPACES
CAULK ALL OPENINGS IN EXTERIOR WALLS, FOAM ALL OPENINGS IN TOP PLATES
PROVIDE 2-1/4" THERMAFLEX STRUCTURAL INSULATION ON ALL EXTERIOR FOUNDATION WALLS, FULL DEPTH (R-10 MIN.)
ALL PENETRATIONS SHALL BE SEALED WITH BUTYL TAPES
PROVIDE HOUSE WRAP OR FLUID APPLIED BARRIER PER LOCAL CODE
PROVIDE SEALANTS AT ANY WATER MIGRATION POINTS IN THE CONSTRUCTION.
NBSP SHALL BE INSTALLED AND ALSO COMPLY WITH ALL MINIMUM ORDINANCES SET FORTH BY THE LOCAL GOVERNING
BUILDING AND ZONING DEPARTMENTS. REFER TO THE TYPICAL WALL SECTION FOR R VALUES AND LOCATIONS.

ALL STRUCTURAL STEEL FOR BEAMS AND PLATES SHALL COMPLY WITH A.S.T.M. SPECIFICATION A-36; ALL STRUCTURAL STEEL FOR COUPLERS SHALL COMPLY WITH A.S.T.M. SPECIFICATION A-53 GRADE B OR A-501; ALL REINFORCING STEEL FOR CONCRETE SHALL COMPLY WITH A.S.T.M. SPECIFICATION A-615 GRADE 60.

GYPSUM NOTES

PROVIDE 5/8" REGULAR GYPSUM BOARD THROUGHOUT ENTIRE STRUCTURE EXCEPT AS NOTED.
 PROVIDE 5/8" TYPE "X" FIRE CODE GYPSUM BOARD THROUGHOUT GARAGE AND WALLS COMMON TO HOUSE
 & GARAGE ATTIC. PROVIDE 5/8" G.B. ON ALL ATTIC ACCESS PANELS.
 PROVIDE WATER RESISTANT GYPSUM BOARD IN ALL BATH & TOILET AREAS.
 PROVIDE DUROCK OR EQUAL ON ALL TILED AREAS OF TUB DECKS AND SHOWER STALLS.
 ALL CEILINGS AND WALLS SHALL HAVE A SMOOTH FINISH. (LEVEL 5)


ALL CHIMNEYS AND FIREPLACES SHALL BE IN COMPLIANCE WITH THE REQUIREMENTS OF CHAPTER 10 AND INSTALLED PER THE ORDINANCES SET FORTH THE BY THE LOCAL GOVERNING BUILDING AND ZONING DEPARTMENTS. IT IS THE RESPONSIBILITY OF THE BUILDER AND/OR OWNER TO VERIFY THE ROUGH OPENING DIMENSIONS FOR ALL PREFAB FIREPLACES WITH THE ACTUAL UNIT TO BE INSTALLED, PRIOR TO FRAMING

[illegible]

ELECTRICAL SYMBOL LEGEND	
SYMBOL	DESCRIPTION
	SWITCH- SINGLE POLE
	SWITCH- THREE WAY
	SWITCH- FOUR WAY
	SWITCH- DIMMER
	DUPLEX RECEPTACLE
	DUPLEX RECEPTACLE - FLOOR MOUNTED
	DUPLEX RECEPTACLE- GFCI
	QUAD RECEPTACLE
	DUPLEX RECEPTACLE- WEATHERPROOF
	DUPLEX RECEPTACLE- 220 VOLT
	KEYHOLE FIXTURE IN ATTIC SPACE
	CARBON MONOXIDE DETECTOR
	CABLE OUTLET
	DATA OUTLET
	CEILING MOUNTED FIXTURE
	CEILING FAN
	DISCONNECT
	6" RECESSED LIGHT
	4" RECESSED LIGHT
	EXHAUST FAN
	EXHAUST FAN /LIGHT COMBO
	SERVICE METER
	SERVICE PANEL
	PENDANT MOUNTED FIXTURE
	SMOKE DETECTOR- HARD WIRED
	TELEPHONE OUTLET
	WALL MOUNTED FIXTURE
	MOTOR
	THERMOSTAT

NOTES: ELECTRICAL LAYOUT SHOWN IS SCHEMATIC. A WALK THROUGH SHALL BE SCHEDULED WITH THE OWNER AND ARCHITECT.

SYMBOL LEGEND	
SECTION NUMBER SHEET NUMBER	ROOM NAME OFFICE 100 ROOM NUMBER
DETAIL NUMBER SHEET NUMBER	DOOR NUMBER
PLAN NUMBER SHEET NUMBER	WINDOW TAG
ROOM NUMBER SHEET NUMBER ELEVATION VIEW	REVISION NUMBER
COLUMN CENTERLINE AND DESIGNATION	REVISION AREA
PLAN NORTH SYMBOL	CODED NOTE SYMBOL
PARTITION TYPE	CEILING HEIGHT CEILING MATERIAL

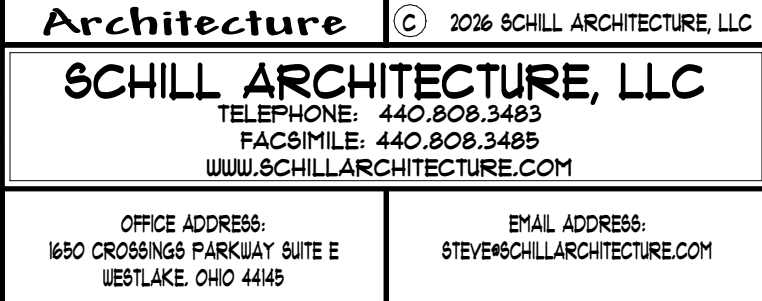

DESIGN LOADS			
COMPONENT	LIVE LOAD	DEAD LOAD	TOTAL LOAD
ATTIC (WALK UP STORAGE)	30 P.S.F.	15 P.S.F.	45 P.S.F.
ATTIC (LIMITED STORAGE)	20 P.S.F.	15 P.S.F.	35 P.S.F.
ATTIC (NO STORAGE)	10 P.S.F.	15 P.S.F.	25 P.S.F.
DECKS	40 P.S.F.	15 P.S.F.	55 P.S.F.
EXTERIOR BALCONIES	60 P.S.F.	15 P.S.F.	75 P.S.F.
GUARDRAIL AND HANDRAILS	200 P.S.F.	15 P.S.F.	215 P.S.F.
GUARDRAIL INFILL COMPONENTS	50 P.S.F.	15 P.S.F.	65 P.S.F.
PASSENGER VEHICLE GARAGES	50 P.S.F.	15 P.S.F.	65 P.S.F.
ROOMS (OTHER THAN SLEEPING ROOMS)	40 P.S.F.	15 P.S.F.	55 P.S.F.
SLEEPING ROOMS	30 P.S.F.	15 P.S.F.	45 P.S.F.
STAIRS	40 P.S.F.	15 P.S.F.	55 P.S.F.
ROOFS	25 P.S.F.	15 P.S.F.	40 P.S.F.
SNOW	25 P.S.F.	N.A.	25 P.S.F.
WIND	15 M.P.H.	N.A.	15 M.P.H.
SOIL BEARING	12000 P.S.F.	N.A.	2000 P.S.F.

MATERIAL SUMMARY		
SPACE	MATERIAL	HEIGHT
MAIN FLOOR	WOOD-2"x4"/2"x4"	N.A.
UPPER FLOOR	WOOD-2"x4"/2"x4"	N.A.
THIRD FLOOR	WOOD-2"x4"/2"x4"	8' 0"

AREA	SIZE
UNFINISHED LOWER LEVEL	0,000 SQ.FT.
FINISHED LOWER LEVEL	0,000 SQ.FT.
MAIN LEVEL	0,000 SQ.FT.
UPPER LEVEL	0,000 SQ.FT.
UPPER LEVEL(VOLUME SPACE)	0,000 SQ.FT.
THIRD FLOOR	646 SQ.FT.
TOTAL HEATED AREA	646 SQ.FT.
GARAGE	0,000 SQ.FT.
ARRIVAL PORCH	0,000 SQ.FT.
FRIENDS/ FAMILY PORCH	0,000 SQ.FT.
MAIN LEVEL COVERED REAR PORCH	0,000 SQ.FT.
LOWER LEVEL COVERED REAR PORCH	0,000 SQ.FT.
TOTAL AREA UNDER ROOF	646 SQ.FT.
REAR PORCH (NOT COVERED)	0,000 SQ.FT.
TOTAL PROJECT AREA	646 SQ.FT.

AREA CALCULATIONS ARE MADE FROM THE OUTSIDE FACE OF EXTERIOR WALLS, STAIRWELLS AND FIREPLACE AREAS ARE INCLUDED ONCE GROUND OPEN AREAS, DECKS, PATIOS AND EXTERIOR PORCHES ARE NOT INCLUDED IN THESE FIGURES. THEY ARE SUMMARIZED AS ADDITIONAL AREAS IN THIS TABLE


REV. NO.	DESCRIPTION	DATE

TITLE SHEET

	DATE: 1 JULY 2026
---	----------------------

REGISTERED ARCHITECT 8877 T-1

STEPHEN M. SCHILL, LICENSE # 8871 EXPIRATION DATE: 12/31/2021	DRAWING NUMBER
--	----------------

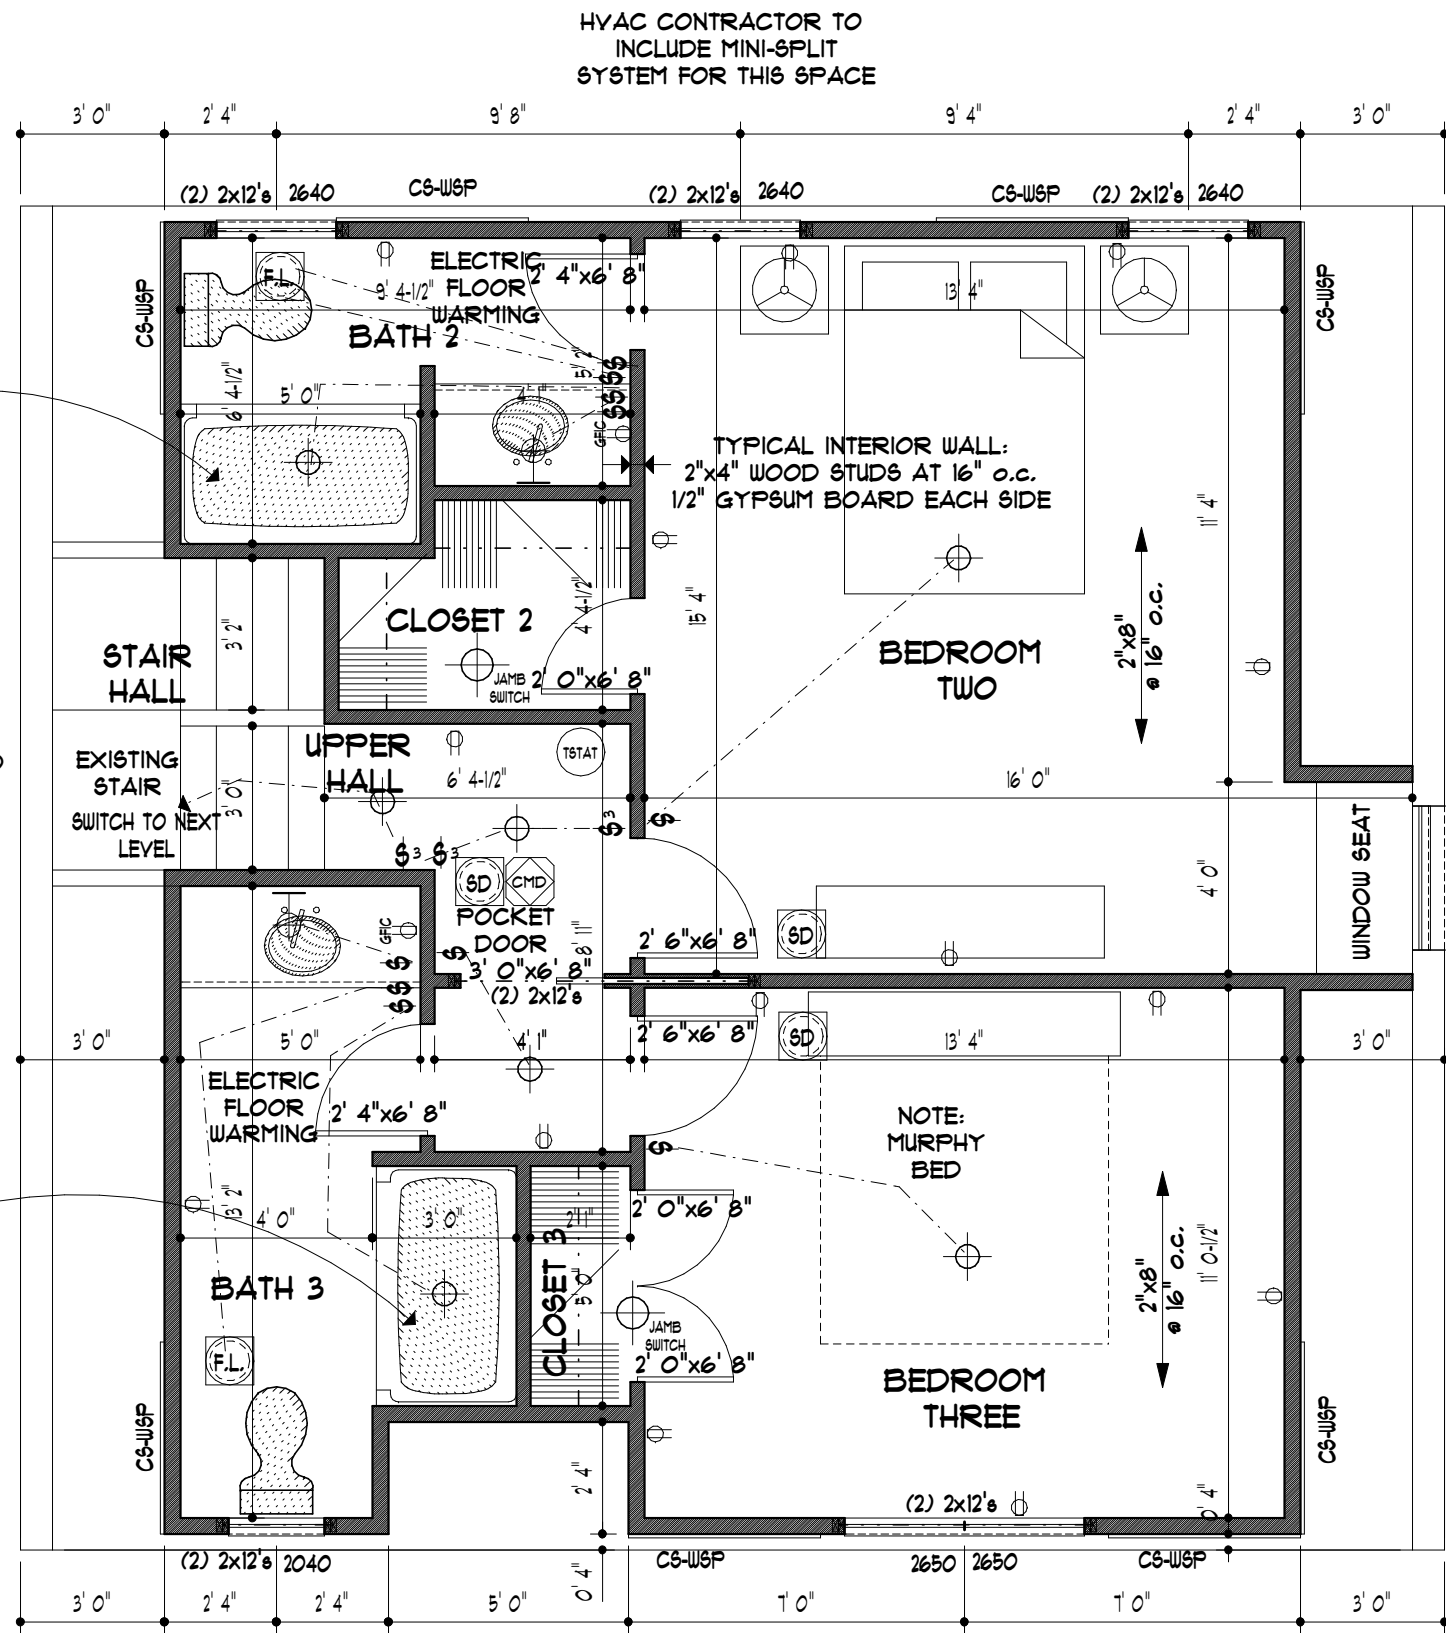

THIRD FLOOR PLAN

SCALE: 1/4" = 1' 0"

TEMPERED GLASS REQUIRED IN BY R.C.O. R308.4 "HAZARDOUS LOCATIONS"

THE FOLLOWING SHALL BE CONSIDERED SPECIFIC HAZARDOUS LOCATIONS REQUIRING SAFETY GLAZING MATERIALS:

- GLAZING IN SLIDING DOORS EXCEPT JALOUSIES.
- GLAZING IN FIXED AND SLIDING PANELS OF SLIDING DOOR ASSEMBLIES AND PANELS IN SLIDING AND BIFOLD CLOSET DOOR ASSEMBLIES.
- GLAZING IN STORM DOORS.
- GLAZING IN SECTION R308.4, ITEM 6 IN WALLS PERPENDICULAR TO THE PLANE OF THE DOOR IN A CLOSED POSITION OR WHERE ACCESS THROUGH THE DOOR IS TO A CLOSET, STORAGE AREA OR BATHROOM GLAZING IN THESE APPLICATIONS SHALL COMPLY WITH SECTION R308.4, ITEM 1.
- GLAZING IN DOORS AND ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, AND SHOWERS. GLAZING IN ANY PORTION OF A BUILDING WALL ENCLOSING THESE COMPARTMENTS WHERE THE BOTTOM EDGE OF AN EXPOSED PANEL IS LESS THAN 60 INCHES ABOVE THE DRAIN INLET AND 36 INCHES HORIZONTALLY FROM THE INSIDE EDGE OF THE TUB OR COMPARTMENT.
- GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST EXPOSED EDGE OF THE GLAZING IS WITHIN A 24 INCH ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE.
- GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL, OTHER THAN THOSE LOCATIONS DESCRIBED IN PRECEDING ITEMS NO.5 AND NO.6, WHICH MEETS ALL OF THE FOLLOWING CONDITIONS:
 - EXPOSED AREA OF AN INDIVIDUAL PANEL GREATER THAN 9 SQUARE FEET.
 - EXPOSED BOTTOM EDGE LESS THAN 18 INCHES ABOVE THE FLOOR.
 - EXPOSED TOP EDGE GREATER THAN 36 INCHES ABOVE THE FLOOR; AND
 - ONE OR MORE WALKING SURFACES WITHIN 36 INCHES HORIZONTALLY OF THE PLANE OF GLAZING.
- GLAZING IN RAILINGS REGARDLESS OF AREA OR HEIGHT ABOVE A WALKING SURFACE INCLUDED ARE STRUCTURAL BALUSTER PANELS AND NON STRUCTURAL INFILL PANELS.
- GLAZING IN WALLS AND FENCES ENCLOSING INDOOR AND OUTDOOR SWIMMING POOLS, HOT TUBS, AND SPAS WHERE THE BOTTOM EDGE OF THE GLAZING ON THE POOL OR SPA SIDE IS LESS THAN 60 INCHES ABOVE A WALKING SURFACE AND WITHIN 60 INCHES HORIZONTALLY OF THE WATERS EDGE OF A SWIMMING POOL, OR SPA. THIS SHALL APPLY TO SINGLE GLAZING AND ALL PANELS IN MULTIPLE GLAZING.
- GLAZING ADJACENT TO STAIRWAYS, LANDINGS AND RAMPS WITHIN 36 INCHES HORIZONTALLY OF A WALKING SURFACE WHEN THE EXPOSED SURFACE OF THE GLASS IS LESS THAN 60 INCHES ABOVE THE PLANE OF THE ADJACENT WALKING SURFACE.
- GLAZING ADJACENT TO STAIRWAYS WITHIN 60 INCHES HORIZONTALLY OF THE BOTTOM TREAD OF A STAIRWAY IN ANY DIRECTION WHEN THE EXPOSED SURFACE OF THE GLASS IS LESS THAN 60 INCHES ABOVE THE NOSE OF THE TREAD.

PORCHES, BALCONIES OR RAISED FLOOR SURFACES LOCATED MORE THAN 30 INCHES ABOVE THE FLOOR OR GRADE BELOW SHALL HAVE GUARDS NOT LESS THAN 36 INCHES IN HEIGHT. OPEN SIDES OF STAIRS WITH A TOTAL RISE OF MORE THAN 30 INCHES ABOVE THE FLOOR OR GRADE BELOW SHALL HAVE GUARDS NOT LESS THAN 34 INCHES IN HEIGHT MEASURED VERTICALLY FROM THE NOSE OF THE TREADS. REQUIRED GUARDS ON OPEN SIDES OF STAIRWAYS, RAISED FLOOR AREA, BALCONIES AND PORCHES SHALL HAVE INTERMEDIATE RAILS OR ORNAMENTAL CLOSURES WHICH DO NOT ALLOW PASSAGE OF A SPHERE 4 INCHES OR MORE IN DIAMETER.

Buildings with combustible ceiling or roof construction shall have an attic access opening to attic areas that have a vertical height of 30" or greater over an area of not less than 30 sq.ft.

BUILD TEMPORARY WALLS AS REQUIRED TO SUPPORT EXISTING CONSTRUCTION DURING REMODELING

NOTE: WALLS SHOWN SHADED ARE NEW CONSTRUCTION

COORDINATE CLOSET LAYOUT & DESIGN WITH ARCHITECT

COORDINATE CABINET LAYOUT & DESIGN WITH ARCHITECT

CONTRACTOR TO FIELD VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION AND NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICTS

FIRESTOPPING SHALL BE INSTALLED IN ALL CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED OR STUDDED OFF SPACES OF MASONRY OR CONCRETE WALLS, AND AT THE CEILING AND FLOOR OR ROOF LEVELS. FIRESTOPPING SHALL BE INSTALLED AT ALL INTERCONNECTIONS BETWEEN VERTICAL AND HORIZONTAL SPACES SUCH AS OCCURRING AT SOFFITS OVER CABINETS, DROP CEILINGS, COVE CEILING, ETC.

Connections between horizontal and vertical spaces. Fireblocking shall be provided at interconnections between concealed vertical stud wall or partition spaces and concealed horizontal spaces created by an assembly of floor joists or trusses, and between concealed vertical and horizontal spaces such as occur at soffits, drop ceilings, cove ceilings and similar locations.

EVERY SLEEPING ROOM SHALL HAVE AT LEAST ONE OPENABLE EMERGENCY ESCAPE WINDOW WITH A SILL HEIGHT OF NO MORE THAN 44 INCHES ABOVE THE FLOOR. THE MINIMUM OPENING HEIGHT SHALL BE 24 INCHES, THE MINIMUM OPENING WIDTH SHALL BE 20 INCHES, AND THE MINIMUM OPENING AREA SHALL BE 5.7 SQUARE FEET. (5.0 SQ. FT. ON THE GRADE FLOOR)

Section 210.12 requires that for dwelling units, all 120-volt, single-phase, 15- and 20-ampere branch circuits supplying outlets or devices installed in dwelling unit kitchens, family rooms, dining rooms, living rooms, porches, libraries, dens, bedrooms, sunrooms, recreation rooms, closets, hallways, laundry areas, or similar rooms or areas shall be protected by AFCIs.

REFER TO INTERIOR DESIGNER DRAWINGS FOR ELECTRICAL LAYOUT. THESE DRAWINGS SHOW THE CODE MINIMUM ELECTRICAL TO OBTAIN A BUILDING PERMIT. A WALK THROUGH SHALL BE SCHEDULED WITH THE OWNER, INTERIOR DESIGNER AND ARCHITECT.

HVAC LAYOUT IS SCHEMATIC ONLY. DESIGN BY MECHANICAL CONTRACTOR.

CS-WSP: CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL

303.1 Habitable rooms. All habitable rooms shall have an aggregate glazing area of not less than 8 percent of the floor area of such rooms. Natural ventilation shall be through windows, doors, louvers or other approved openings to the outdoor air. Such openings shall be provided with ready access or shall otherwise be readily controllable by the building occupants.

The minimum operable area to the outdoors shall be 4 percent of the floor area being ventilated.

Exceptions:

- The glazed area need not be operable where the opening is not required by Section 303 and an approved mechanical ventilation system capable of producing 0.35 air change per hour in the room is installed or a whole-house mechanical ventilation system is installed capable of supplying outdoor ventilation air of 15 cubic feet per minute (cfm) (15 L/s) per occupant computed on the basis of two occupants for the first bedroom and one occupant for each additional bedroom.

- The glazed area need not be installed in rooms where Exception 1 above is satisfied and artificial light is provided capable of producing an average illumination of 6 footcandles (65 lux) over the area of the room at a height of 30 inches (762 mm) above the floor level.

- Use of sunroom additions and patio covers, as defined in Section 303, shall be permitted for natural ventilation if in excess of 40 percent of the exterior sunroom walls are open, or are enclosed only by insect screening.

303.2 Adjoining rooms. For the purpose of determining light and ventilation requirements, any room shall be considered as a portion of an adjoining room when at least one-half of the area of the common wall is open and unobstructed and provides an opening of not less than one-tenth of the floor area of the interior room but not less than 25 square feet (2.3 m²).

Exception: Openings required for light and/or ventilation shall be permitted to open into a thermally isolated sunroom addition or patio cover, provided that there is an operable area between the adjoining room and the sunroom addition or patio cover of not less than one-tenth of the floor area of the interior room but not less than 20 square feet (2 m²).

303.3 Bathrooms. Bathrooms, water closet compartments and other similar rooms shall be provided with aggregate glazing area in windows of not less than 3 square feet (0.3 m²).

one-half of which must be operable.

Exception: The glazed area shall not be required where artificial light and a mechanical ventilation system are provided. The minimum ventilation rates shall be 40 L/s-0.1 40

shall be 50 cubic feet per minute (14 L/s) for intermittent ventilation or 20 cubic feet per minute (10 L/s) for continuous ventilation. Ventilation air from the space shall be exhausted directly to the outside.

303.4 Opening location. Outdoor intake and exhaust openings shall be located in accordance with Sections 303.4.1 and 303.4.2.


303.4.1 Intake openings. Mechanical and gravity outdoor air intake openings shall be located a minimum of 10 feet (3048 mm) from any hazardous or noxious contaminant, such as vents, chimneys, plumbing vents, streets, alleys, parking lots and loading docks, except as otherwise specified in this code.

Where a source of contaminant is located within 10 feet (3048 mm) of an intake opening, such opening shall be located a minimum of 2 feet (610 mm) below the contaminant source.

For the purpose of this section, the exhaust from dwelling unit toilet room, bathrooms and kitchens shall not be considered as hazardous or noxious.


303.4.2 Exhaust openings. Exhaust air shall not be directed onto walkways.

303.5 Outside opening protection. Air exhaust and intake openings that terminate outdoors shall be protected with corrosion-resistant screens, louvers or grilles having a minimum opening size of 1/8 inch (3 mm) and a maximum opening size of 1/2 inch (13 mm) in any dimension. Openings shall be protected against local weather conditions. Outdoor air exhaust and intake openings shall meet the provisions for exterior wall opening protectives in accordance with this code.

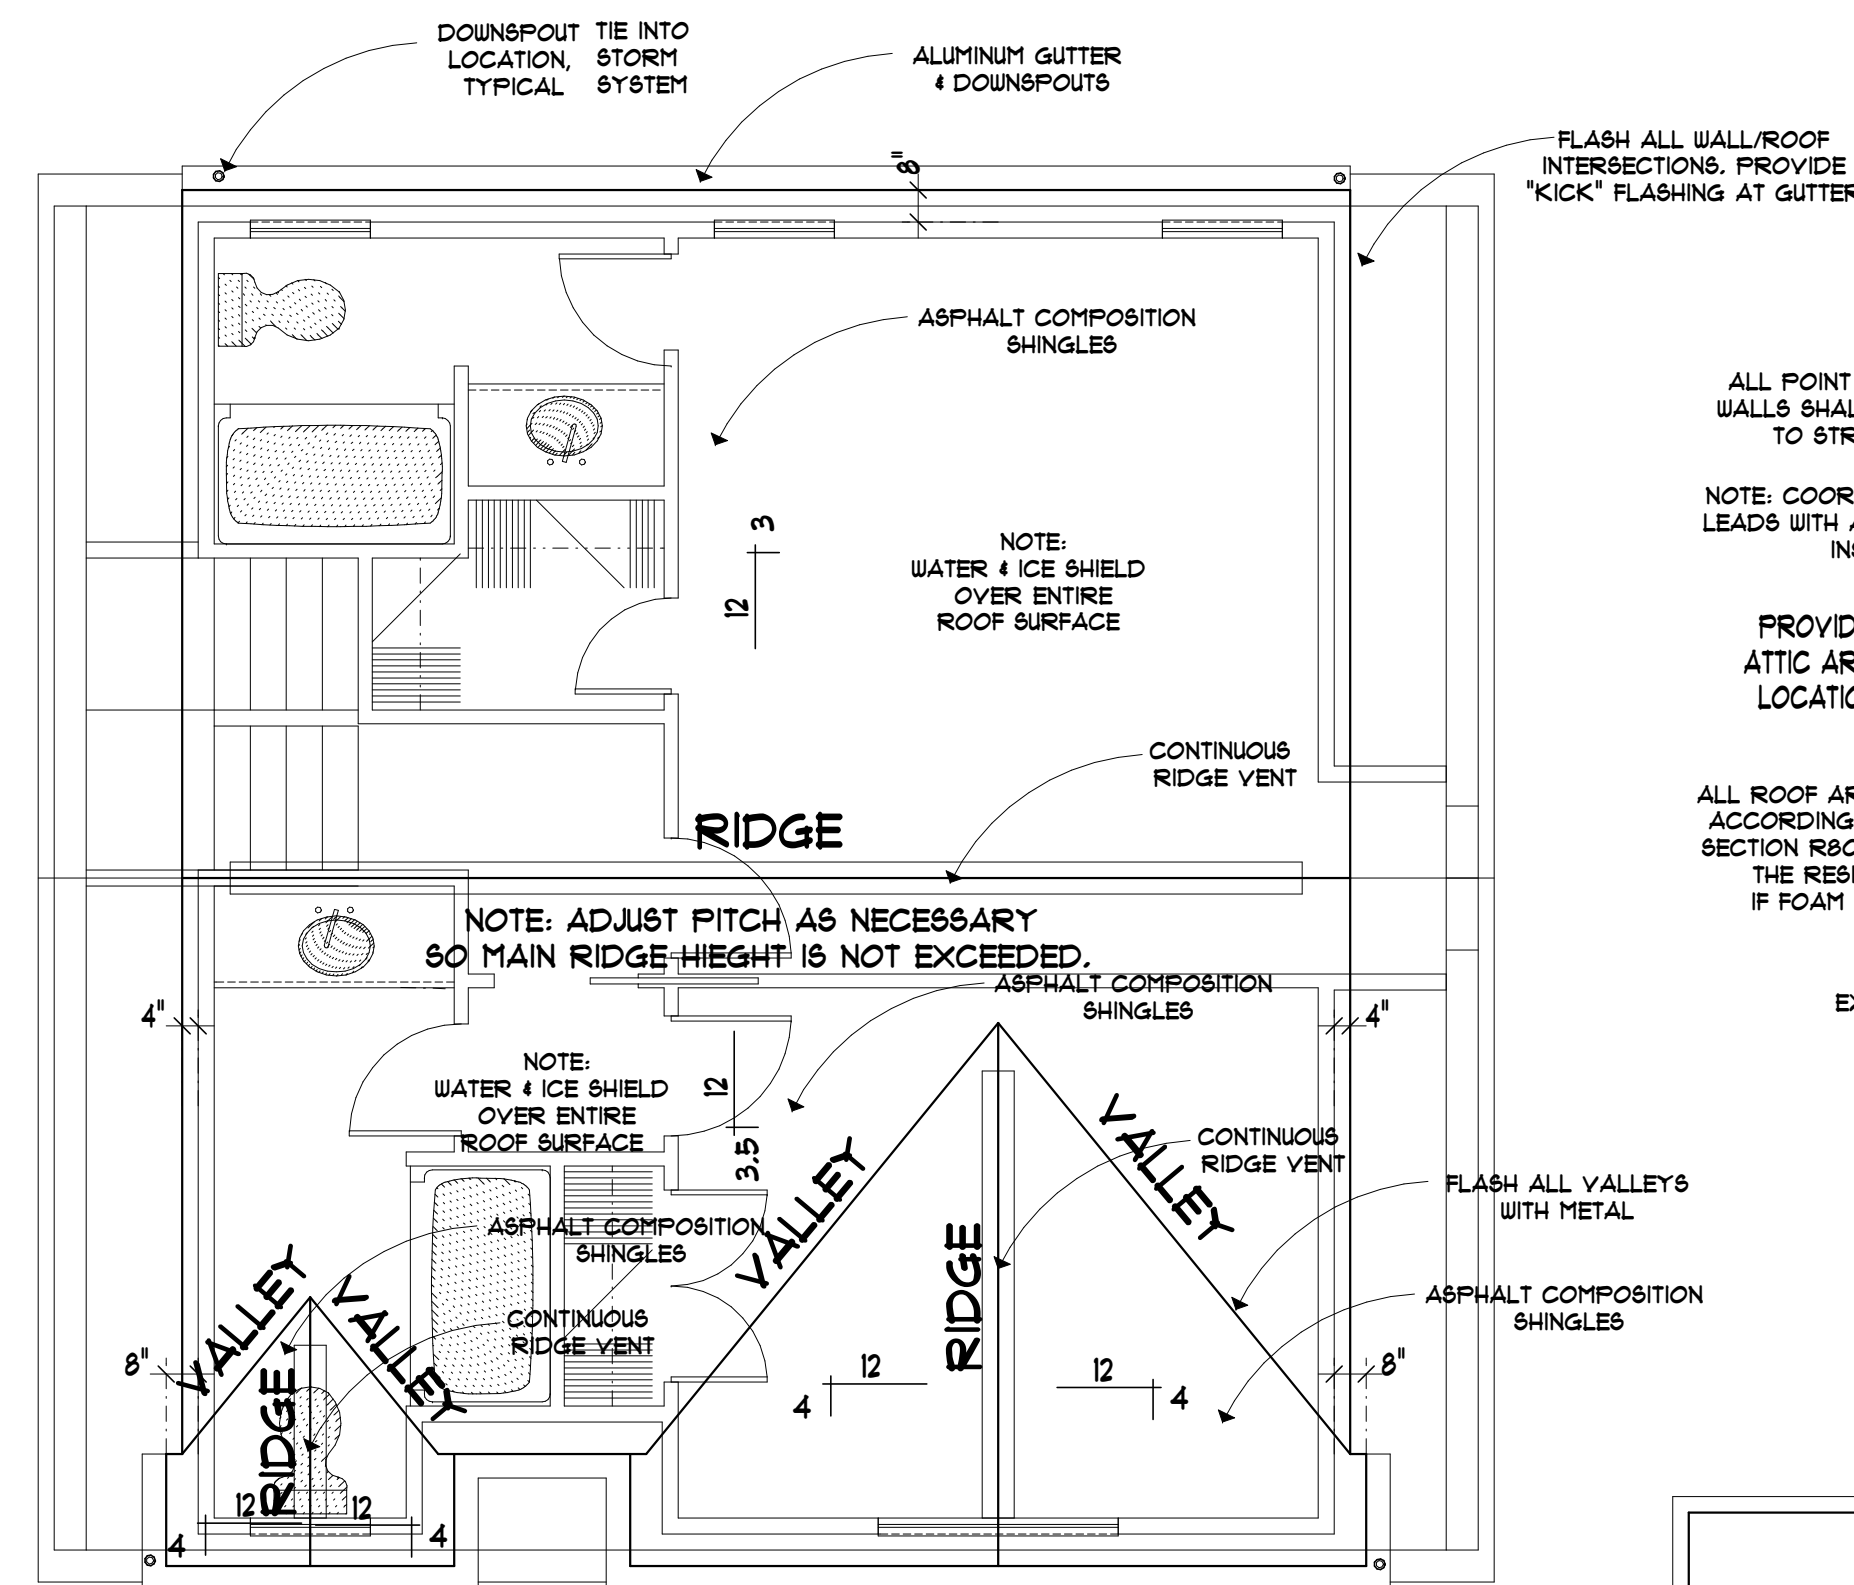

ROOF PLAN

SCALE: 1/4" = 1' 0"

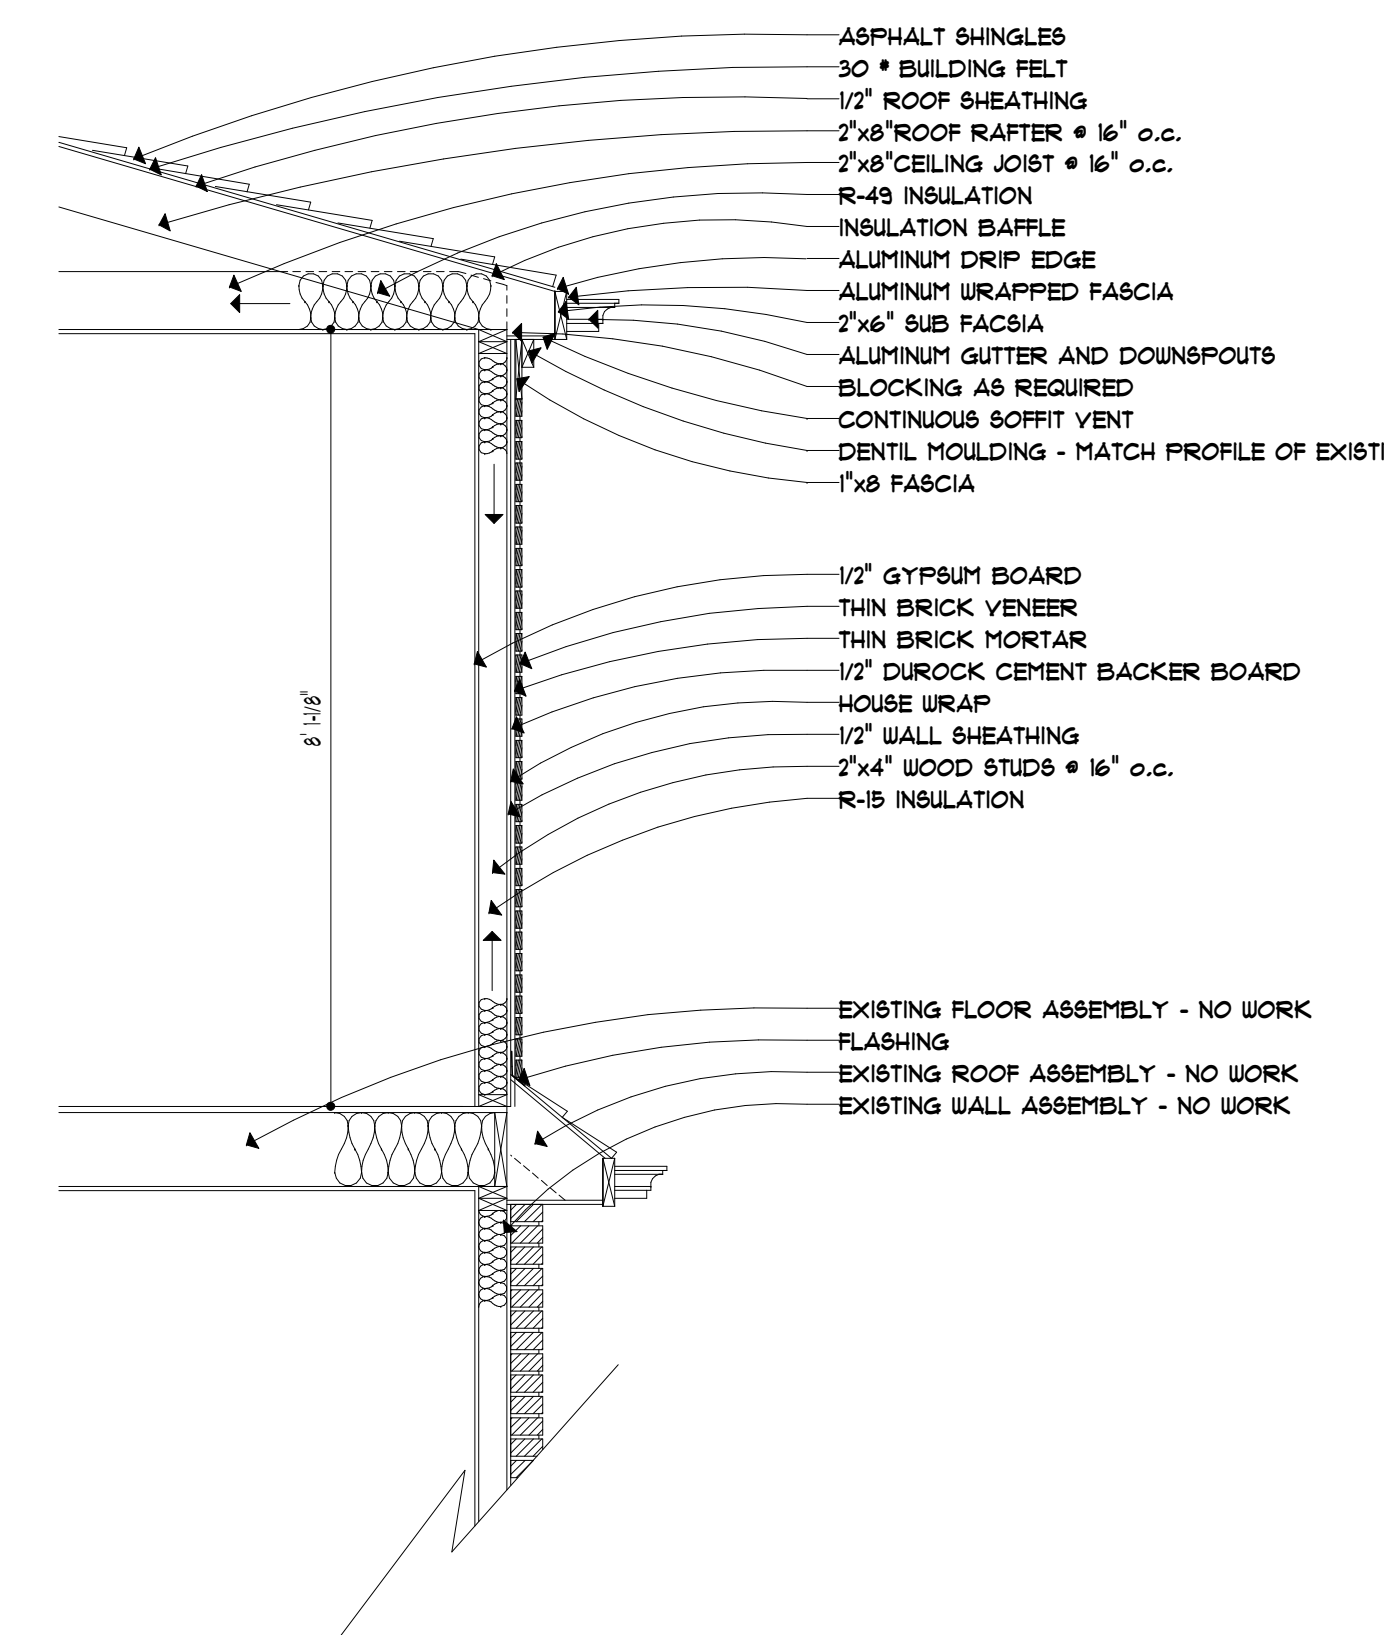

WALL SECTION

SCALE: 1/2" = 1' 0"

MISCELLANEOUS PLANS

SCALE: 1/4" = 1' 0"

ALL CONSTRUCTION SHALL COMPLY WITH THE REQUIREMENTS OF THE 2018 RESIDENTIAL CODE OF OHIO

THESE DRAWINGS, DESIGN, AND SPECIFICATIONS ARE THE SOLE PROPERTY OF SCHILL ARCHITECTURE, LLC. STEPHEN M. SCHILL, ARCHITECT. THEY ARE TO BE USED ONLY WITH THIS PROJECT AND MAY NOT BE REPRODUCED OR ALTERED WITHOUT WRITTEN PERMISSION. THIS COPYRIGHT PROTECTION INCLUDES, BUT IS NOT LIMITED TO, THE OVERALL FORM, AS WELL AS THE ARRANGEMENT, COMPOSITION OF SPACES & ELEMENTS OF DESIGN.

SCHILL ARCHITECTURE, LLC
TELEPHONE: 440.808.3485
FACSIMILE: 440.808.3485
WWW.SCHILLARCHITECTURE.COM

OFFICE ADDRESS: 1650 CROSSINGS PARKWAY SUITE E WESTLAKE, OHIO 44146
EMAIL ADDRESS: STEVE@SCHILLARCHITECTURE.COM

DESIGN LOADS			
COMPONENT	LIVE LOAD	DEAD LOAD	TOTAL LOAD
ATTIC (WALK UP STORAGE)	30 P.S.F.	15 P.S.F.	45 P.S.F.
ATTIC (LIMITED STORAGE)	20 P.S.F.	15 P.S.F.	35 P.S.F.
ATTIC (NO STORAGE)	10 P.S.F.	15 P.S.F.	25 P.S.F.
DECKS	40 P.S.F.	15 P.S.F.	55 P.S.F.
EXTERIOR BALCONIES	60 P.S.F.	15 P.S.F.	75 P.S.F.
GUARDRAIL AND HANDRAILS	200 P.S.F.	15 P.S.F.	215 P.S.F.
GUARDRAIL INFILL COMPONENTS	50 P.S.F.	15 P.S.F.	65 P.S.F.
PASSENGER VEHICLE GARAGES	50 P.S.F.	15 P.S.F.	65 P.S.F.
ROOMS OTHER THAN SLEEPING ROOMS	40 P.S.F.	15 P.S.F.	55 P.S.F.
SLEEPING ROOMS	30 P.S.F.	15 P.S.F.	45 P.S.F.
STAIRS	40 P.S.F.	15 P.S.F.	55 P.S.F.
ROOFS	25 P.S.F.	15 P.S.F.	40 P.S.F.
SNOW	25 P.S.F.	N.A.	25 P.S.F.
WIND	15 M.P.H.	N.A.	15 M.P.H.
SOIL BEARING	3000 P.S.F.	N.A.	3000 P.S.F.

DESIGN LOADS			
COMPONENT	LIVE LOAD	DEAD LOAD	TOTAL LOAD
ATTIC (WALK UP STORAGE)	30 P.S.F.	15 P.S.F.	45 P.S.F.
ATTIC (LIMITED STORAGE)	20 P.S.F.	15 P.S.F.	35 P.S.F.
ATTIC (NO STORAGE)	10 P.S.F.	15 P.S.F.	25 P.S.F.
DECKS	40 P.S.F.	15 P.S.F.	55 P.S.F.
EXTERIOR BALCONIES	60 P.S.F.	15 P.S.F.	75 P.S.F.
GUARDRAIL AND HANDRAILS	200 P.S.F.	15 P.S.F.	215 P.S.F.
GUARDRAIL INFILL COMPONENTS	50 P.S.F.	15 P.S.F.	65 P.S.F.
PASSENGER VEHICLE GARAGES	50 P.S.F.	15 P.S.F.	65 P.S.F.
ROOMS OTHER THAN SLEEPING ROOMS	40 P.S.F.	15 P.S.F.	55 P.S.F.
SLEEPING ROOMS	30 P.S.F.	15 P.S.F.	45 P.S.F.
STAIRS	40 P.S.F.	15 P.S.F.	55 P.S.F.
ROOFS	25 P.S.F.	15 P.S.F.	40 P.S.F.
SNOW	25 P.S.F.	N.A.	25 P.S.F.
WIND	15 M.P.H.	N.A.	15 M.P.H.
SOIL BEARING	3000 P.S.F.	N.A.	3000 P.S.F.

NOTES:
1. ASSUMED SOIL BEARING CAPACITY IS 3000 P.S.F. A GEOTECHNICAL ENGINEER SHALL BE RETAINED AND THE ARCHITECT SHALL BE NOTIFIED AT ONCE IF UNUSUAL OR UNSTABLE SOIL CONDITIONS EXIST.
2. NOTIFY ARCHITECT IF STONE OR TILE FLOORING IS TO BE USED.
3. NOTIFY ARCHITECT IF ROOFING MATERIAL IS OTHER THAN ASPHALT SHINGLE.

MATERIAL SUMMARY		
SPACE	MATERIAL	HEIGHT
MAIN FLOOR	WOOD-2"x4"/12"x4"	N.A.
UPPER FLOOR	WOOD-2"x4"/12"x4"	N.A.
THIRD FLOOR	WOOD-2"x4"/12"x4"	8' 0"

AREA SUMMARY	
AREA	SIZE
UNFINISHED LOWER LEVEL	0,000 SQ.FT.
FINISHED LOWER LEVEL	0,000 SQ.FT.
MAIN LEVEL	0,000 SQ.FT.
UPPER LEVEL	0,000 SQ.FT.
UPPER LEVEL(VOLUME SPACE)	0,000 SQ.FT.
THIRD FLOOR	646 SQ.FT.
TOTAL HEATED AREA	646 SQ.FT.
GARAGE	0,000 SQ.FT.
ARRIVAL PORCH	0,000 SQ.FT.
FRIENDS/ FAMILY PORCH	0,000 SQ.FT.
MAIN LEVEL COVERED REAR PORCH	0,000 SQ.FT.
LOWER LEVEL COVERED REAR PORCH	0,000 SQ.FT.
TOTAL AREA UNDER ROOF	646 SQ.FT.
REAR PORCH (NOT COVERED)	0,000 SQ.FT.
TOTAL PROJECT AREA	646 SQ.FT.
AREA CALCULATIONS ARE MADE FROM THE OUTSIDE FACE OF EXTERIOR WALLS, STAIRWELLS AND FIREPLACE AREAS ARE INCLUDED ONCE, GARAGES, OPEN SPACES, DECKS, PATIOS, AND EXTERIOR PORCHES ARE NOT INCLUDED IN THESE FIGURES. THEY ARE SUMMARIZED AS ADDITIONAL AREAS IN THIS TABLE	

ISSUED FOR PERMIT AND BIDDING	15 SEP 2026
ISSUED FOR PERMIT AND BIDDING	15 AUG 2026

REV. NO.	DESCRIPTION	DATE
PROJECT:		
THIRD FLOOR CONVERSION TO:		
A PRIVATE RESIDENCE:		
LOCATION 20381 MOREWOOD PARKWAY		
ROCKY RIVER, OHIO 44116		
CUYAHOGA COUNTY		
PERMANENT PARCEL NUMBER: 301-13-123		

MISC. PLANS

SCALE:	JOB NUMBER:
AS NOTED	26EKCEOG


DATE: 1 JULY 2026

CAD FILE NAME: C:\DRAWINGS\CENTRAL\ARCHIVE\SCHILL\26EKCEOG\CONCEPT.CAD

STEPHEN M. SCHILL, LICENSE # 8871
EXPIRATION DATE: 12/31/2021


A-1

DRAWING NUMBER

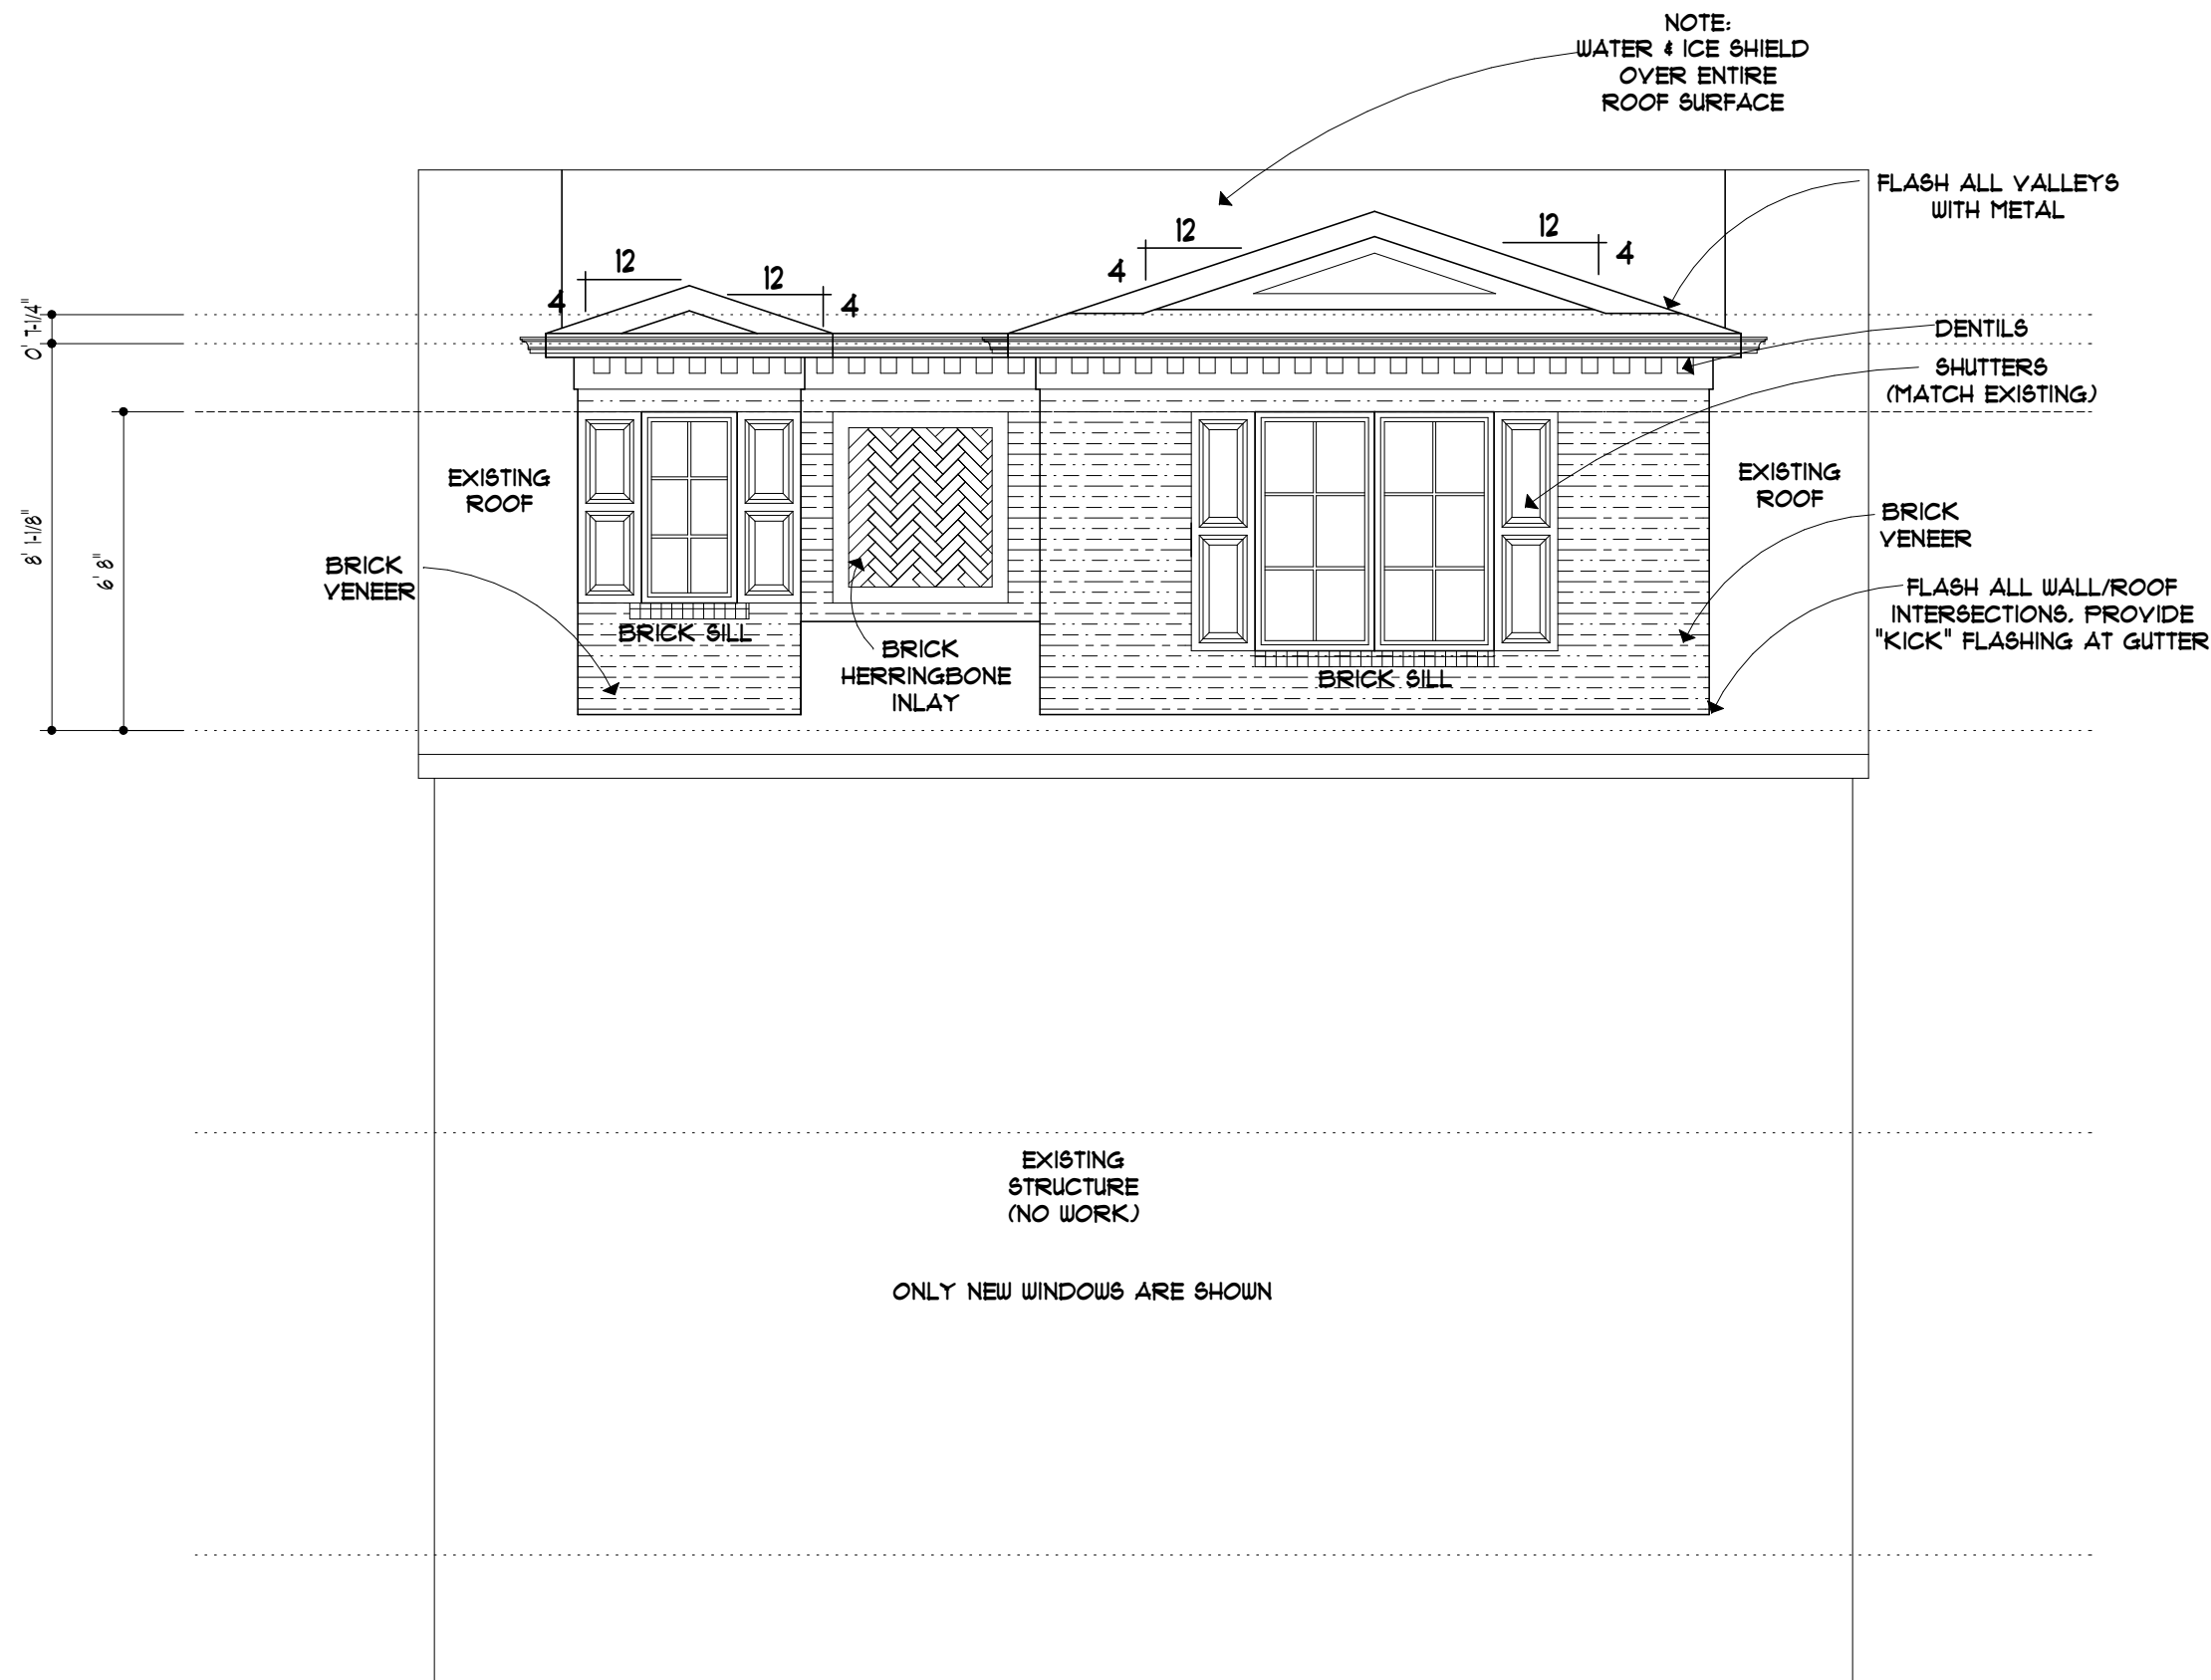


NORTH ELEVATION
SCALE: 1/4" = 1' 0"

ALL MATERIALS TO MATCH EXISTING

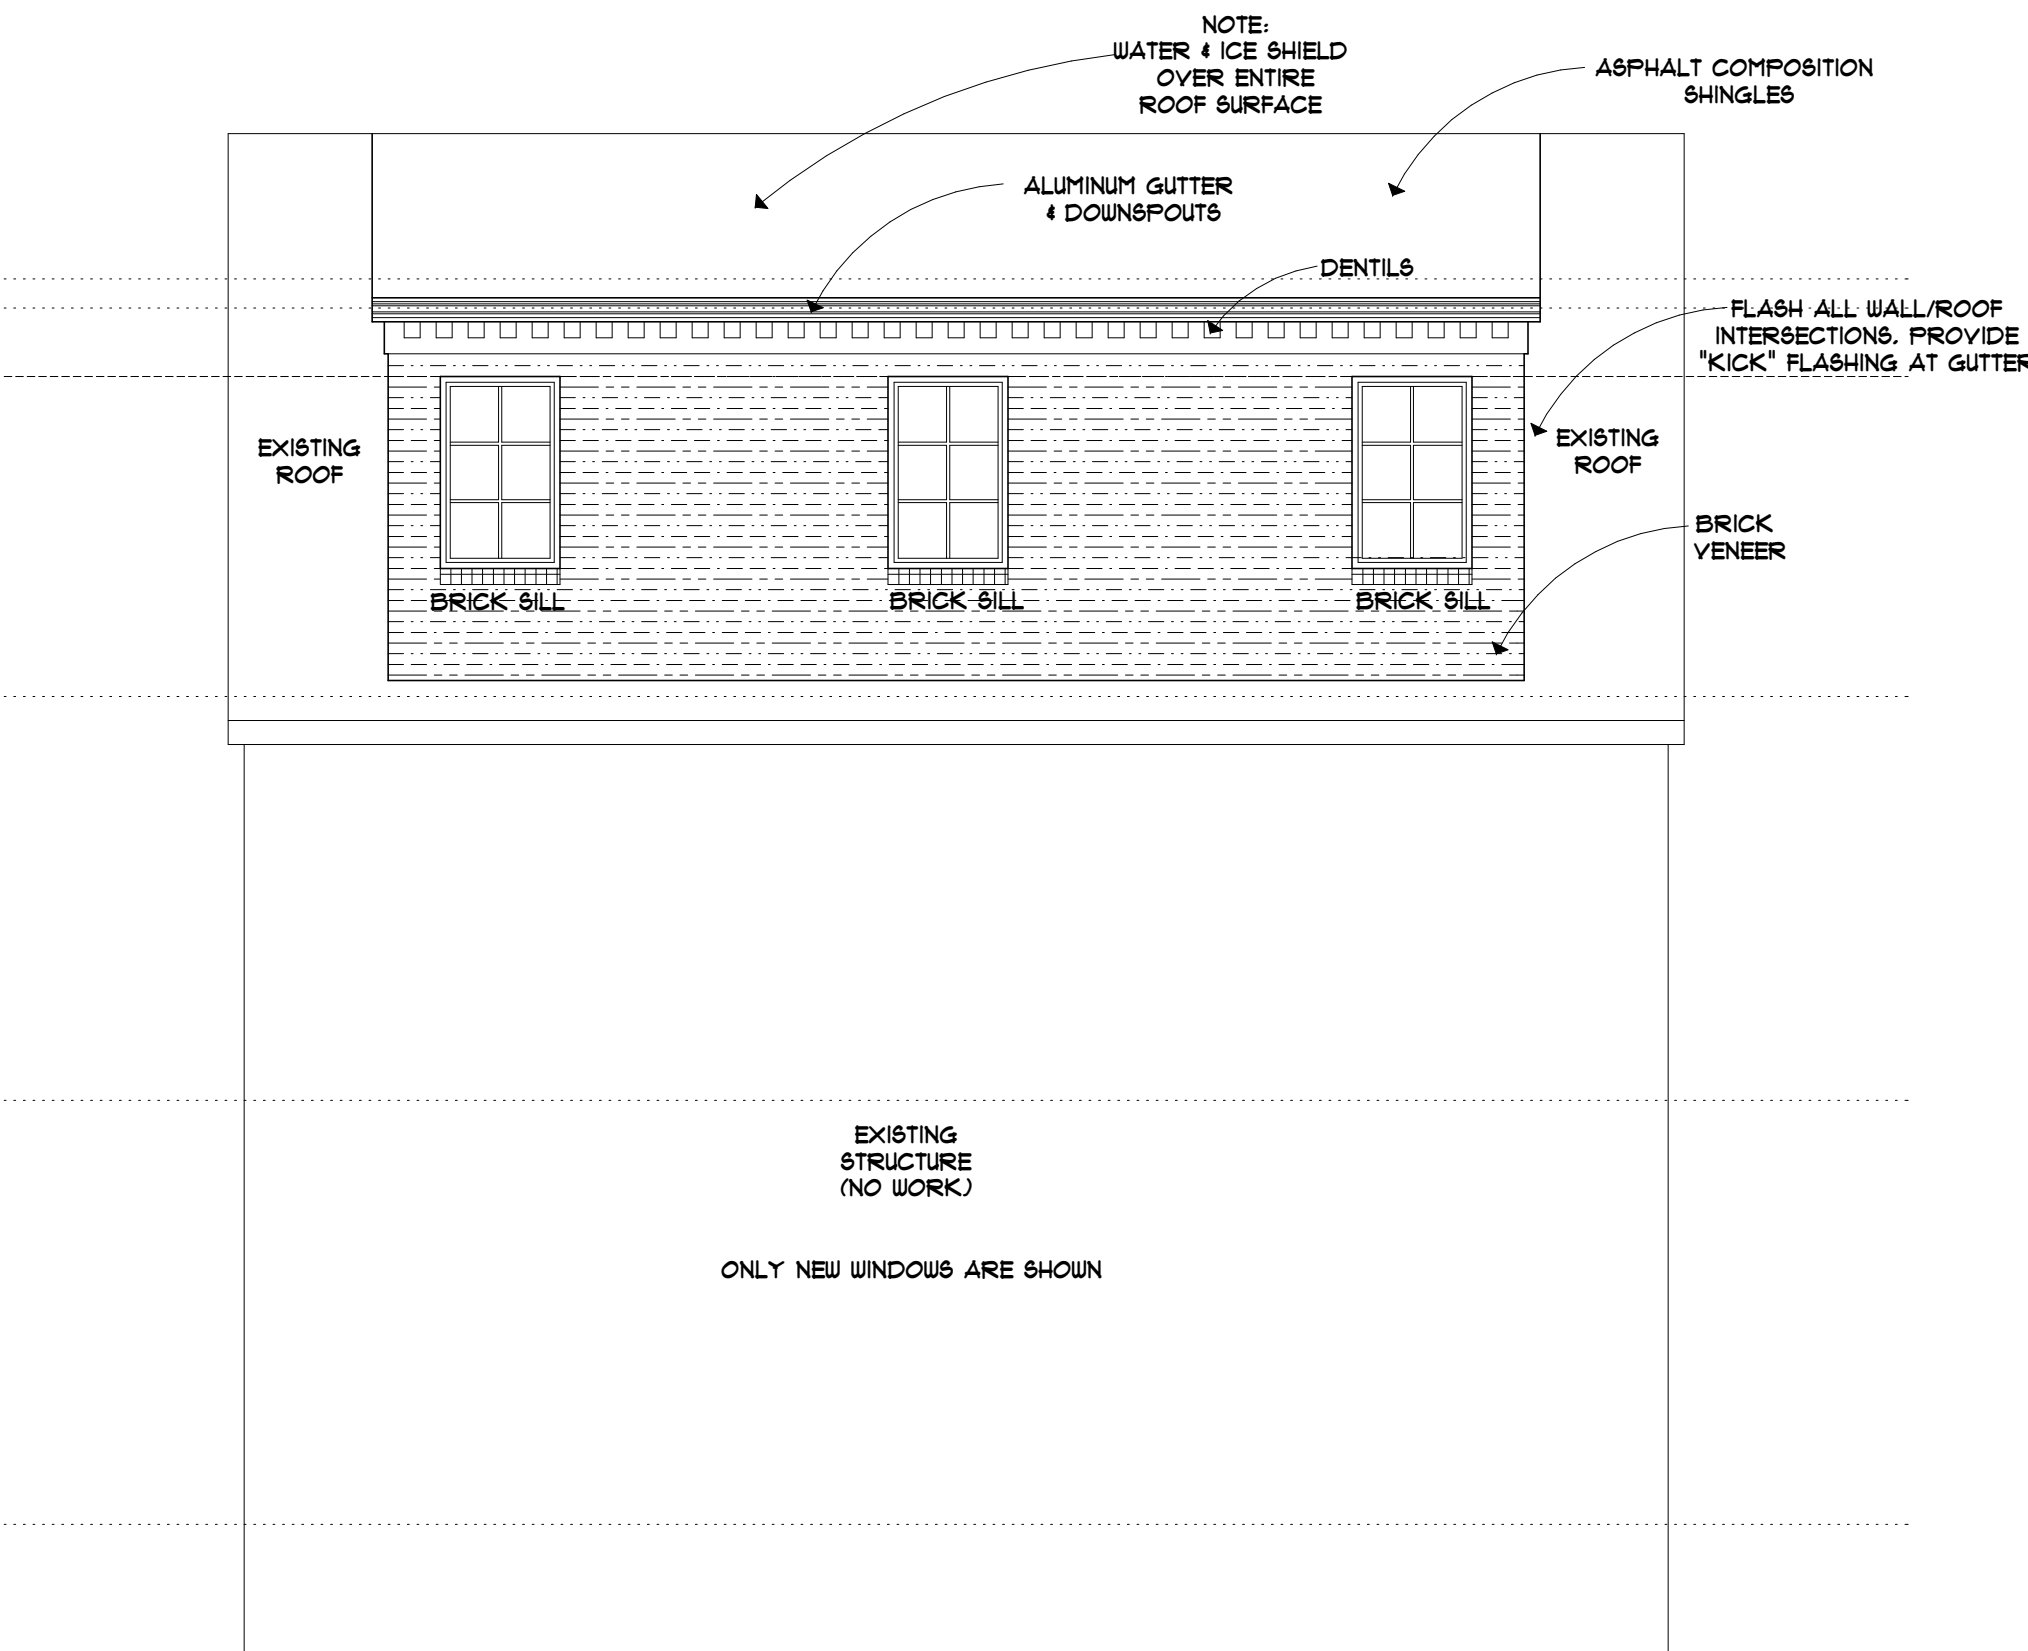


SOUTH ELEVATION
SCALE: 1/4" = 1' 0"

ALL MATERIALS TO MATCH EXISTING

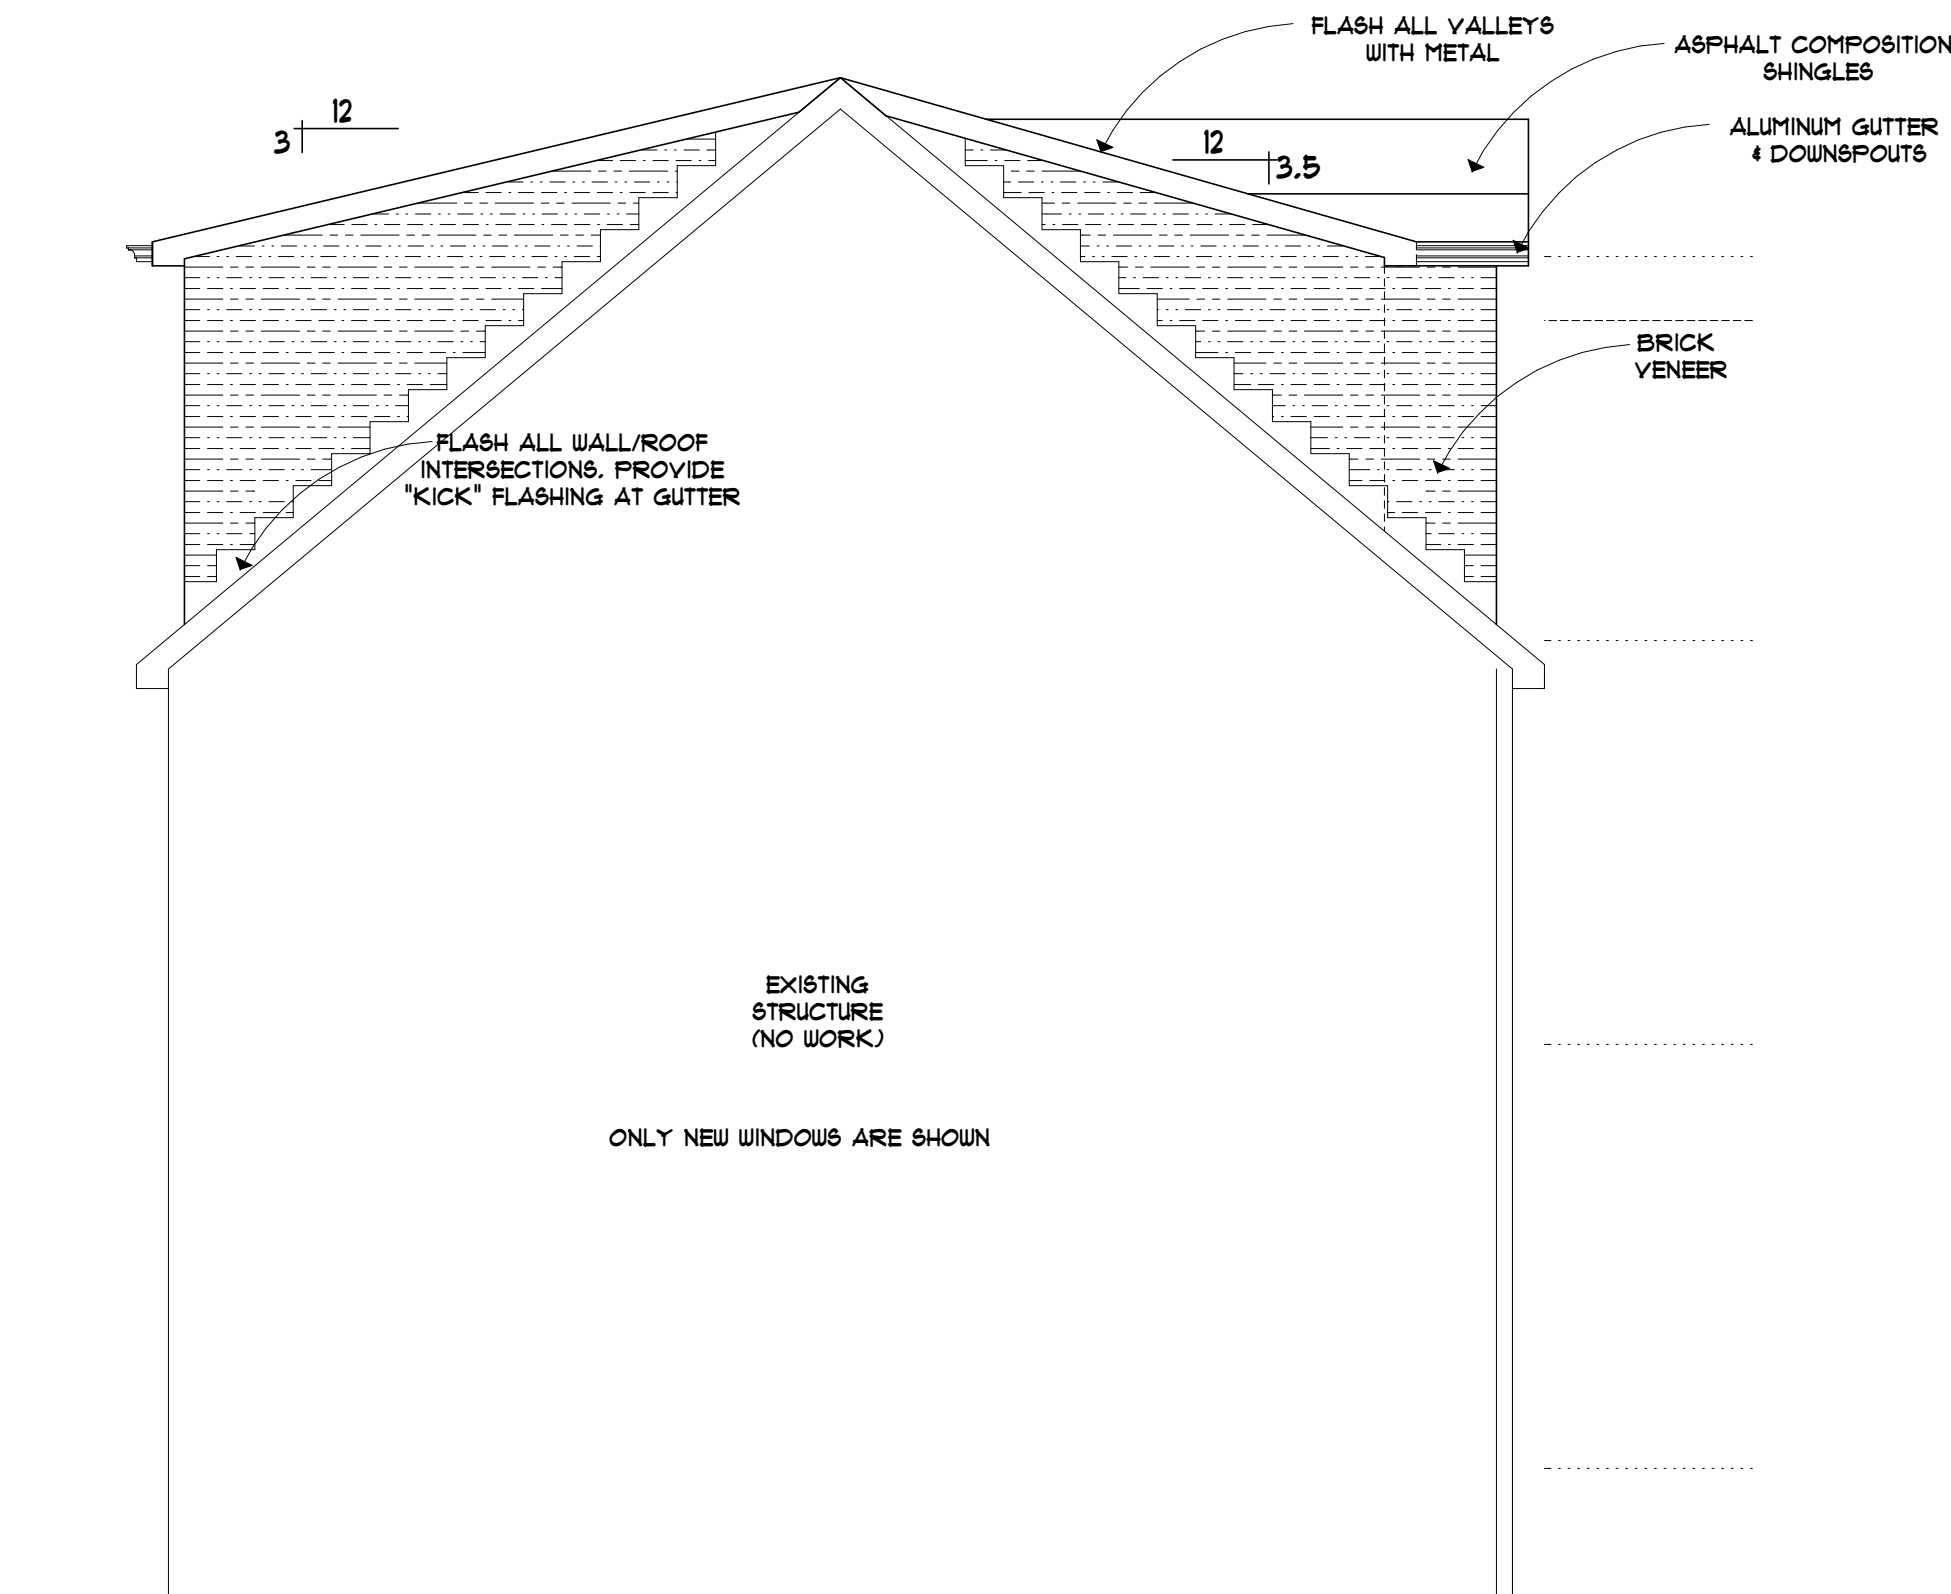

EAST ELEVATION
SCALE: 1/4" = 1' 0"

ALL MATERIALS TO MATCH EXISTING

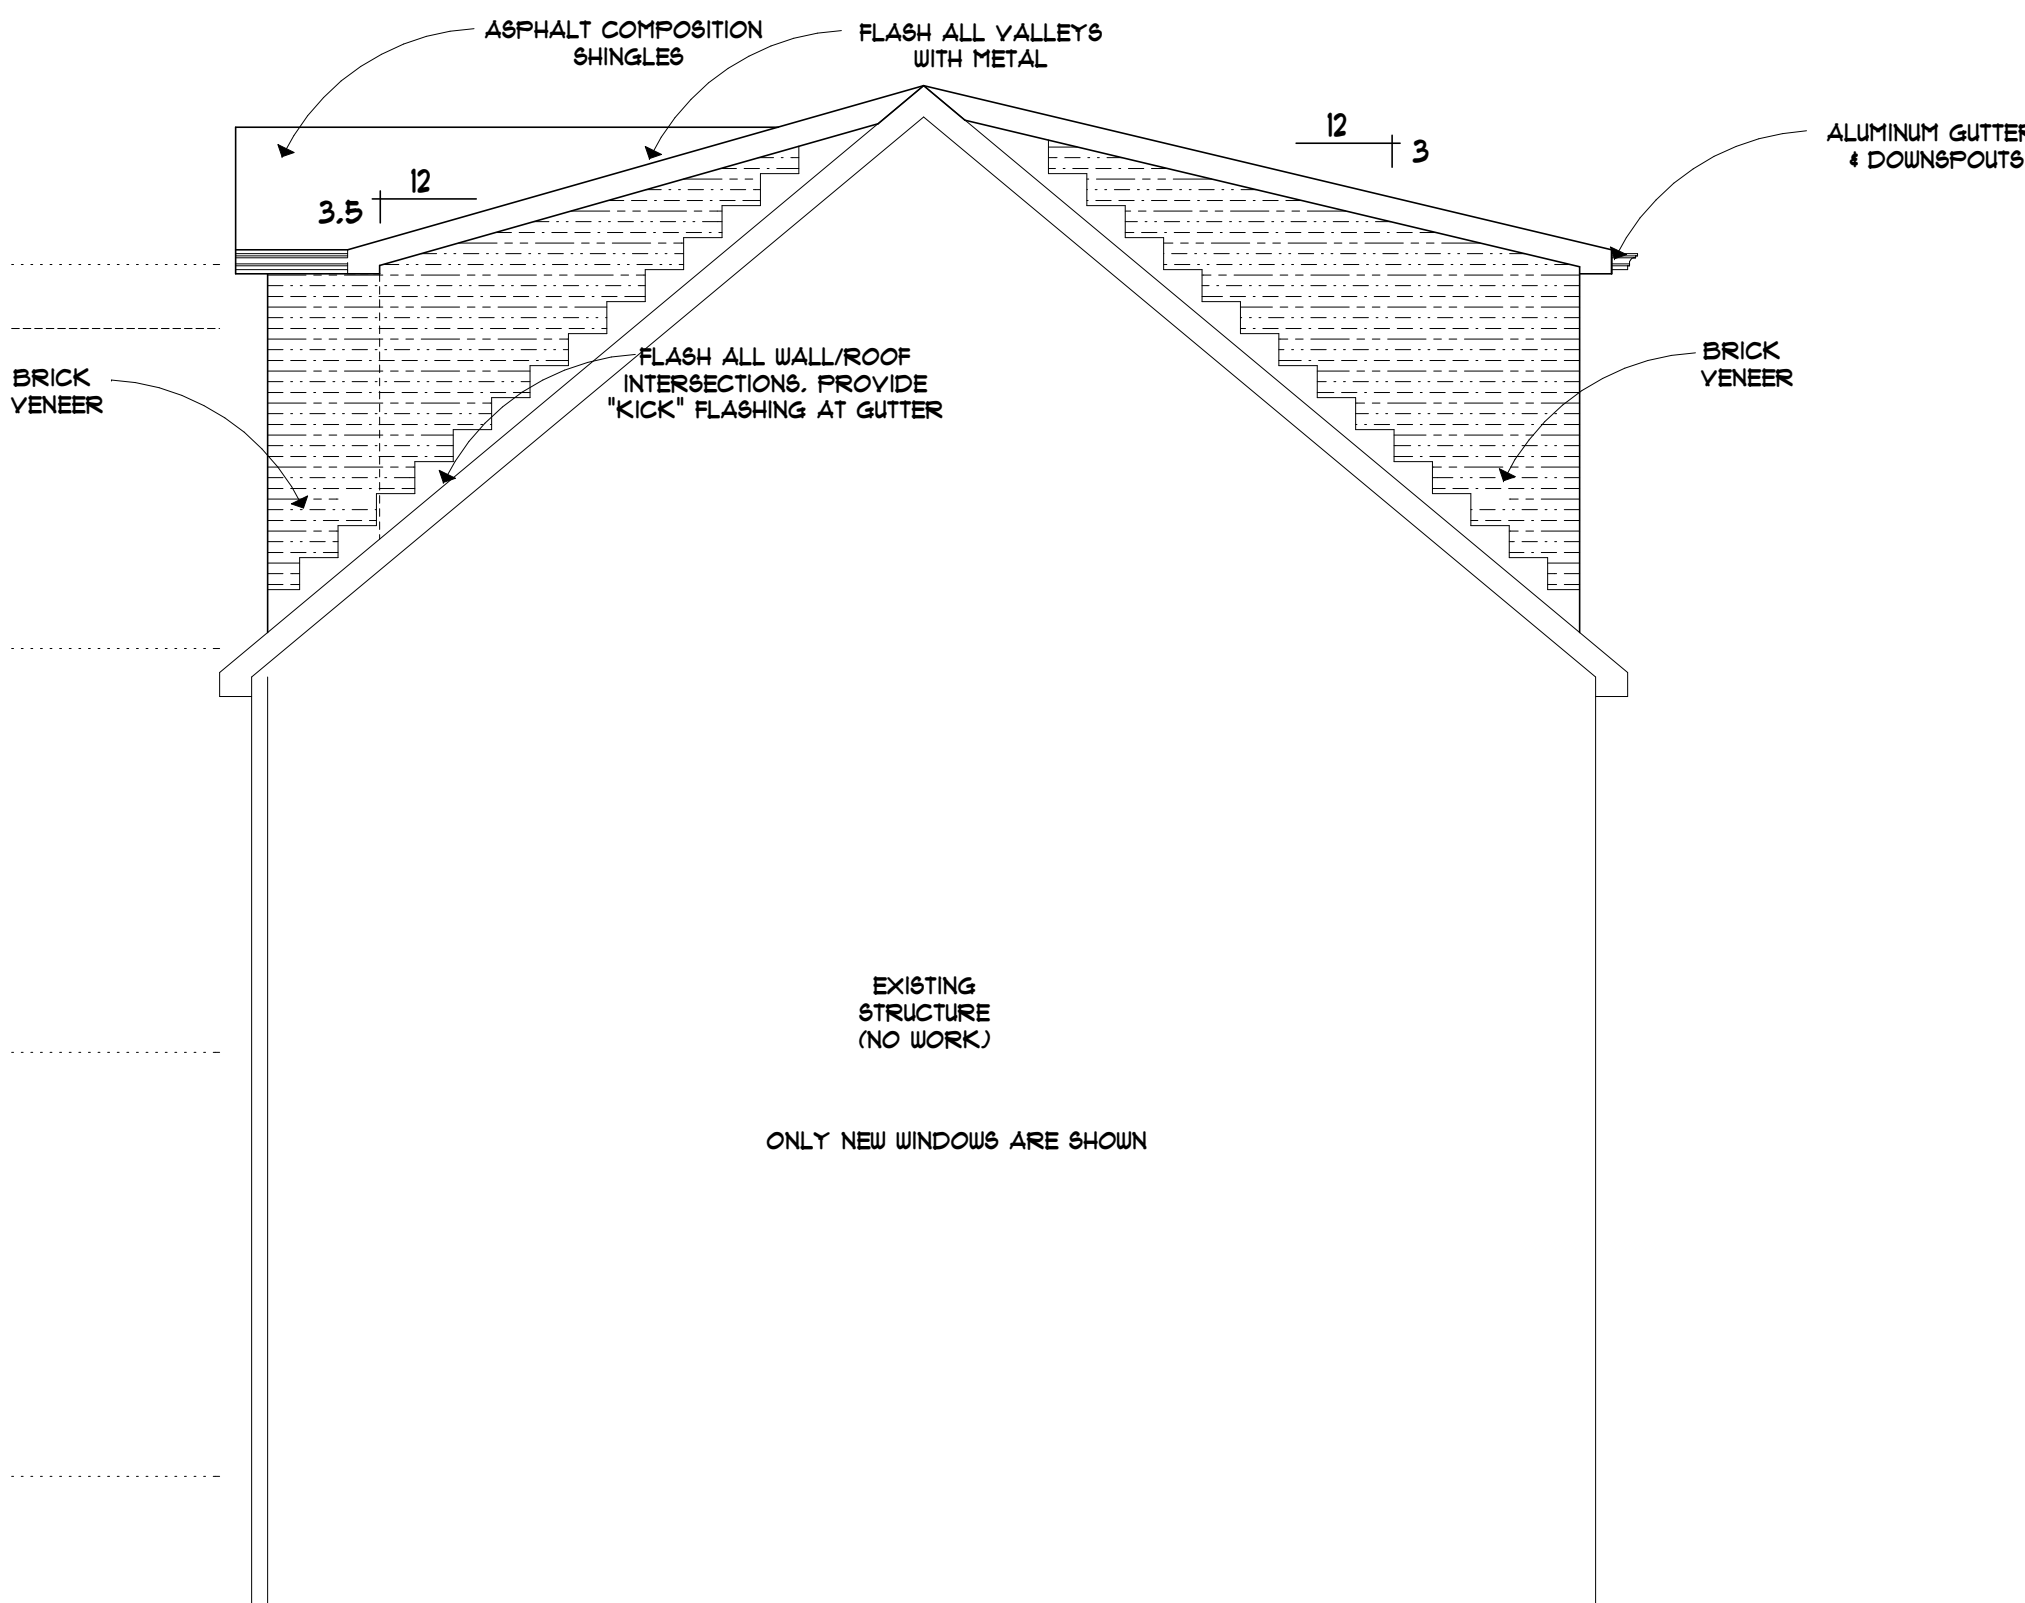


WEST ELEVATION
SCALE: 1/4" = 1' 0"

ALL MATERIALS TO MATCH EXISTING

EXTERIOR ELEVATIONS
SCALE: 1/4" = 1' 0"

ALL CONSTRUCTION SHALL COMPLY WITH THE REQUIREMENTS OF THE 2019 RESIDENTIAL CODE OF OHIO



Schill
Architecture

SCHILL ARCHITECTURE, LLC
TELEPHONE: 440.808.3485
FACSIMILE: 440.808.3485
WWW.SCHILLARCHITECTURE.COM

OFFICE ADDRESS: 1650 CROSSINGS PARKWAY SUITE E WESTLAKE, OHIO 44146
EMAIL ADDRESS: STEVE@SCHILLARCHITECTURE.COM

DESIGN LOADS

COMPONENT	LIVE LOAD	DEAD LOAD	TOTAL LOAD
ATTIC (WALK UP STORAGE)	30 P.S.F.	15 P.S.F.	45 P.S.F.
ATTIC (LIMITED STORAGE)	20 P.S.F.	15 P.S.F.	35 P.S.F.
ATTIC (NO STORAGE)	10 P.S.F.	15 P.S.F.	25 P.S.F.
DECKS	40 P.S.F.	15 P.S.F.	55 P.S.F.
EXTERIOR BALCONIES	60 P.S.F.	15 P.S.F.	75 P.S.F.
GUARDRAIL AND HANDRAILS	200 P.S.F.	15 P.S.F.	215 P.S.F.
GUARDRAIL INFILL COMPONENTS	50 P.S.F.	15 P.S.F.	65 P.S.F.
PASSENGER VEHICLE GARAGES	50 P.S.F.	15 P.S.F.	65 P.S.F.
ROOMS (OTHER THAN SLEEPING ROOMS)	40 P.S.F.	15 P.S.F.	55 P.S.F.
SLEEPING ROOMS	30 P.S.F.	15 P.S.F.	45 P.S.F.
STAIRS	40 P.S.F.	15 P.S.F.	55 P.S.F.
ROOFS	25 P.S.F.	15 P.S.F.	40 P.S.F.
SNOW	25 P.S.F.	N.A.	25 P.S.F.
WIND	15 M.P.H.	N.A.	15 M.P.H.
SOIL BEARING	3000 P.S.F.	N.A.	3000 P.S.F.

NOTES:
1. ASSIGNED SOIL BEARING CAPACITY IS 3000 P.S.F. A GEOTECHNICAL ENGINEER SHALL BE RETAINED AND THE ARCHITECT SHALL BE NOTIFIED AT ONCE IF UNUSUAL OR UNSTABLE SOIL CONDITIONS EXIST.
2. NOTIFY ARCHITECT IF STONE OR TILE FLOORING IS TO BE USED.
3. NOTIFY ARCHITECT IF ROOFING MATERIAL IS OTHER THAN ASPHALT SHINGLE.

SPACE	MATERIAL	HEIGHT
MAIN FLOOR	WOOD-2"x4"/2"x4"	N.A.
UPPER FLOOR	WOOD-2"x4"/2"x4"	N.A.
THIRD FLOOR	WOOD-2"x4"/2"x4"	8' 0"


AREA	SIZE
UNFINISHED LOWER LEVEL	0,000 SQ.FT.
FINISHED LOWER LEVEL	0,000 SQ.FT.
MAIN LEVEL	0,000 SQ.FT.
UPPER LEVEL	0,000 SQ.FT.
UPPER LEVEL(VOLUME SPACE)	0,000 SQ.FT.
THIRD FLOOR	646 SQ.FT.
TOTAL HEATED AREA	646 SQ.FT.
GARAGE	0,000 SQ.FT.
ARRIVAL PORCH	0,000 SQ.FT.
FRIENDS/ FAMILY PORCH	0,000 SQ.FT.
MAIN LEVEL COVERED REAR PORCH	0,000 SQ.FT.
LOWER LEVEL COVERED REAR PORCH	0,000 SQ.FT.
TOTAL AREA UNDER ROOF	646 SQ.FT.
REAR PORCH (NOT COVERED)	0,000 SQ.FT.
TOTAL PROJECT AREA	646 SQ.FT.
AREA CALCULATIONS ARE MADE FROM THE OUTSIDE FACE OF EXTERIOR WALLS, STAIRWELLS AND FIREPLACE AREAS ARE INCLUDED ONCE, GARAGES, OPEN SPACES, DECKS, PATIOS, AND EXTERIOR PORCHES ARE NOT INCLUDED IN THESE FIGURES. THEY ARE SUMMARIZED AS ADDITIONAL AREAS IN THIS TABLE.	

ISSUED FOR PERMIT AND BIDDING	15 SEPT 2026
ISSUED FOR PERMIT AND BIDDING	15 AUG 2026


REV. NO.	DESCRIPTION	DATE
PROJECT: THIRD FLOOR CONVERSION TO: A PRIVATE RESIDENCE:		
LOCATION: 20381 MOREWOOD PARKWAY ROCKY RIVER, OHIO 44116 CUYAHOGA COUNTY PERMANENT PARCEL NUMBER: 301-13-123		

EXTERIOR ELEVATIONS


SCALE: AS NOTED	JOB NUMBER: 26EKCEOG
DATE: 1 JULY 2026	CAD FILE NAME: C:\DRAWINGS\CENTRAL\ARCHIVE\ SCHILL\26EKCEOG\CONCEPT.CAD
A-2	
DRAWING NUMBER	




GRAPHIC SCALE

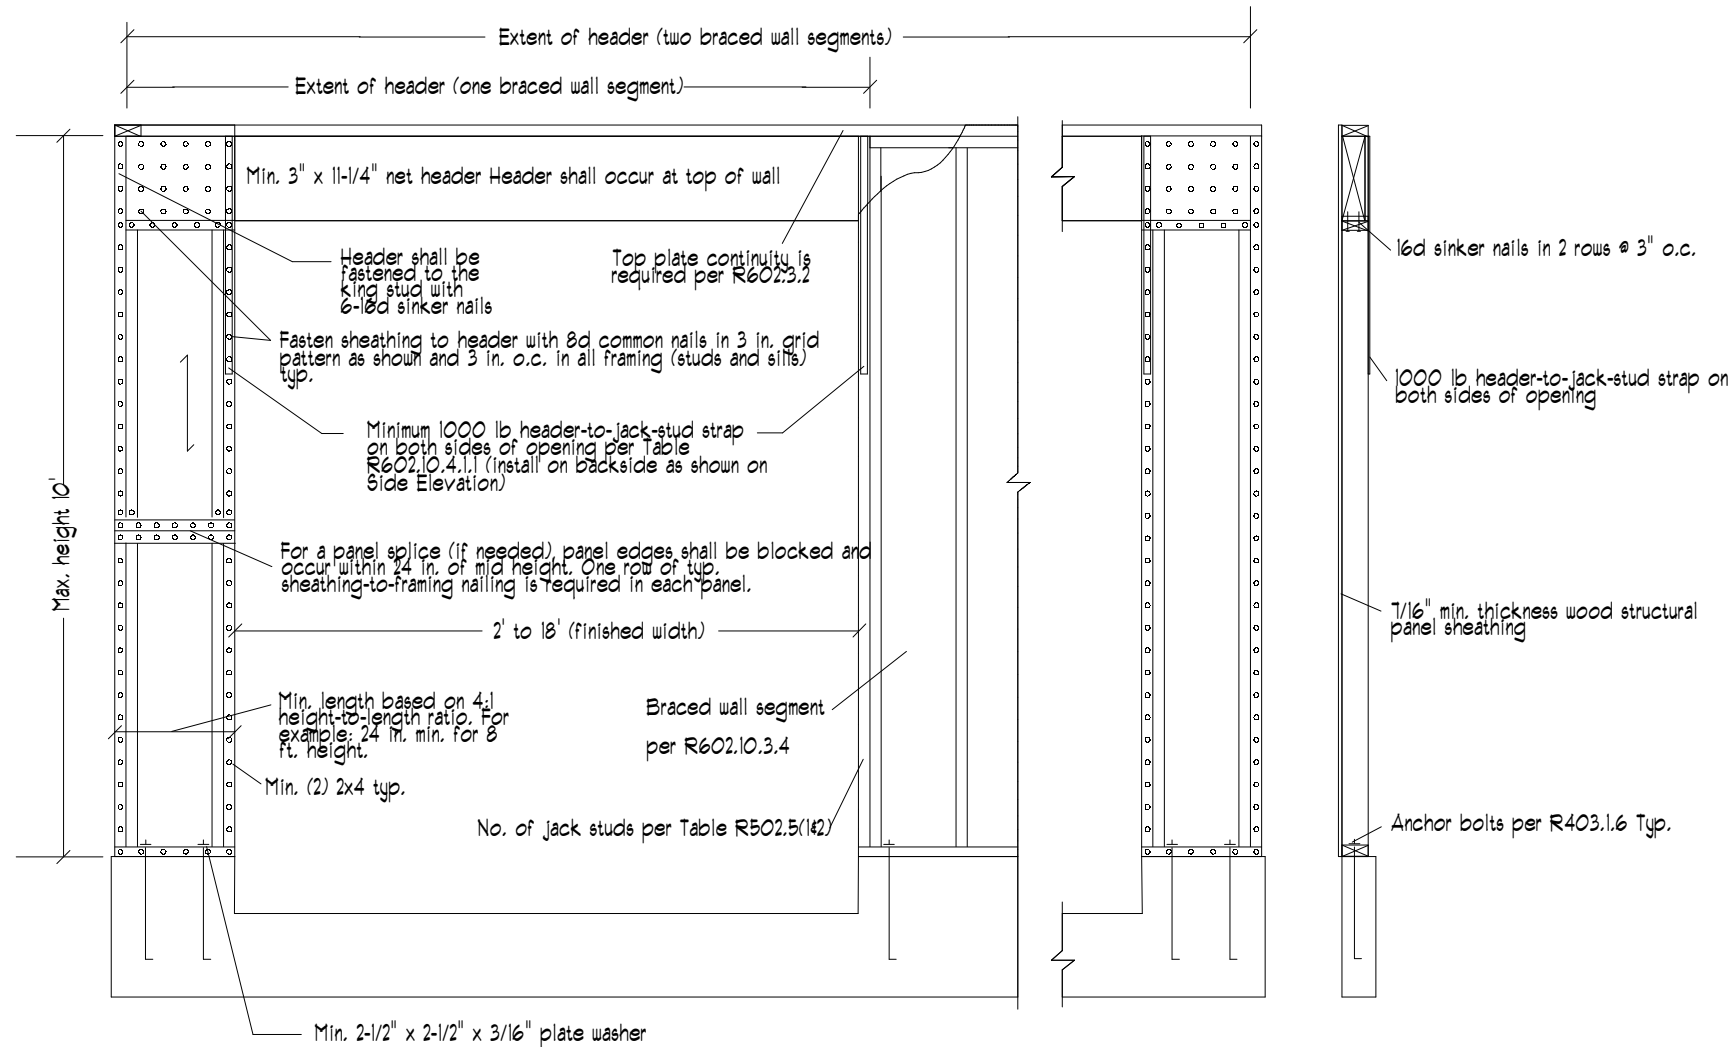


APA BRACED WALL
SCALE: NONE

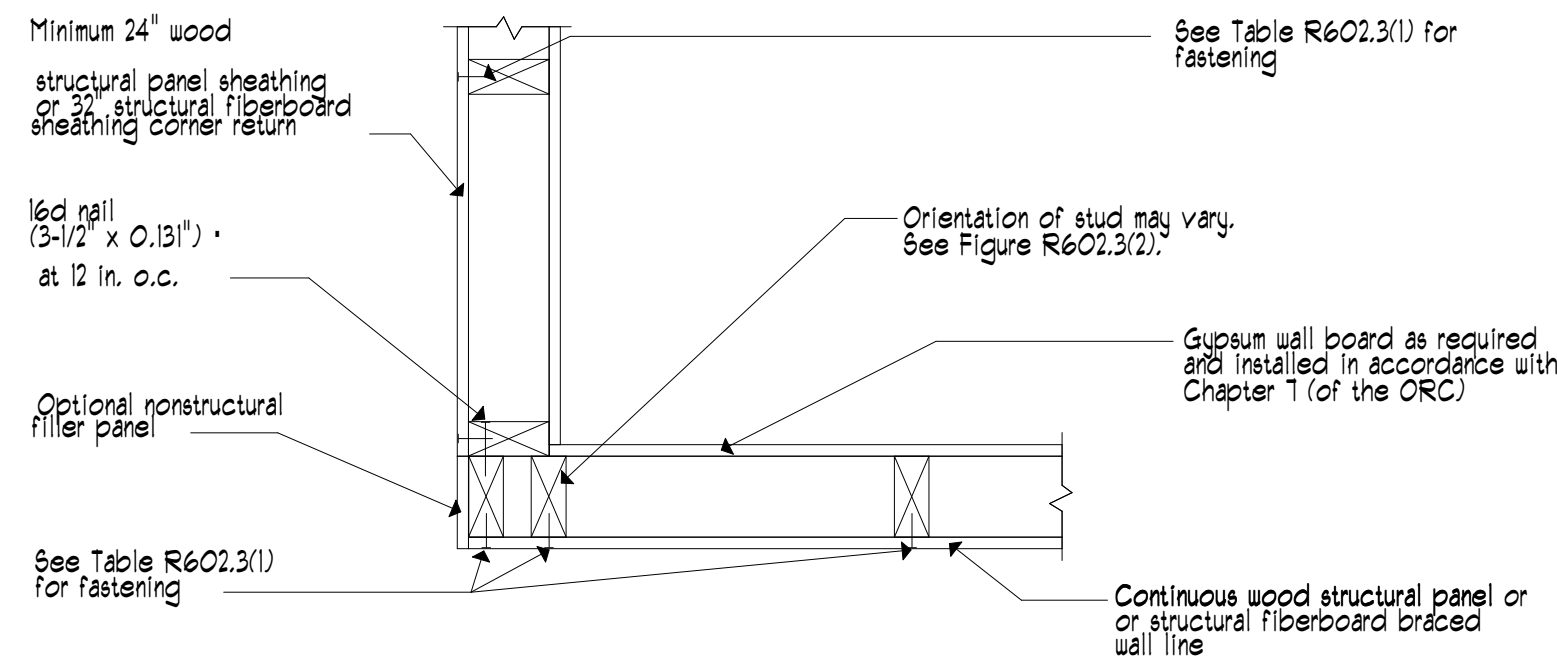

INSIDE CORNER DETAIL
SCALE: NONE

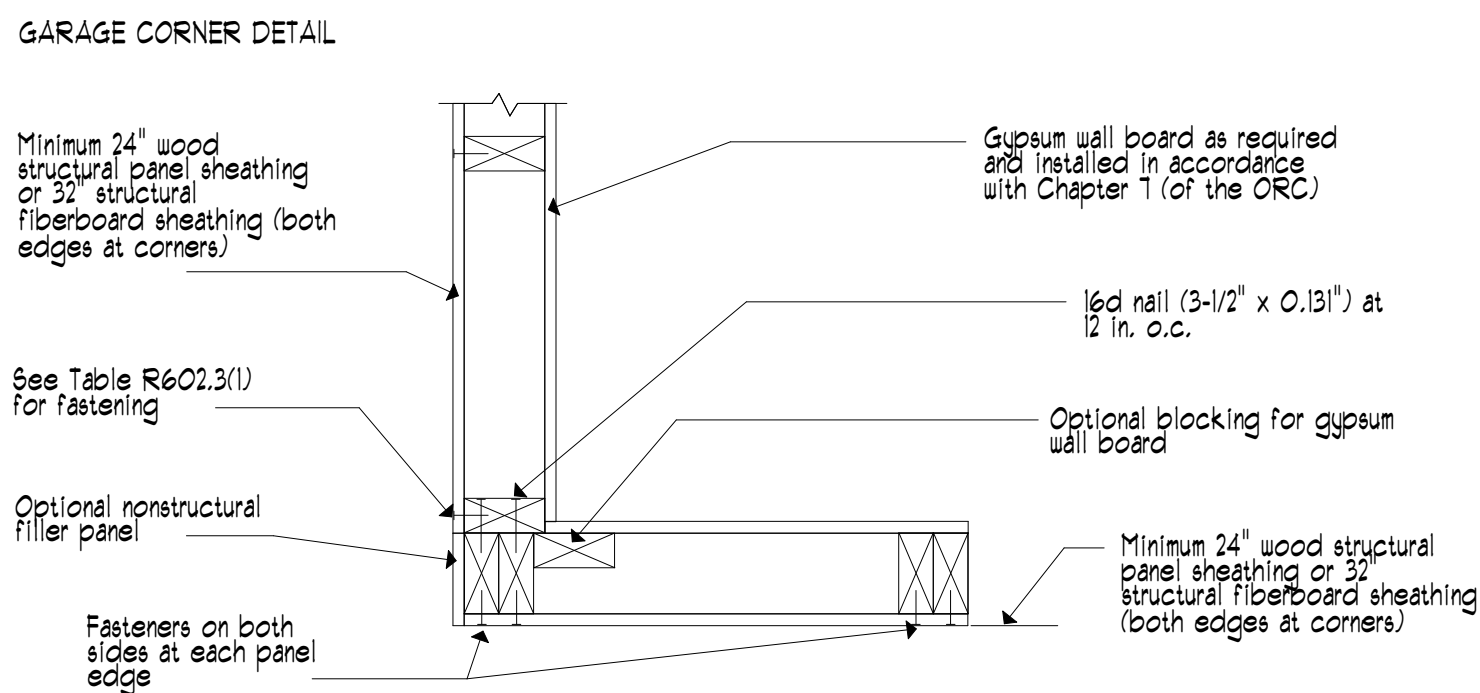


GARAGE CORNER DETAIL
SCALE: NONE

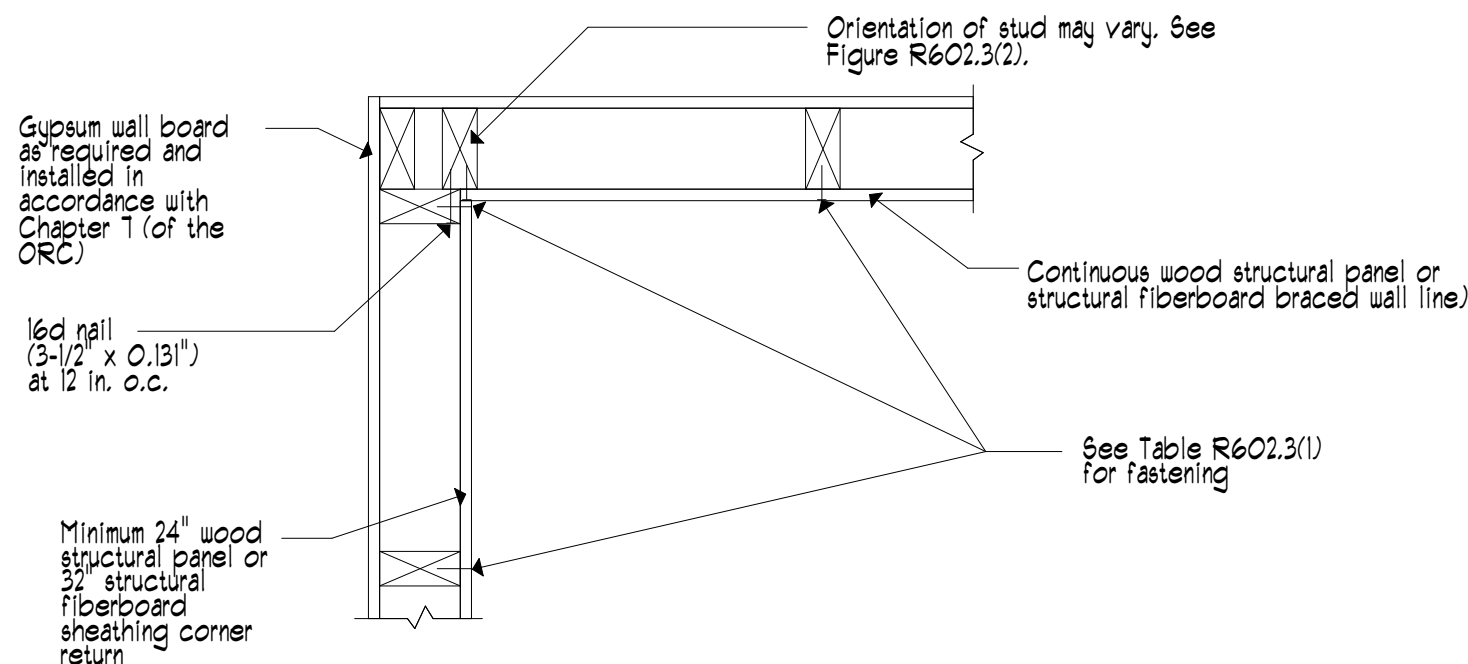

INSIDE CORNER DETAIL
SCALE: NONE

R-VALUE ASSEMBLY TABLE		R-VALUE ASSEMBLY TABLE	
WALL ASSEMBLY		CEILING ASSEMBLY	
COMPONENT	R VALUE	COMPONENT	R VALUE
OUTSIDE AIR FILM	0.17	INSIDE AIR FILM	0.68
THIN BRICK VENEER	0.10	1/2" GYPSUM BOARD	0.45
THINSET MORTAR	0.05	12" FIBERGLASS BATT INSULATION	49.0
1/2" DUROCK CEMENT BACKER BOARD	0.40	1/2" PLYWOOD SHEATHING	0.63
1/2" PLYWOOD SHEATHING	0.63	ASPHALT SHINGLES	0.44
3-1/2" FIBERGLASS BATT INSULATION	15	OUTSIDE AIR FILM	0.17
1/2" GYPSUM BOARD	0.45		
INSIDE AIR FILM	0.68		
TOTAL R VALUE	17.48	TOTAL R VALUE	51.37




GRAPHIC SCALE



SCALE: NONE

ALL CONSTRUCTION SHALL COMPLY WITH THE REQUIREMENTS OF THE 2018 RESIDENTIAL CODE OF OHIO



Schill
Architecture

THESE DRAWINGS, DESIGNS, AND SPECIFICATIONS ARE THE SOLE PROPERTY OF SCHILL ARCHITECTURE, LLC. STEPHEN M. SCHILL, ARCHITECT. THEY ARE TO BE USED ONLY WITH THIS PROJECT AND MAY NOT BE REPRODUCED OR ALTERED WITHOUT WRITTEN PERMISSION. THIS COPYRIGHT PROTECTION INCLUDES, BUT IS NOT LIMITED TO, THE OVERALL FORM, AS WELL AS THE ARRANGEMENT, COMPOSITION OF SPACES, AND ELEMENTS OF DESIGN.

© 2016 SCHILL ARCHITECTURE, LLC

SCHILL ARCHITECTURE, LLC

TELEPHONE: 440.808.3485
FACSIMILE: 440.808.3485
WWW.SCHILLARCHITECTURE.COM

OFFICE ADDRESS:
1650 CROSSINGS PARKWAY SUITE E
WESTLAKE, OHIO 44145

EMAIL ADDRESS:
STEVEN@SCHILLARCHITECTURE.COM

DESIGN LOADS

COMPONENT	LIVE LOAD	DEAD LOAD	TOTAL LOAD
ATTIC (WALK UP STORAGE)	30 P.S.F.	15 P.S.F.	45 P.S.F.
ATTIC (LIMITED STORAGE)	20 P.S.F.	15 P.S.F.	35 P.S.F.
ATTIC (NO STORAGE)	10 P.S.F.	15 P.S.F.	25 P.S.F.
DECKS	40 P.S.F.	15 P.S.F.	55 P.S.F.
EXTERIOR BALCONIES	60 P.S.F.	15 P.S.F.	75 P.S.F.
GUARDRAIL AND HANDRAILS	200 P.S.F.	15 P.S.F.	215 P.S.F.
GUARDRAIL INFILL COMPONENTS	50 P.S.F.	15 P.S.F.	65 P.S.F.
PASSENGER VEHICLE GARAGES	50 P.S.F.	15 P.S.F.	65 P.S.F.
ROOMS OTHER THAN SLEEPING ROOMS	40 P.S.F.	15 P.S.F.	55 P.S.F.
SLEEPING ROOMS	30 P.S.F.	15 P.S.F.	45 P.S.F.
STAIRS	40 P.S.F.	15 P.S.F.	55 P.S.F.
ROOFS	25 P.S.F.	15 P.S.F.	40 P.S.F.
SNOW	25 P.S.F.	N.A.	25 P.S.F.
WIND	15 M.P.H.	N.A.	15 M.P.H.
SOIL BEARING	2000 P.S.F.	N.A.	2000 P.S.F.

NOTES:
1. ASSUMED SOIL BEARING CAPACITY IS 2000 P.S.F. A GEOTECHNICAL ENGINEER SHALL BE RETAINED AND THE ARCHITECT SHALL BE NOTIFIED AT ONCE IF UNUSUAL OR UNSTABLE SOIL CONDITIONS EXIST.
2. NOTIFY ARCHITECT IF STONE OR TILE FLOORING IS TO BE USED.
3. NOTIFY ARCHITECT IF ROOFING MATERIAL IS OTHER THAN ASPHALT SHINGLE.

SPACE	MATERIAL	HEIGHT
LOWER LEVEL	WOOD-2"x4"/2"x4"	N.A.
MAIN FLOOR	WOOD-2"x4"/2"x4"	N.A.
UPPER FLOOR	WOOD-2"x4"/2"x4"	8' 0"

AREA	SIZE
UNFINISHED LOWER LEVEL	0,000 SQ.FT.
FINISHED LOWER LEVEL	0,000 SQ.FT.
MAIN LEVEL	0,000 SQ.FT.
UPPER LEVEL	0,000 SQ.FT.
UPPER LEVEL(VOLUME SPACE)	0,000 SQ.FT.
THIRD FLOOR	646 SQ.FT.
TOTAL HEATED AREA	646 SQ.FT.
GARAGE	0,000 SQ.FT.
ARRIVAL PORCH	0,000 SQ.FT.
FRIENDS/ FAMILY PORCH	0,000 SQ.FT.
MAIN LEVEL COVERED FRONT PORCH	0,000 SQ.FT.
LOWER LEVEL COVERED REAR PORCH	0,000 SQ.FT.
TOTAL AREA UNDER ROOF	646 SQ.FT.
REAR PORCH (NOT COVERED)	0,000 SQ.FT.
TOTAL PROJECT AREA	646 SQ.FT.

AREA CALCULATIONS ARE MADE FROM THE OUTSIDE FACE OF EXTERIOR WALLS, STAIRWELLS AND FIREPLACE AREAS ARE INCLUDED ONCE. GARAGES, OPEN SPACES, DECKS, PATIOS, AND EXTERIOR PORCHES ARE NOT INCLUDED IN THESE FIGURES. THEY ARE SUMMARIZED AS ADDITIONAL AREAS IN THIS TABLE.

1	ISSUED FOR PERMIT AND BIDDING	15 SEPT 2026
2	ISSUED FOR PERMIT AND BIDDING	15 AUG 2026

REV. NO.	DESCRIPTION	DATE
----------	-------------	------

PROJECT:
**THIRD FLOOR CONVERSION TO:
A PRIVATE RESIDENCE:**

LOCATION: 20381 MOREWOOD PARKWAY
ROCKY RIVER, OHIO 44116
CUYAHOGA COUNTY
PERMANENT PARCEL NUMBER: 301-13-123


DETAILS

SCALE: AS NOTED	JOB NUMBER: 26EKCEOG
--------------------	-------------------------

DATE: 1 JULY 2026	CAD FILE NAME: C:\DRAWINGS\CENTRAL\ARCHIVE\ SCHILL\26EKCEOG\CONCEPT.CAD
----------------------	--

A-3

DRAWING NUMBER



Schill
Architecture

SCHILL ARCHITECTURE, LLC
TELEPHONE: 440.808.3483
FACSIMILE: 440.808.3485
WWW.SCHILLARCHITECTURE.COM

OFFICE ADDRESS:
1650 CROSSINGS PARKWAY SUITE E
WESTLAKE, OHIO 44145

DESIGN LOADS

COMPONENT	LIVE LOAD	DEAD LOAD	TOTAL LOAD
ATTIC (WALK UP STORAGE)	30 P.S.F.	15 P.S.F.	45 P.S.F.
ATTIC (LIMITED STORAGE)	20 P.S.F.	15 P.S.F.	35 P.S.F.
ATTIC (NO STORAGE)	10 P.S.F.	15 P.S.F.	25 P.S.F.
DECKS	40 P.S.F.	15 P.S.F.	55 P.S.F.
EXTERIOR BALCONIES	60 P.S.F.	15 P.S.F.	75 P.S.F.
GUARDRAIL AND HANDRAILS	200 P.S.F.	15 P.S.F.	215 P.S.F.
GUARDRAIL INFILL COMPONENTS	50 P.S.F.	15 P.S.F.	65 P.S.F.
PASSENGER VEHICLE GARAGES	50 P.S.F.	15 P.S.F.	65 P.S.F.
ROOMS (OTHER THAN SLEEPING ROOMS)	40 P.S.F.	15 P.S.F.	55 P.S.F.
SLEEPING ROOMS	30 P.S.F.	15 P.S.F.	45 P.S.F.
STAIRS	40 P.S.F.	15 P.S.F.	55 P.S.F.
ROOFS	25 P.S.F.	15 P.S.F.	40 P.S.F.
SNOW	25 P.S.F.	N.A.	25 P.S.F.
WIND	15 M.P.H.	N.A.	15 M.P.H.
SOIL BEARING	2000 P.S.F.	N.A.	2000 P.S.F.

NOTES:
1. ASSUMED SOIL BEARING CAPACITY IS 2000 P.S.F. A GEOTECHNICAL ENGINEER SHALL BE RETAINED AND THE ARCHITECT SHALL BE NOTIFIED AT ONCE IF UNUSUAL OR UNSTABLE SOIL CONDITIONS EXIST.
2. NOTIFY ARCHITECT IF STONE OR TILE FLOORING IS TO BE USED.
3. NOTIFY ARCHITECT IF ROOFING MATERIAL IS OTHER THAN ASPHALT SHINGLE.

SPACE	MATERIAL	HEIGHT
LOWER LEVEL	WOOD-2"x4"x12"x4"	N.A.
MAIN FLOOR	WOOD-2"x4"x12"x4"	N.A.
UPPER FLOOR	WOOD-2"x4"x12"x4"	8' 0"

AREA	SIZE
UNFINISHED LOWER LEVEL	0,000 SQ.FT.
FINISHED LOWER LEVEL	0,000 SQ.FT.
MAIN LEVEL	0,000 SQ.FT.
UPPER LEVEL	0,000 SQ.FT.
UPPER LEVEL(VOLUME SPACE)	0,000 SQ.FT.
THIRD FLOOR	646 SQ.FT.
TOTAL HEATED AREA	646 SQ.FT.
GARAGE	0,000 SQ.FT.
ARRIVAL PORCH	0,000 SQ.FT.
FRIENDS/ FAMILY PORCH	0,000 SQ.FT.
MAIN LEVEL COVERED FRONT PORCH	0,000 SQ.FT.
LOWER LEVEL COVERED REAR PORCH	0,000 SQ.FT.
TOTAL AREA UNDER ROOF	646 SQ.FT.
REAR PORCH (NOT COVERED)	0,000 SQ.FT.
TOTAL PROJECT AREA	646 SQ.FT.

AREA CALCULATIONS ARE MADE FROM THE OUTSIDE FACE OF EXTERIOR WALLS. STAIRWELLS AND FIREPLACE AREAS ARE INCLUDED ONCE GARAGES, OPEN SPACES, DECKS, PATIOS, AND EXTERIOR PORCHES ARE NOT INCLUDED IN THESE FIGURES. THEY ARE SUMMARIZED AS ADDITIONAL AREAS IN THIS TABLE.

ISSUED FOR PERMIT AND BIDDING	15 SEPT 2026
ISSUED FOR PERMIT AND BIDDING	15 AUG 2026


REV. NO.	DESCRIPTION	DATE
----------	-------------	------

PROJECT:
**THIRD FLOOR CONVERSION TO:
A PRIVATE RESIDENCE:**


LOCATION20981 MOREWOOD PARKWAY
ROCKY RIVER, OHIO 44116
CUYAHOGA COUNTY
PERMANENT PARCEL NUMBER: 30113-123

DETAILS


SCALE: AS NOTED	JOB NUMBER: 26EKCEOG
DATE: 1 JULY 2026	CAD FILE NAME: C:\DRAWINGS\CENTRAL\ARCHIVE\ SCHILL\26EKCEOG\CONCEPT.CAD
STEPHEN M. SCHILL REGISTERED ARCHITECT 8877	
STEPHEN M. SCHILL, LICENSE # 8871 EXPIRATION DATE: 03/31/2021	
DRAWING NUMBER A-4	

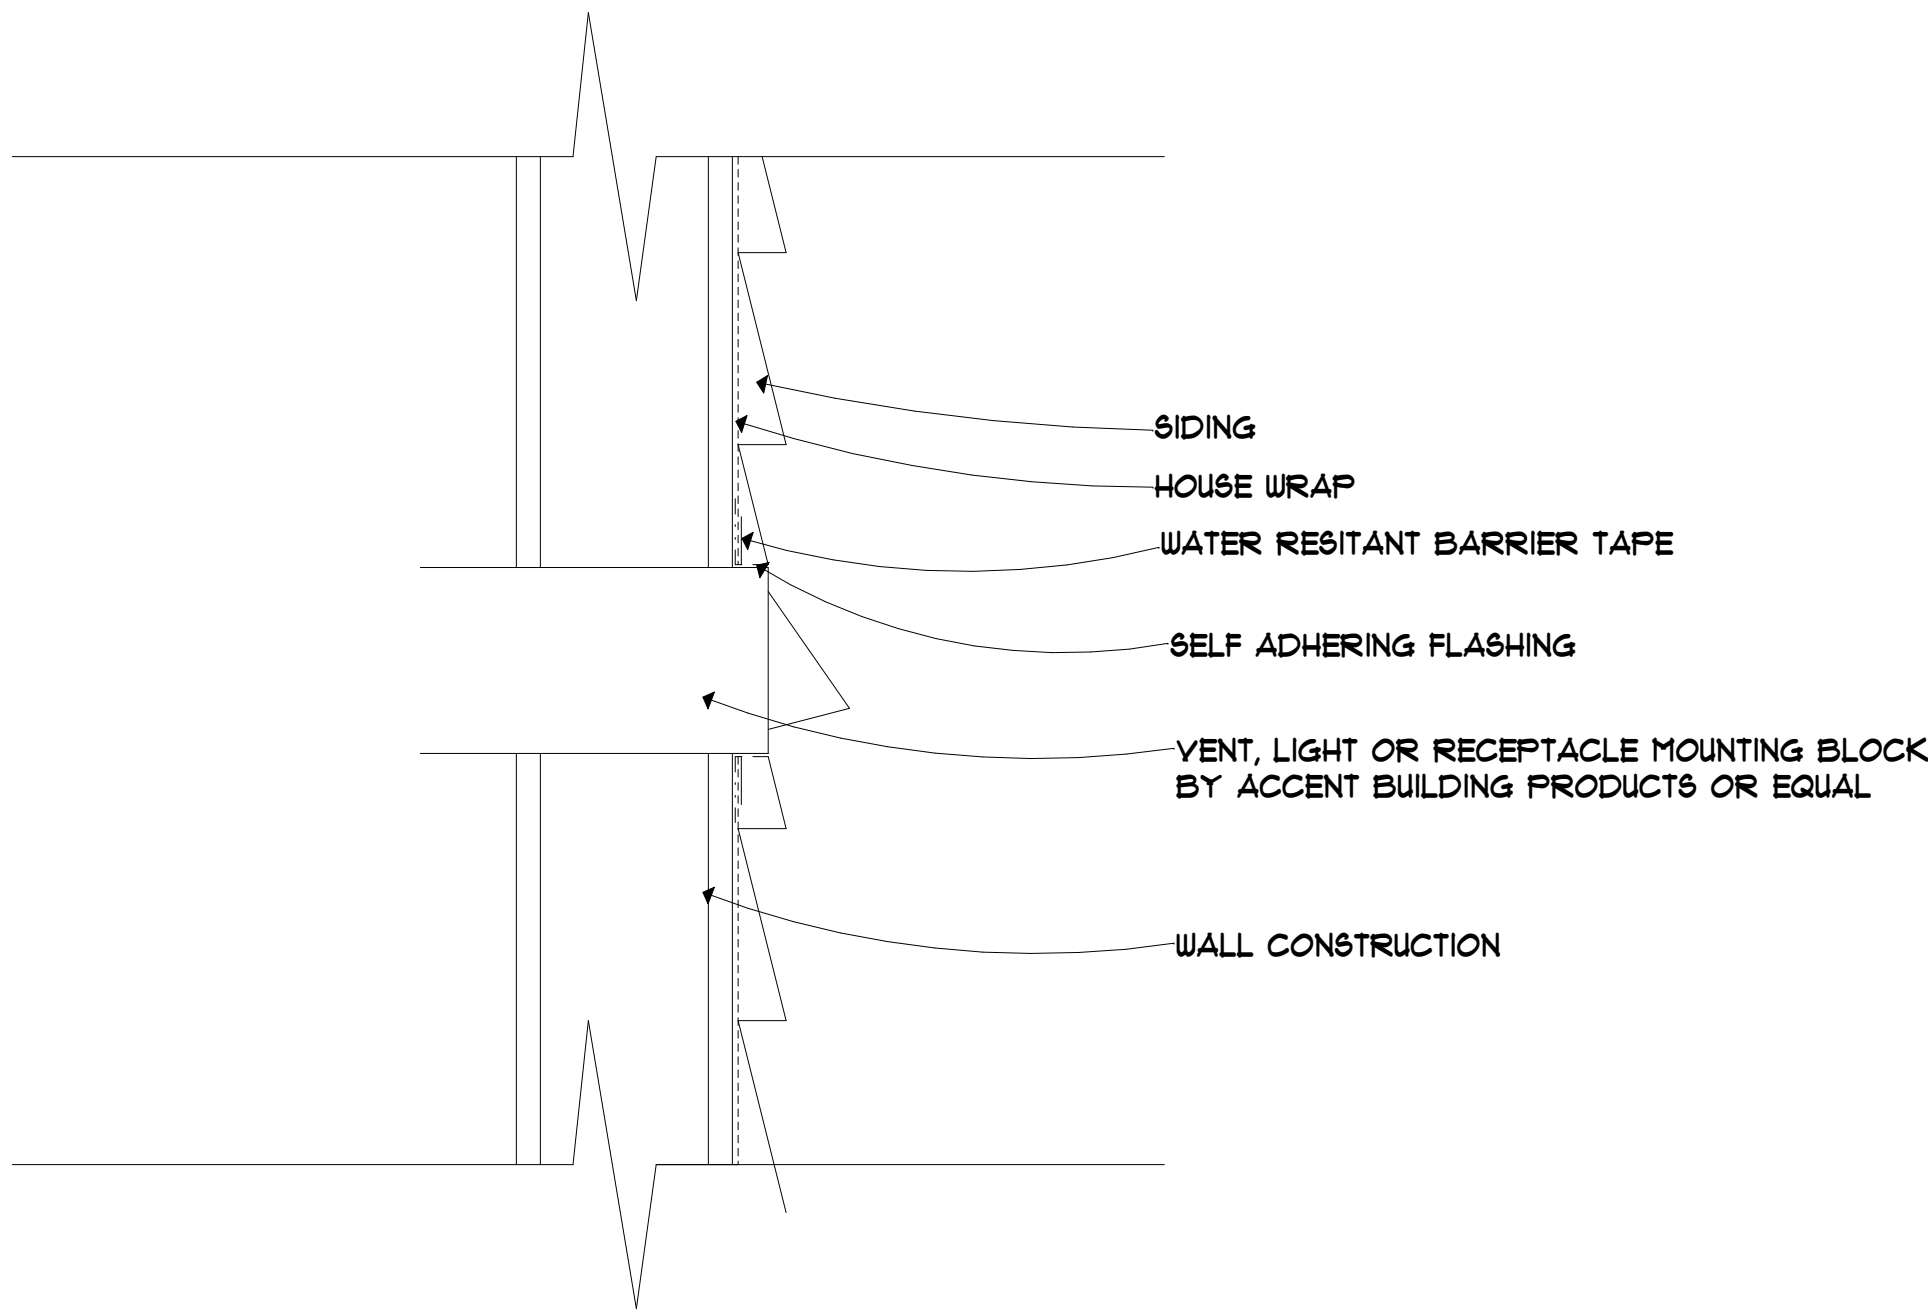


DETAIL
SCALE: 3" = 1' 0"

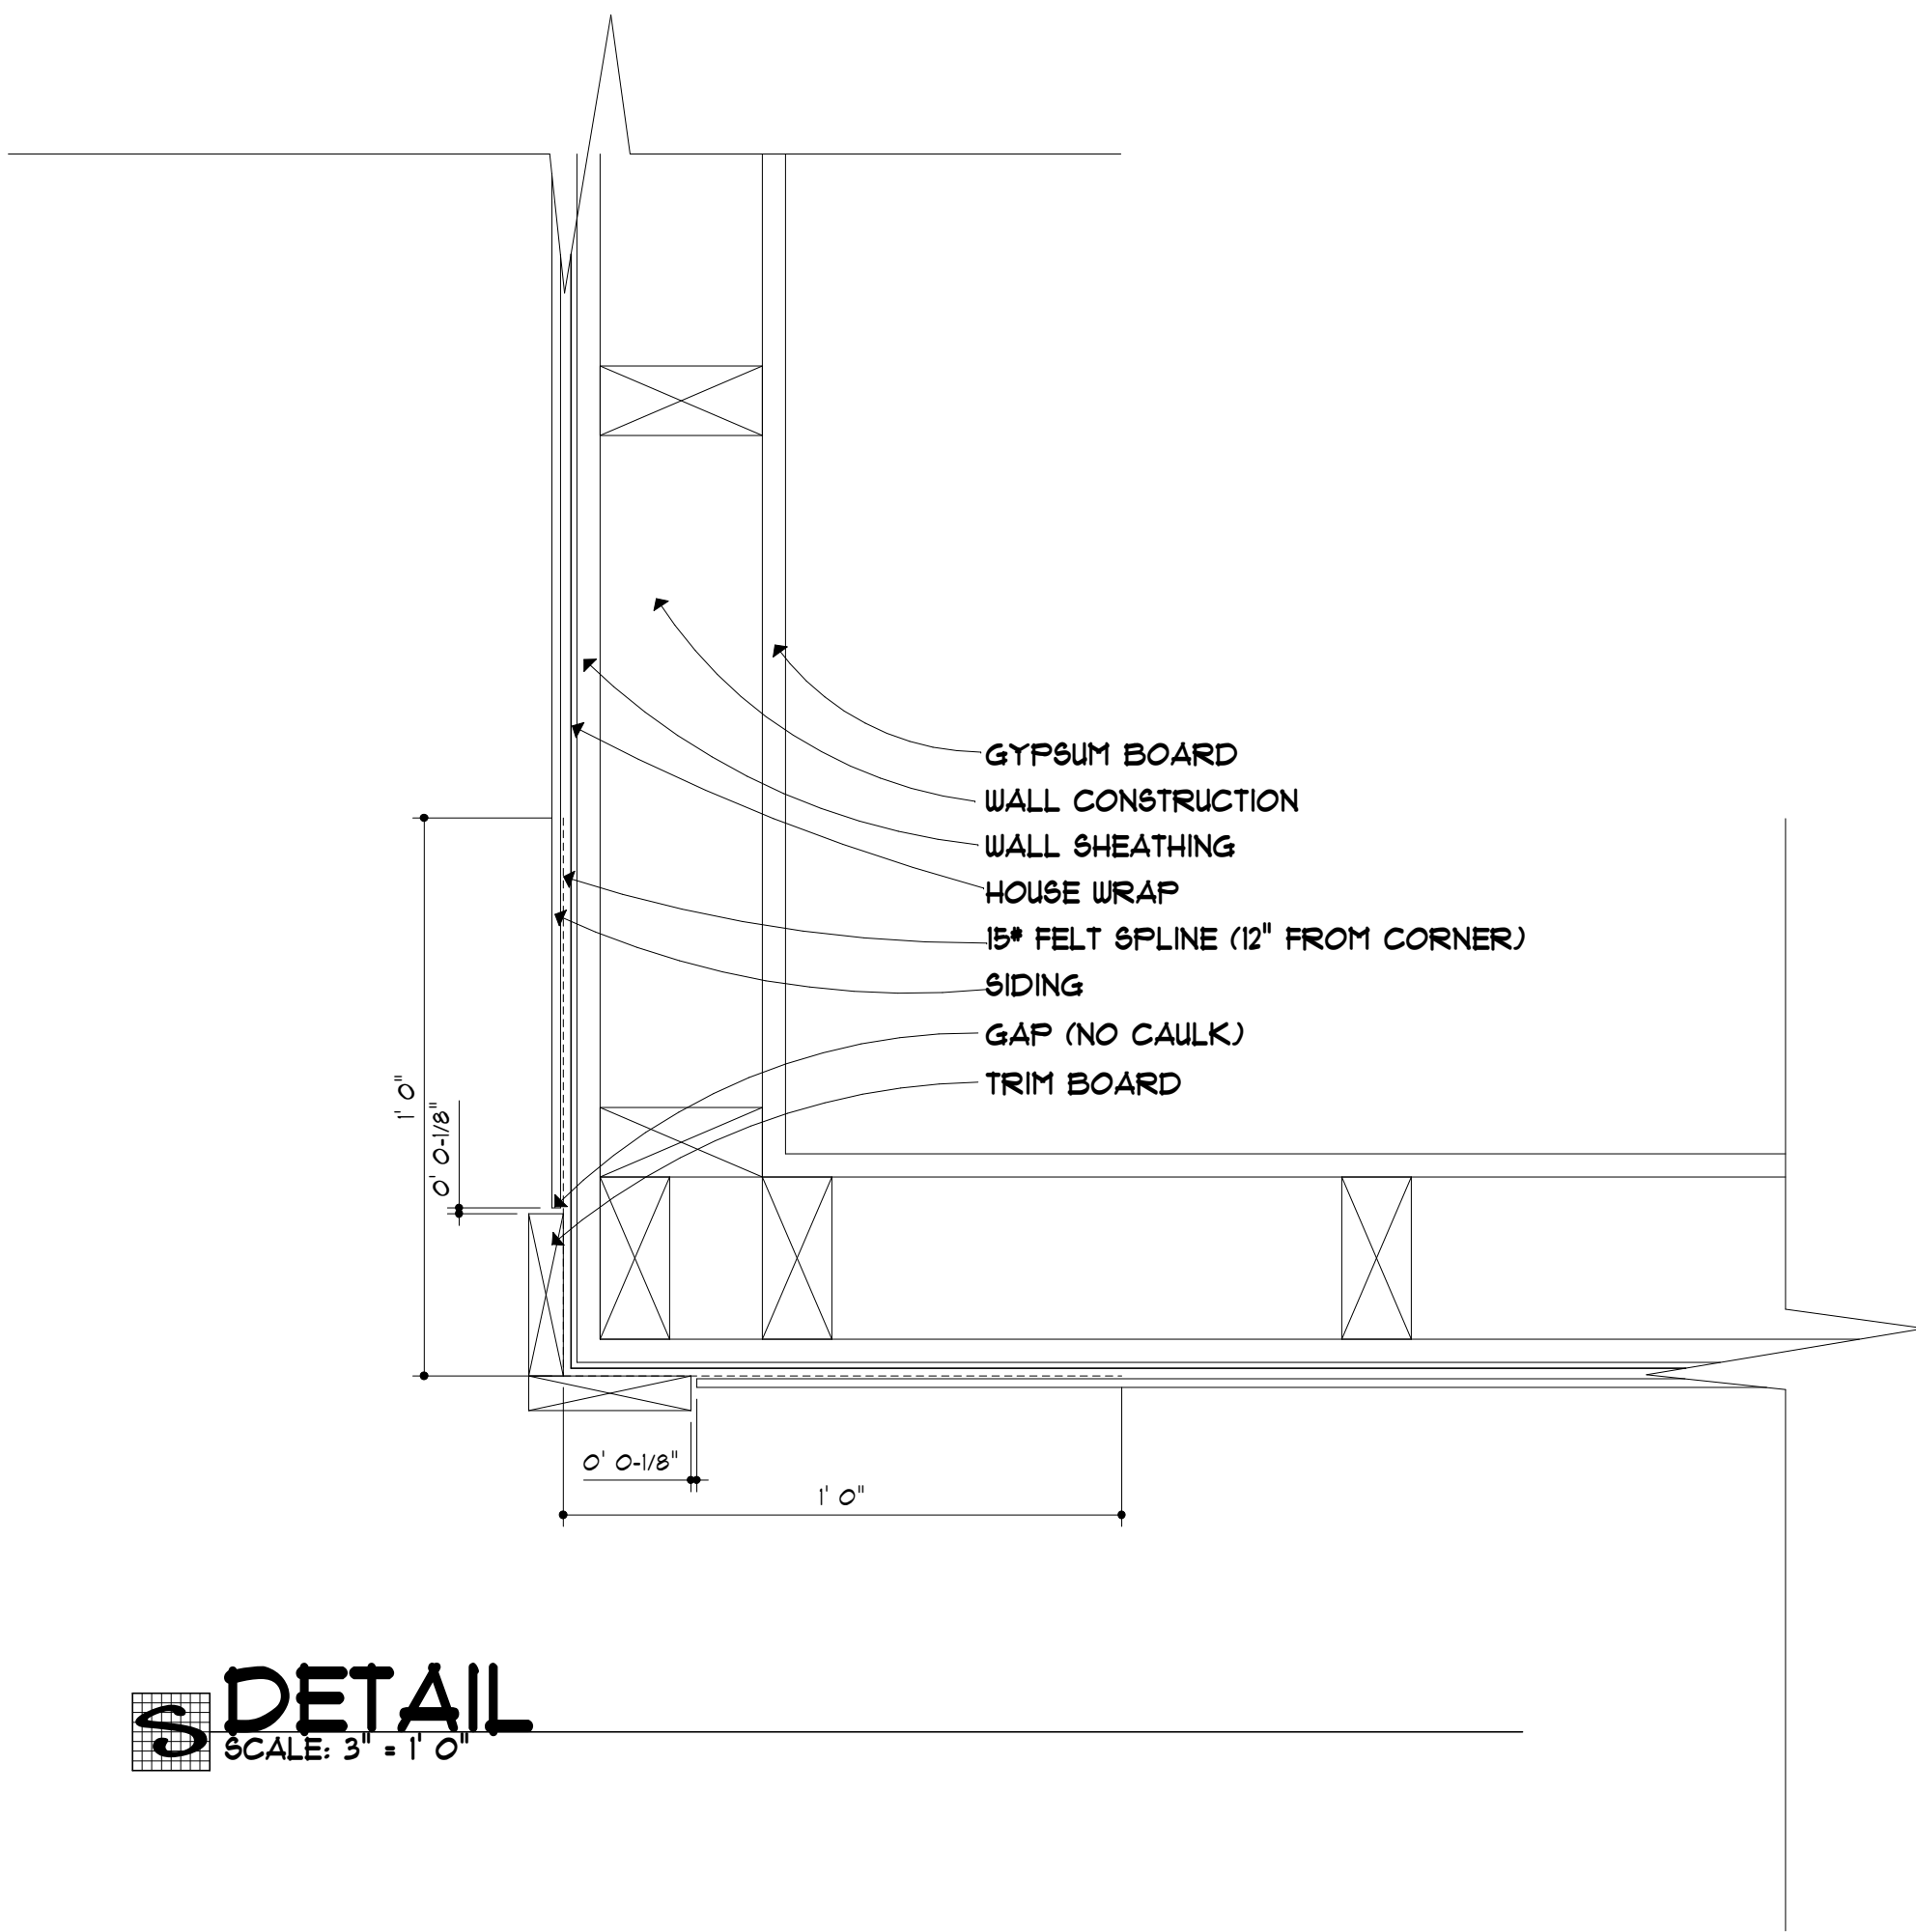

DETAIL
SCALE: 3" = 1' 0"

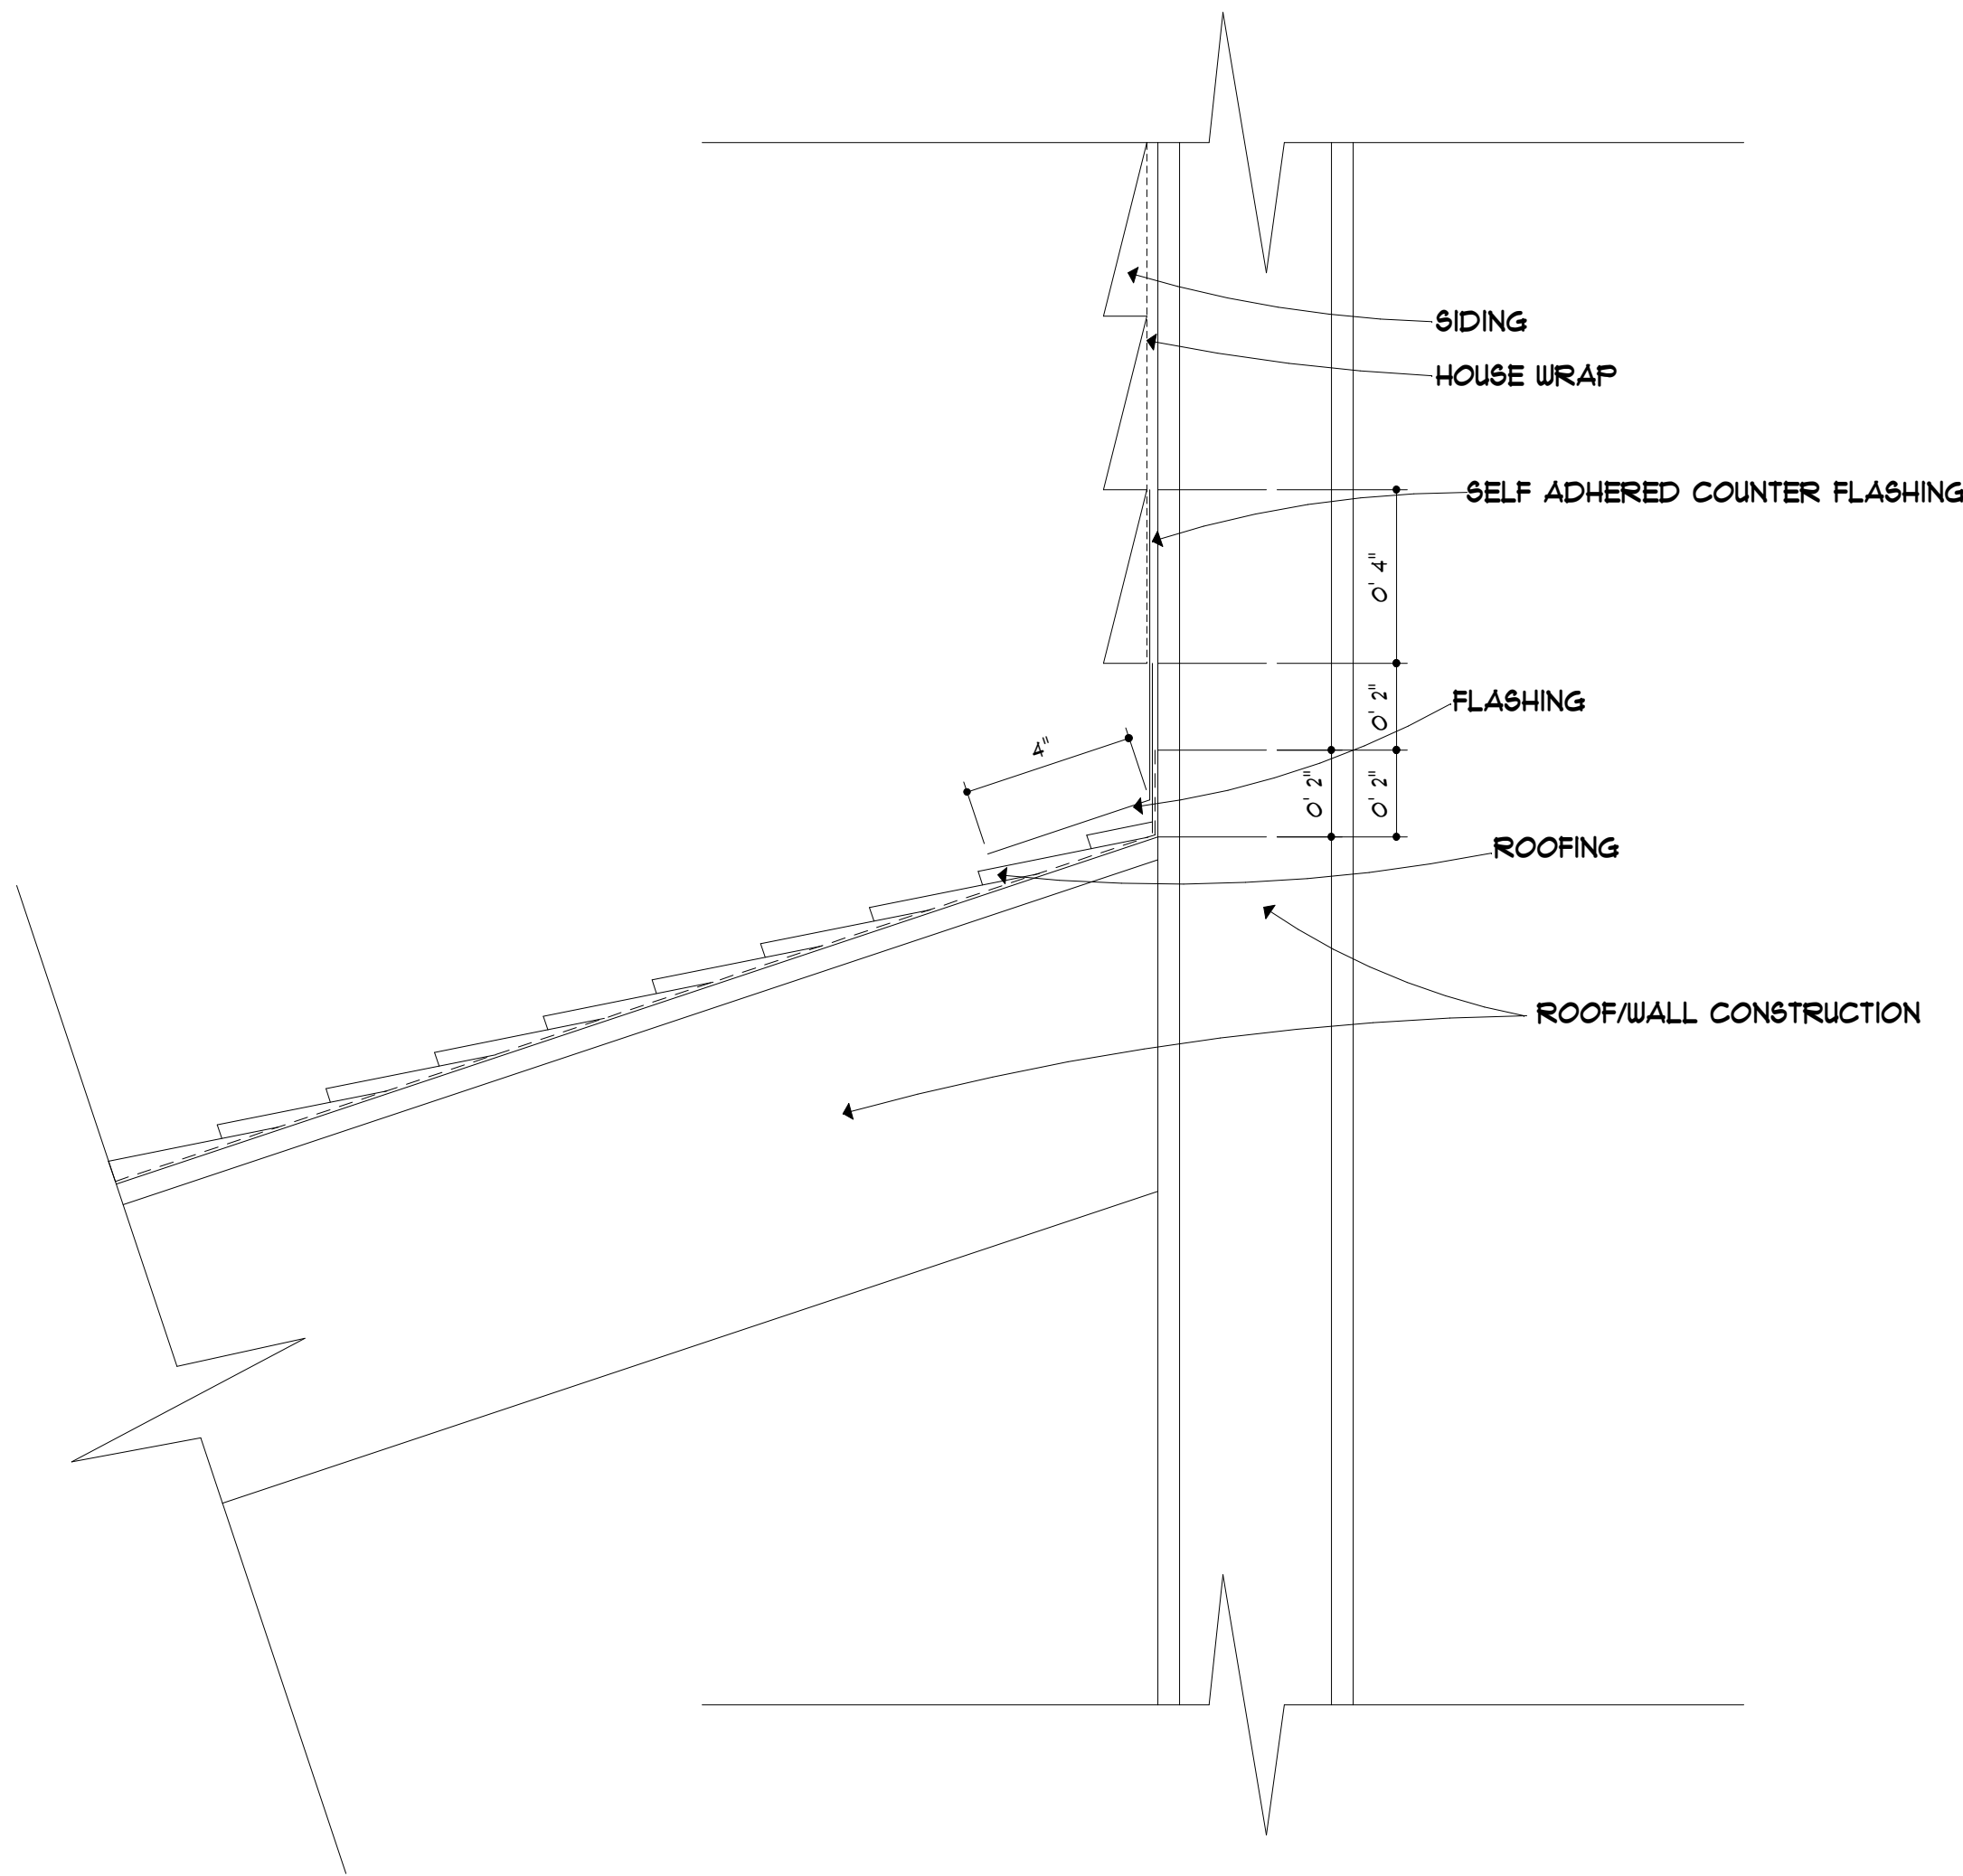


DETAIL
SCALE: 3" = 1' 0"

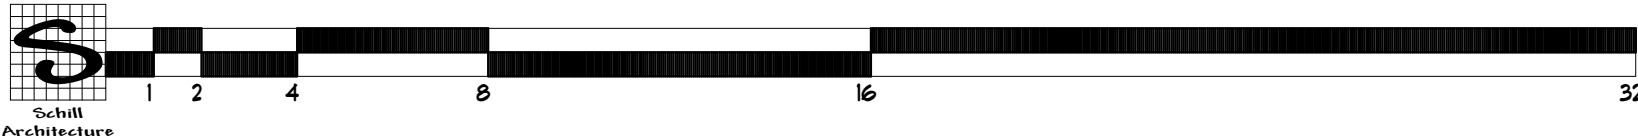

GRAPHIC SCALE

DETAIL
SCALE: NONE

ALL CONSTRUCTION SHALL COMPLY
WITH THE REQUIREMENTS OF THE 2018
RESIDENTIAL CODE OF OHIO

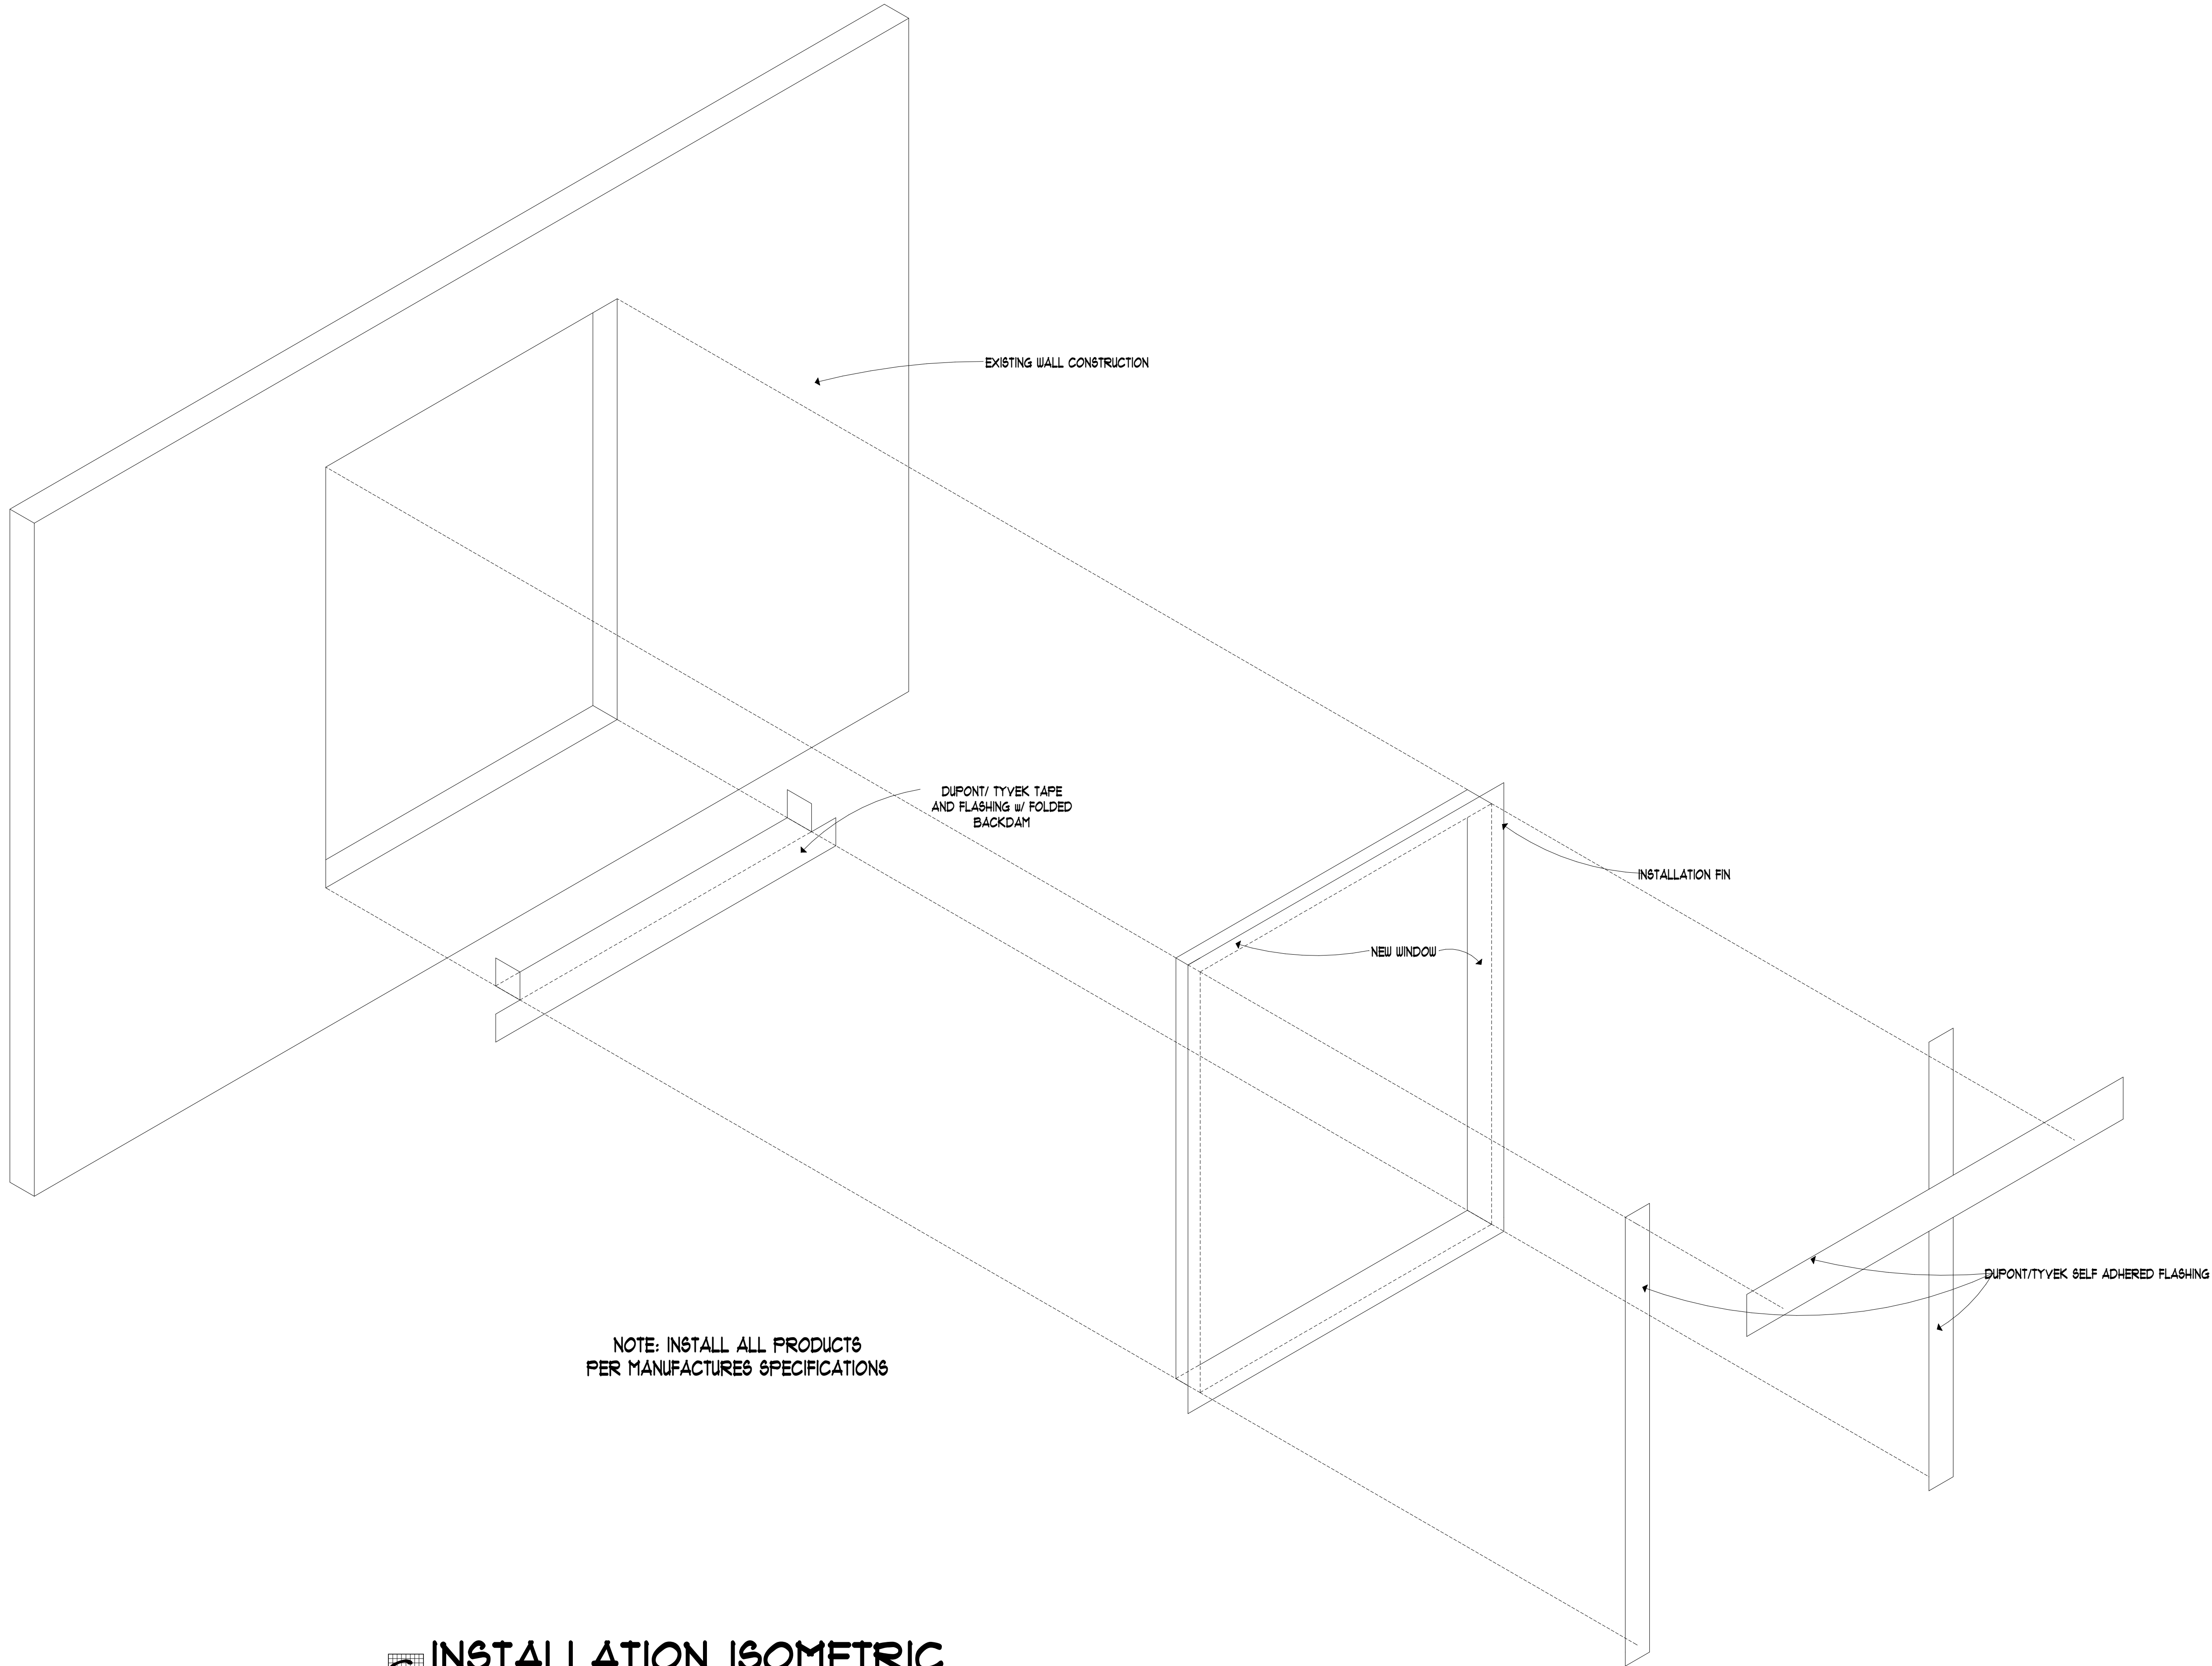

S INSTALLATION ISOMETRIC

SCALE: NONE

S DETAIL

SCALE: NONE

ALL CONSTRUCTION SHALL COMPLY WITH THE REQUIREMENTS OF THE 2019 RESIDENTIAL CODE OF OHIO

S

Schill
Architecture

THESE DRAWINGS, DESIGNS, AND SPECIFICATIONS ARE THE SOLE PROPERTY OF SCHILL ARCHITECTURE, LLC. © STEPHEN M. SCHILL, ARCHITECT. THEY ARE TO BE USED ONLY WITH THIS PROJECT AND MAY NOT BE REPRODUCED OR ALTERED WITHOUT WRITTEN PERMISSION. THIS COPYRIGHT PROTECTION INCLUDES, BUT IS NOT LIMITED TO, THE OVERALL FORM, AS WELL AS THE ARRANGEMENT, COMPOSITION OF SPACES, & ELEMENTS OF DESIGN.

© 2026 SCHILL ARCHITECTURE, LLC

SCHILL ARCHITECTURE, LLC

TELEPHONE: 440.808.3485
FACSIMILE: 440.808.3485
WWW.SCHILLARCHITECTURE.COM

OFFICE ADDRESS:
1650 CROSSINGS PARKWAY SUITE E
WESTLAKE, OHIO 44145

EMAIL ADDRESS:
STEVEN@SCHILLARCHITECTURE.COM

DESIGN LOADS

COMPONENT	LIVE LOAD	DEAD LOAD	TOTAL LOAD
ATTIC (WALK UP STORAGE)	30 P.S.F.	15 P.S.F.	45 P.S.F.
ATTIC (LIMITED STORAGE)	20 P.S.F.	15 P.S.F.	35 P.S.F.
ATTIC (NO STORAGE)	10 P.S.F.	15 P.S.F.	25 P.S.F.
DECKS	40 P.S.F.	15 P.S.F.	55 P.S.F.
EXTERIOR BALCONIES	60 P.S.F.	15 P.S.F.	75 P.S.F.
GUARDRAIL AND HANDRAILS	200 P.S.F.	15 P.S.F.	215 P.S.F.
GUARDRAIL INFILL COMPONENTS	50 P.S.F.	15 P.S.F.	65 P.S.F.
PASSENGER VEHICLE GARAGES	50 P.S.F.	15 P.S.F.	65 P.S.F.
ROOMS (OTHER THAN SLEEPING ROOMS)	40 P.S.F.	15 P.S.F.	55 P.S.F.
SLEEPING ROOMS	30 P.S.F.	15 P.S.F.	45 P.S.F.
STAIRS	40 P.S.F.	15 P.S.F.	55 P.S.F.
ROOFS	25 P.S.F.	15 P.S.F.	40 P.S.F.
SNOW	25 P.S.F.	N.A.	25 P.S.F.
WIND	115 M.P.H.	N.A.	115 M.P.H.
SOIL BEARING	3000 P.S.F.	N.A.	3000 P.S.F.

NOTES:
1. ASSUMED SOIL BEARING CAPACITY IS 3000 P.S.F. A GEOTECHNICAL ENGINEER SHALL BE RETAINED AND THE ARCHITECT SHALL BE NOTIFIED AT ONCE IF UNUSUAL OR UNSTABLE SOIL CONDITIONS EXIST.
2. NOTIFY ARCHITECT IF STONE OR TILE FLOORING IS TO BE USED.
3. NOTIFY ARCHITECT IF ROOFING MATERIAL IS OTHER THAN ASPHALT SHINGLE.

S

MATERIAL SUMMARY

S

SPACE	MATERIAL	HEIGHT
MAIN FLOOR	WOOD-2"x4"/2"x4"	N.A.
UPPER FLOOR	WOOD-2"x4"/2"x4"	N.A.
THIRD FLOOR	WOOD-2"x4"/2"x4"	8' 0"

S

AREA SUMMARY

S

AREA	SIZE
UNFINISHED LOWER LEVEL	0,000 SQ.FT.
FINISHED LOWER LEVEL	0,000 SQ.FT.
MAIN LEVEL	0,000 SQ.FT.
UPPER LEVEL	0,000 SQ.FT.
UPPER LEVEL(VOLUME SPACE)	0,000 SQ.FT.
THIRD FLOOR	646 SQ.FT.
TOTAL HEATED AREA	646 SQ.FT.
GARAGE	0,000 SQ.FT.
ARRIVAL PORCH	0,000 SQ.FT.
FRIENDS/ FAMILY PORCH	0,000 SQ.FT.
MAIN LEVEL COVERED FRONT PORCH	0,000 SQ.FT.
LOWER LEVEL COVERED REAR PORCH	0,000 SQ.FT.
TOTAL AREA UNDER ROOF	646 SQ.FT.
REAR PORCH (NOT COVERED)	0,000 SQ.FT.
TOTAL PROJECT AREA	646 SQ.FT.

AREA CALCULATIONS ARE MADE FROM THE OUTSIDE FACE OF EXTERIOR WALLS, STAIRWELLS AND FIREPLACE AREAS ARE INCLUDED ONCE, GARAGES, OPEN SPACES, DECKS, PATIOS, AND EXTERIOR PORCHES ARE NOT INCLUDED IN THESE FIGURES. THEY ARE SUMMARIZED AS ADDITIONAL AREAS IN THIS TABLE.

1

ISSUED FOR PERMIT AND BIDDING

15 SEPT 2026

1

ISSUED FOR PERMIT AND BIDDING

15 AUG 2026

REV. NO.	DESCRIPTION	DATE
PROJECT:		
THIRD FLOOR CONVERSION TO: A PRIVATE RESIDENCE:		
LOCATION: 20381 MOREWOOD PARKWAY ROCKY RIVER, OHIO 44116 CUYAHOGA COUNTY PERMANENT PARCEL NUMBER: 301-13-123		

DETAILS

SCALE:
AS NOTED

JOB NUMBER:
26EKCEOG

STATE OF OHIO
REGISTERED ARCHITECT
STEPHEN M. SCHILL
18877

STEPHEN M. SCHILL, LICENSE # 8871
EXPIRATION DATE: 12/31/2021

DATE:
1 JULY 2026
CAD FILE NAME:
C:\DRAWINGS\CENTRAL\ARCHIVE\ SCHILL\KCEOG\CONCEPT.CAD

A-5

DRAWING NUMBER

FASTENING SCHEDULE FOR STRUCTURAL MEMBERS

ITEM	DESCRIPTION OF BUILDING ELEMENT	NUMBER AND TYPE OF FASTENERS a,b,c	SPACING OF FASTENERS
ROOF			
1	Blocking between joists or rafters to top plate, toe nail	3-8d (2½" x 0.113")	-----
2	Ceiling joists to plate, toe nail	3-8d (2½" x 0.113")	-----
3	Ceiling joists not attached to parallel rafter, lips over partitions, face nail	3-10d	-----
4	Ceiling tie rafter, face nail or 1¼"x 20 gauge ridge strap	3-10d (3" x 0.128")	-----
5	Rafter to plate, toe nail	2-16d (3½" x 0.135")	-----
6	Roof rafters to ridge, valley or hip rafters: toe nail face nail	4-16d (3½" x 0.135") 3-16d (3½" x 0.135")	-----

WALL			
1	Built-up corner studs	10d/3" x 0.128")	24" o.c.
8	Built-up header, two pieces with ½" spacer	16d (3½" x 0.135")	16" o.c. along each edge
9	Continued header, two pieces	16d (3½" x 0.135")	16" o.c. along each edge
10	Continuous header to stud, toe nail	4-8d (2½" x 0.113")	-----
11	Double studs, face nail	10d/3" x 0.128")	24" o.c.
12	Double top plates, face nail	10d/3" x 0.128")	24" o.c.
13	Double top plates, minimum 24-inch offset of end joints, face nail in lapped area	8-16d (3½" x 0.135")	24" o.c.

14	Sole plate to joist or blocking, face nail	16d (3½" x 0.135")	16" o.c.
15	Sole plate to joist or blocking at braced wall panels	3-16d (3½" x 0.135")	16" o.c.
16	Stud to sole plate, toe nail	3-8d (2½" x 0.113") or 2-16d (3½" x 0.135")	-----
17	Top or sole plate to stud, end nail	2-16d (3½" x 0.135")	-----
18	Top plates, lips at corners and intersections, face nail	2-10d (3" x 0.128")	-----
19	1" brace to each stud and plate, face nail	2-8d (2½" x 0.113") 2 staples 1½"	-----
20	1"x 8" sheathing to each bearing, face nail	2-8d (2½" x 0.113") 2 staples 1½"	-----
21	1"x 8" sheathing to each bearing, face nail	2-8d (2½" x 0.113") 3 staples 1½"	-----
22	Wider than 1"x 8" sheathing to each bearing, face nail	3-8d (2½" x 0.113") 4 staples 1½"	-----

FLOOR			
23	Joist to sill or girder, toe nail	3-8d (2½" x 0.113")	-----
24	1"x 6" subfloor or less to each joist, face nail	2-8d (2½" x 0.113") 3 staples 1½"	-----
25	2" subfloor to joist or girder, blind and face nail	2-16d (3½" x 0.135")	-----
26	Rite joist to top plate, toe nail (roof applications also)	8d (2½" x 0.113")	6" o.c.
27	2" planks (plank & beam - floor & roof)	2-16d (3½" x 0.135")	at each bearing
28	Built-up girders and beams, 2-inch lumber layers	10d (3" x 0.128")	Nail each layer as follows: 32" o.c. at top and bottom and staggered. Two nails at ends and at each splice.
29	Ledger strip supporting joists or rafters	3-16d (3½" x 0.135")	At each joist or rafter

WOOD STRUCTURAL PANELS, SUBFLOOR, ROOF AND INTERIOR WALL SHEATHING AND PARTICLEBOARD WALL SHEATHING TO FRAMING

ITEM	DESCRIPTION OF BUILDING MATERIALS	NUMBER AND TYPE OF FASTENERS b,c,e	SPACING OF FASTENERS
EDGE (INCHES)f INTERMEDIATE SUPPORTS g,h (INCHES)			
30	3/8"-1/4"	6d common (2" x 0.113") nail (subfloor wall) 8d common (2½" x 0.131") nail (roof)	6 12 g
31	19/32"-1"	8d common nail (2½" x 0.131")	6 12 g
32	1 1/8"-1¼"	10d common (3" x 0.148") nail or 8d (2½" x 0.131") deformed	6 12

OTHER WALL SHEATHING h

33	½" structural cellulose fiberboard sheathing	1½" galvanized roofing nail, 1/16" crown or 1" crown staple 16 ga., 1¼" long	3 6
34	25/32" structural cellulose fiberboard sheathing	1½" galvanized roofing nail, 1/16" crown or 1" crown staple 16 ga., 1¼" long	3 6
35	½" gypsum sheathing d	1½" galvanized roofing nail; staple galvanized, 1½" long; 1¼" screws, Type II or S	7 7
36	5/8" gypsum sheathing d	1½" galvanized roofing nail; staple galvanized, 1 5/8" long; 1 5/8" screws, Type II or S	7 7

WOOD STRUCTURAL PANELS, COMBINATION SUBFLOOR UNDERLAYMENT TO FRAMING

37	¾" and less	6d deformed (2" x 0.120") nail or 8d common (2½" x 0.131")	12
38	1/8"-1"	8d common (2½" x 0.131") nail or 8d deformed (2½" x 0.120")	12
39	1 1/8"-1¼"	10d common (3" x 0.148") nail or 8d deformed (2½" x 0.120")	12

For 8d: 1 inch = 25.4 mm, 1 mile per hour = 0.441 m/s, 1 ksi = 6.895 MPa.
a. All nails are smooth-common, box or deformed shanks except where otherwise stated. Nails used for framing and sheathing connections shall have minimum average bending yield strengths as shown: 80 ksi for shank diameter of 0.192 inch (20d common nail), 90 ksi for shank diameters larger than 0.142 inch but not larger than 0.171 inch, and 100 ksi for shank diameters of 0.142 inch or less.
b. Staples are 16 gauge wire and have a minimum 7/16-inch on diameter crown width.
c. Nails shall be spaced at not more than 6 inches on center at all supports where spans are 48 inches or greater.
d. Four-foot-by-8-foot or 4-foot-by-9-foot panels shall be applied vertically.
e. Spacing of fasteners not included in this table shall be based on Table 602.3(2).
f. For regions having basic wind speed of 100 mph or greater, 8d deformed (2½" x 0.120") nails shall be used for attaching plywood and wood structural panel roof sheathing to framing within minimum 48-inch distance from gables and walls, if mean roof height is more than 25 feet, up to 35 feet maximum.
g. For regions having basic wind speed of 100 mph or less, nails for attaching wood structural panel roof sheathing to gable and wall framing shall be spaced 6 inches on center, when basic wind speed is greater than 100 mph nails for attaching panel roof sheathing to intermediate supports shall be spaced 6 inches on center for minimum 48-inch distance from ridges, eaves and gable and walls, and 4 inches on center to gable and wall framing.
h. Gypsum sheathing shall conform to ASTM C 396 and shall be installed in accordance with GA 253. Fiberboard sheathing shall conform to ASTM C 208.
i. Spacing of fasteners on floor sheathing panel edges applies to panel edges supported by framing members and required blocking and at all floor perimeters only. Spacing of fasteners on roof sheathing panel edges applies to panel edges supported by framing members and required blocking. Blocking of roof or floor sheathing panel edges perpendicular to the framing members need not be provided except as required by other provisions of this code. Floor perimeter shall be supported by framing members or solid blocking.



GRAPHIC SCALE

ALTERNATE ATTACHMENTS

WOOD STRUCTURAL PANELS, SUBFLOOR, ROOF AND INTERIOR WALL SHEATHING AND PARTICLEBOARD WALL SHEATHING TO FRAMING

NOMINAL MATERIAL THICKNESS (INCHES)/DESCRIPTION a,b OF FASTENERS (INCHES)		SPACING c OF FASTENERS	
		EDGE (INCHES)f	INTERMEDIATE SUPPORTS (INCHES)
UP TO 1/2"	Staple 15 ga. 1½"	4	8
	0.091 - 0.099 Nail 2¼"	3	6
	Staple 16 ga. 1½"	3	6
	0.113 Nail 2	3	6
19/32 and 5/8"	Staple 15 and 16 ga. 2	4	8
	0.091 - 0.099 Nail 2¼"	4	8
	Staple 14 ga. 2	4	8
	Staple 15 ga. 1½"	3	6
23/32 and ¾"	0.091 - 0.099 Nail 2¼"	4	8
	Staple 16 ga. 2	4	8
	Staple 14 ga. 2	4	8
	0.113 Nail 2¼"	3	6
1	Staple 15 ga. 2¼"	4	8
	0.091 - 0.099 Nail 2¼"	4	8
	Staple 15 ga. 1½"	3	6
	0.091 - 0.099 Nail 2¼"	4	8

FLOOR UNDERLAYMENT: PLYWOOD-HARDWOOD-PARTICLEBOARD f

NOMINAL MATERIAL THICKNESS (INCHES)/DESCRIPTION a,b OF FASTENERS (INCHES)		SPACING c OF FASTENERS	
		EDGE (INCHES)f	INTERMEDIATE SUPPORTS (INCHES)
PLYWOOD			
¾ and 5/8"	¼ ring or screw shank nail-minimum 12½ ga. (0.099") shank diameter	3	6
	Staple 18 ga, 1/8, 3/16 crown width	2	5
19/32, 3/8, 5/32, and 1/2"	¼ ring or screw shank nail-minimum 12½ ga. (0.099") shank diameter	6	8e
	¼ ring or screw shank nail-minimum 12½ ga. (0.099") shank diameter	6	8
19/32, 1/8, 30/32 and 3/4"	¼ ring or screw shank nail-minimum 12½ ga. (0.099") shank diameter	6	8
	Staple 16 ga. 1½	6	8

HARDBOARD f			
0.200	1½ long ring-grooved underlayment nail	6	6
	4d cement-coated sinker nail	6	6
	Staple 18 ga, 1/8 long (plastic coated)	3	6

PARTICLEBOARD			
¾	4d ring-grooved underlayment nail	3	6
	Staple 18 ga, 1/8 long, 3/16" crown	3	6
3/8	6d ring-grooved underlayment nail	6	10
	Staple 16 ga., 1/8 long, 3/8 crown	3	6
½, 5/8	6d ring-grooved underlayment nail	6	10
	Staple 16 ga., 1 5/8 long, 3/8 crown	3	6

For 8d: 1 inch = 25.4 mm.
a. Nail is a general description and may be T-head, modified round head or round head.
b. Staples shall have a minimum crown width of 5/8-inch on diameter except as noted.
c. Nails or staples shall be spaced at not more than 6 inches on center at all supports where spans are 48 inches or greater. Nails or staples shall be spaced at not more than 12 inches on center at intermediate supports for floors.
d. Fasteners shall be placed in a grid pattern throughout the body of the panel.
e. For 5-ply panels, intermediate nails shall be spaced not more than 12 inches on center each way.
f. Hardboard underlayment shall conform to CPA/ANSI A 135.4.

REQUIREMENTS FOR WOOD STRUCTURAL PANEL WALL SHEATHING USED TO RESIST WIND PRESSURES a,b,c

MINIMUM NAIL		MINIMUM WOOD STRUCTURAL PANEL SPAN RATINGS	MINIMUM NOMINAL PANEL THICKNESS (inches)	MAXIMUM WALL STUD SPACING (inches)	PANEL NAIL SPACING		MAXIMUM WIND SPEED (mph)		
SIZE	PENETRATION (INCHES)				Edges (Inches o.c.)	Field (Inches o.c.)	Wind exposure category		
6d Common (2.0" x 0.13")	1.5	24/0	3/8	16	6	12	B	C	D
8d Common (2.5" x 0.13")	1.75	24/6	1/16	16	6	12	130	110	105
				24	6	12	110	90	85

For 8d: 1 inch = 25.4 mm, 1 mile per hour = 0.441 m/s.
a. Panel strength axis parallel or perpendicular to supports. Three-ply plywood sheathing with studs spaced more than 16 inches on center shall be applied with panel strength axis perpendicular to supports.
b. Table is based on wind pressures acting toward and away from building surfaces per Section 301.2. Lateral bracing requirements shall be in accordance with Section 602.10.
c. Wood Structural Panels with span ratings of Wall-16 or Wall-24 shall be permitted as an alternate to panels with a 24/0 span rating. Plywood siding rated 16 oc or 24 oc shall be permitted as an alternate to panels with a 24/6 span rating. Wall-16 and Plywood siding 16 oc shall be used with studs spaced a maximum of 16 inches on center.


2019 RESIDENTIAL CODE OF OHIO COMPLIANCE PATH OPTIONS

CLIMATE ZONE 5- SELECT ONE OPTION

DESCRIPTION	OPTION 1 2009 IECC	OPTION 2 RCO 110/1004	OPTIONS RCO 105 (OHBA)	
			OPTION 3A OHBA PATH 1	OPTION 3B OHBA PATH 2
MINIMUM FENESTRATION U-FACTOR (ALL GLAZED FENESTRATION EXCEPT SKYLIGHTS)	0.35	0.35	0.32	0.32
SKYLIGHT FENESTRATION U-FACTOR	0.60	0.60	0.60	0.60
CEILING R-VALUE	R-38	R-38	R-43	R-43
WOOD FRAMED WALL R-VALUE	20 OR 13+ *	20 OR 13+ *	15 OR 13+ *	13
MASS WALL R-VALUE (ABOVE GRADE WALLS OF CONCRETE BLOCK, ICF, SOLID TIMBER LOGS, ETC.)	13/11	13/11	13/11	13/11
FRAMED FLOOR R-VALUE	30 **	30 **	30 **	30 **
BASEMENT WALL R-VALUE	10/13 ** (FULL)	10/13 ** (FULL)	10/13 ** (MIN. 4 FT.)	10/13 ** (MIN. 4 FT.)
SLAB R-VALUE (A)	R-10 # 2 FT.	R-10 # 2 FT.	R-10 # 2 FT.	R-10 # 2 FT.
CRAWL SPACE WALL R-VALUE	10/13 **	10/13 **	10/13 **	10/13 **
BLOWER DOOR TEST	YES (B)	YES (B)	YES (D)	YES (D)
DUCTS MUST BE TESTED FOR FOR TIGHTNESS (IECC 403.2.2)	YES (C)	YES (C)	YES (C) (D)	YES (C) (D)
SUPPLY DUCTS IN ATTICS SHALL BE INSULATED TO A MINIMUM OF (E)	R-8	R-8	R-8	R-8
ALL OTHER DUCTS (OUTSIDE THE BUILDING ENVELOPE) SHALL BE SEALED AND INSULATED TO A MINIMUM OF (E)	R-6	R-6	R-6	R-6
AIR SEALING (IECC 402.4) OF PLATES, WALLS, WOODS, DOORS, UTILITY PENETRATIONS, ATTIC ACCESS, RECESSED	YES	YES	YES	YES
WOOD BURNING FIREPLACES SHALL HAVE GASKETED DOORS AND OUTDOOR COMBUSTION AIR (F)	YES	YES	YES	YES
ACCESS DOORS FROM CONDITIONED SPACES TO UNCONDITIONED SPACE SHALL BE WEATHERSTRIPPED	YES	YES	YES	YES
CIRCULATING HOT WATER SYSTEMS PIPING SHALL BE INSULATED TO AT LEAST R- (PER SECTION 1103.4)	R-2 (ALL)	R-2 (ALL)	R-2 (FIRST 5 FT.)	R-2 (FIRST 5 FT.)
MECHANICAL SYSTEM PIPING (ABOVE 105 F OR BELOW 55 F MUST BE INSULATED TO A MINIMUM OF	R-3	R-3	R-3	R-3
MINIMUM PERCENTAGE OF HIGH EFFICIENCY LIGHT FIXTURES	50%	50%	75%	75%
PROGRAMMABLE THERMOSTAT REQUIRED	YES	YES	YES	YES
PERMANENT CERTIFICATE SHALL BE POSTED ON THE ELECTRICAL PANEL	YES	YES	YES	YES
FURNACE EFFICIENCY RATING	EQUIPMENT SIZING SHALL MEET SECTION M1401.0 OF THE IRC			
AIR CONDITIONING SEER RATING				

NOTES:
* 13+ MEANS R-13 CAVITY INSULATION PLUS R-5 INSULATED SHEATHING (LIKEWISE FOR 13+3)
** OR INSULATION SUFFICIENT TO FILL THE FRAMING CAVITY
*** 10/13 MEANS R-10 CONTINUOUS INSULATION (ON THE INTERIOR OR EXTERIOR) OR R-13 CAVITY INSULATION ON THE BASEMENT/CRAWL WALL
(A) FOR HEATED SLABS R-5 SHALL BE ADDED TO THE REQUIRED SLAB EDGE R VALUES
(B) EXCEPTION: COMPLIANCE MAY BE DETERMINED BY A VISUAL INSPECTION BASED ON THE CRITERIA LISTED IN IECC TABLE 402.4.2 (IN LIEU OF BLOWER DOOR)
(C) EXCEPTION: DUCT TIGHTNESS TEST IS NOT REQUIRED IF THE AIR HANDLER AND ALL DUCTS ARE LOCATED WITHIN CONDITIONED SPACE
(D) THIS REQUIREMENT WILL TAKE EFFECT ONE YEAR AFTER THE EFFECTIVE DATE OF THIS RULE (1/1/14)
(E) BUILDING FRAMING CAVITIES SHALL NOT BE USED AS SUPPLY DUCTS
(F) EXCEPTION: PRE MANUFACTURED FIREPLACES MUST BE INSTALLED PER MANUFACTURERS INSTRUCTIONS (WHICH MAY OR MAY NOT INCLUDE GASKETED DOORS AND OUTSIDE AIR)

(OHBA) OHIO HOME BUILDERS ASSOCIATION
(RCO) RESIDENTIAL CODE OF OHIO
(IECC) INTERNATIONAL ENERGY CONSERVATION CODE

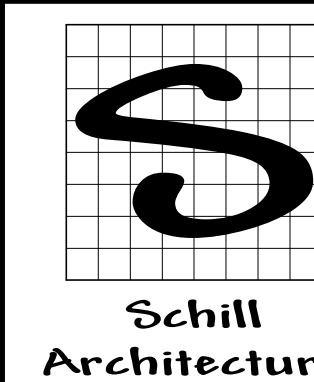

THESE DRAWINGS, DESIGN, AND SPECIFICATIONS ARE THE SOLE PROPERTY OF SCHILL ARCHITECTURE, LLC. © STEPHEN M. SCHILL, ARCHITECT. THEY ARE TO BE USED ONLY WITH THIS PROJECT AND MAY NOT BE REPRODUCED OR ALTERED WITHOUT WRITTEN PERMISSION. THIS COPYRIGHT PROTECTION INCLUDES, BUT IS NOT LIMITED TO, THE OVERALL FORM, AS WELL AS THE ARRANGEMENT, COMPOSITION OF SPACES & ELEMENTS OF DESIGN.

Schill
Architecture

© 2016 SCHILL ARCHITECTURE, LLC

SCHILL ARCHITECTURE, LLC

TELEPHONE: 440.808.3485
FACSIMILE: 440.808.3485
WWW.SCHILLARCHITECTURE.COM

OFFICE ADDRESS:
1650 CROSSINGS PARKWAY SUITE E
WESTLAKE, OHIO 44145



EMAIL ADDRESS:
STEVE@SCHILLARCHITECTURE.COM

DESIGN LOADS			
COMPONENT	LIVE LOAD	DEAD LOAD	TOTAL LOAD
ATTIC (WALK UP STORAGE)	30 P.S.F.	15 P.S.F.	45 P.S.F.
ATTIC (LIMITED STORAGE)	20 P.S.F.	15 P.S.F.	35 P.S.F.
ATTIC (NO STORAGE)	10 P.S.F.	15 P.S.F.	25 P.S.F.
DECKS	40 P.S.F.	15 P.S.F.	55 P.S.F.
EXTERIOR BALCONIES	60 P.S.F.	15 P.S.F.	75 P.S.F.
GUARDRAIL AND HANDRAILS	200 P.S.F.	15 P.S.F.	215 P.S.F.
GUARDRAIL INFL COMPONENTS	50 P.S.F.	15 P.S.F.	65 P.S.F.
PASSENGER VEHICLE GARAGES	50 P.S.F.	15 P.S.F.	65 P.S.F.
ROOMS OTHER THAN SLEEPING ROOMS	40 P.S.F.	15 P.S.F.	55 P.S.F.
SLEEPING ROOMS	40 P.S.F.	15 P.S.F.	55 P.S.F.
STAIRS	40 P.S.F.	15 P.S.F.	55 P.S.F.
ROOFS	25 P.S.F.	15 P.S.F.	40 P.S.F.
SNOW	25 P.S.F.	N.A.	25 P.S.F.
WIND	15 M.P.H.	N.A.	15 M.P.H.
SOIL BEARING	3000 P.S.F.	N.A.	3000 P.S.F.

NOTES:
1. ASSUMED SOIL BEARING CAPACITY IS 3000 P.S.F. A GEOTECHNICAL ENGINEER SHALL BE RETAINED AND THE ARCHITECT SHALL BE NOTIFIED AT ONCE IF UNUSUAL OR UNSTABLE SOIL CONDITIONS EXIST.
2. NOTIFY ARCHITECT IF STONE OR TILE FLOORING IS TO BE USED.
3. NOTIFY ARCHITECT IF ROOFING MATERIAL IS OTHER THAN ASPHALT SHINGLE.

MATERIAL SUMMARY		
SPACE	MATERIAL	HEIGHT
MAIN FLOOR	WOOD-2"x4"/2"x4"	N.A.
UPPER FLOOR	WOOD-2"x4"/2"x4"	N.A.
THIRD FLOOR	WOOD-2"x4"/2"x4"	8' 0"

AREA SUMMARY	
AREA	SIZE
UNFINISHED LOWER LEVEL	0,000 SQ.FT.
FINISHED LOWER LEVEL	0,000 SQ.FT.
MAIN LEVEL	0,000 SQ.FT.
UPPER LEVEL	0,000 SQ.FT.
UPPER LEVEL(VOLUME SPACE)	0,000 SQ.FT.
THIRD FLOOR	646 SQ.FT.
TOTAL HEATED AREA	646 SQ.FT.
GARAGE	0,000 SQ.FT.
ARRIVAL PORCH	0,000 SQ.FT.
FRIENDS/ FAMILY PORCH	0,000 SQ.FT.
MAIN LEVEL COVERED REAR PORCH	0,000 SQ.FT.
LOWER LEVEL COVERED REAR PORCH	0,000 SQ.FT.
TOTAL AREA UNDER ROOF	646 SQ.FT.
REAR PORCH (NOT COVERED)	0,000 SQ.FT.
TOTAL PROJECT AREA	646 SQ.FT.
AREA CALCULATIONS ARE MADE FROM THE OUTSIDE FACE OF EXTERIOR WALLS, STAIRWELLS AND FIREPLACE AREAS ARE INCLUDED ONCE, GARAGES, OPEN SPACES, DECKS, PATIOS, AND EXTERIOR PORCHES ARE NOT INCLUDED IN THESE FIGURES. THEY ARE SUMMARIZED AS ADDITIONAL AREAS IN THIS TABLE.	

	ISSUED FOR PERMIT AND BIDDING	15 SEPT 2026
	ISSUED FOR PERMIT AND BIDDING	15 AUG 2026

REV. NO.	DESCRIPTION	DATE
----------	-------------	------


PROJECT:
**THIRD FLOOR CONVERSION TO:
A PRIVATE RESIDENCE:**

LOCATION:20981 MOREWOOD PARKWAY
ROCKY RIVER, OHIO 44116
CUYAHOGA COUNTY
PERMANENT PARCEL NUMBER: 301-13-123

SPECIFICATIONS

SCALE: AS NOTED	JOB NUMBER: 26EKC00G
--------------------	-------------------------

DATE: 1 JULY 2026 CAD FILE NAME: C:\DRAWINGS\CENTRAL\ARCHIVE\ SCHILL\RCO2009\CONCEPT.CAD	
---	--

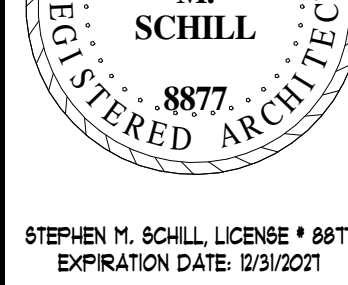

STEPHEN M. SCHILL, LICENSE # 8871
EXPIRATION DATE: 12/31/2021

A-6

DRAWING NUMBER